


2025 Public Health Goals

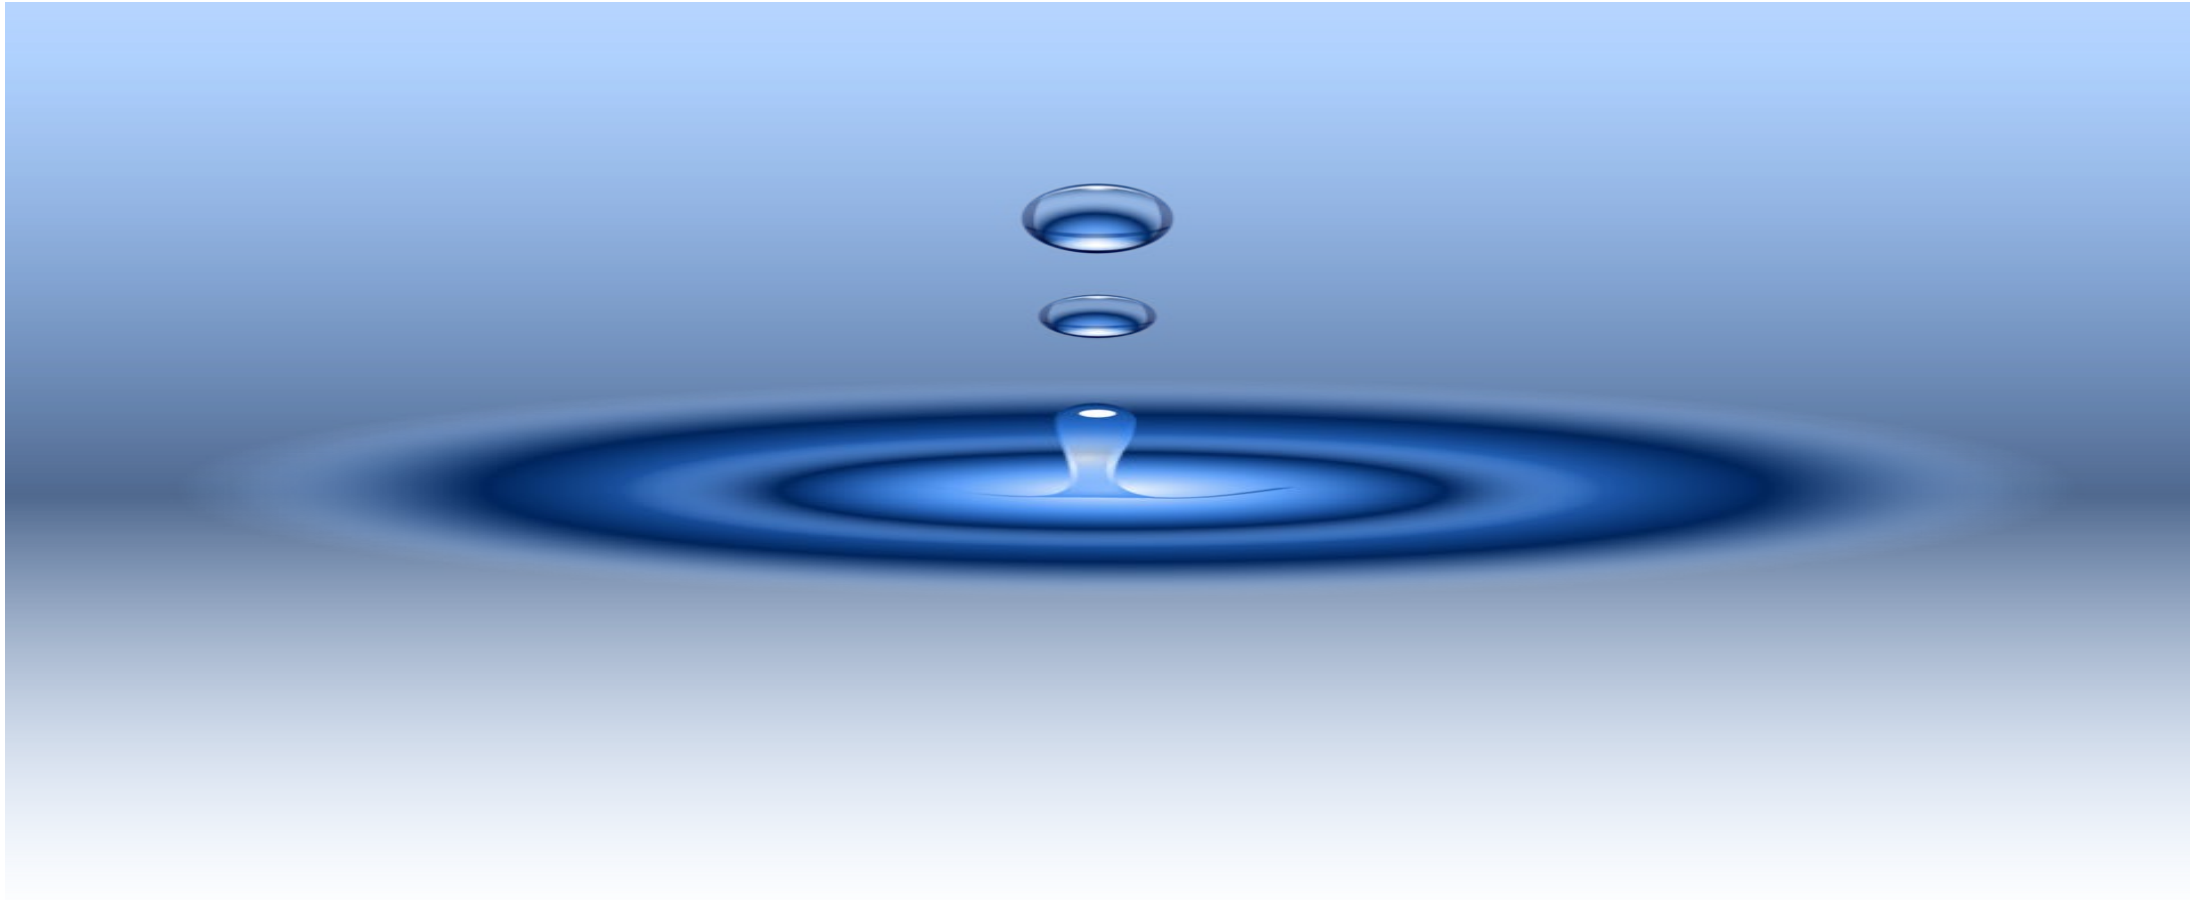

BACKGROUND

- The Calderon-Sher Drinking Water Act of 1996 added new provisions to the California Health and Safety Code which mandate that a report be prepared every three years to provide water quality information to the public in addition to the Consumer Confidence Reports (CCR).
- This report has been prepared to address the requirements set forth in Section 116470 of the California Health and Safety Code. It is based on water quality analyses during the years of **2022, 2023, 2024**.
- The law requires that a public hearing be held for the purpose of accepting and responding to public comment on the report.

WHAT ARE PUBLIC HEALTH GOALS (PHGS)?

- PHG is the **safe level** of concentration which poses no significant health risk if consumed for a lifetime.
- The process of establishing a PHG is a risk assessment based strictly on human health considerations.
- PHGs are recommended targets and are not required to be met by any public water system.
- PHGs are developed by the California Environmental Protection Agency's Office of Environmental Health Hazard Assessment.





What is Maximum Contaminant Level?

- Upon establishment of a PHG, the California State Water Resources Control Board Division of Drinking Water and Environmental Management (SWRCB) determines a Maximum Contaminant Level (MCL) in drinking water.
- The MCL is the highest level of concentration that is **allowed** in drinking water for a constituent.


The PHGs Report Detected Three Constituents Above the Public Health Guidelines:

- ARSENIC
- HEXAVALENT CHROMIUM
- 2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)

ARSENIC

- **Arsenic** is a semi-metal element in the periodic table. It is a naturally occurring element that is found in combination with either inorganic or organic substances, and are found in soils, sediment, and sand groundwater.
- The Public Health Goal (PHG) for arsenic in drinking water is 0.004 ppb (parts per billion).
- The Maximum Contaminant Level (MCL) for arsenic is 10 ppb.
- Therefore, **safe** levels of arsenic in drinking water is any level under 10 ppb, zero being the safest.
- Arsenic was found to occur in only one groundwater well – City Well 2, and not in any other wells.
- It should be noted that City Well 2 water is blended with additional water sources that contain no detection levels of arsenic.

Detection Levels Arsenic

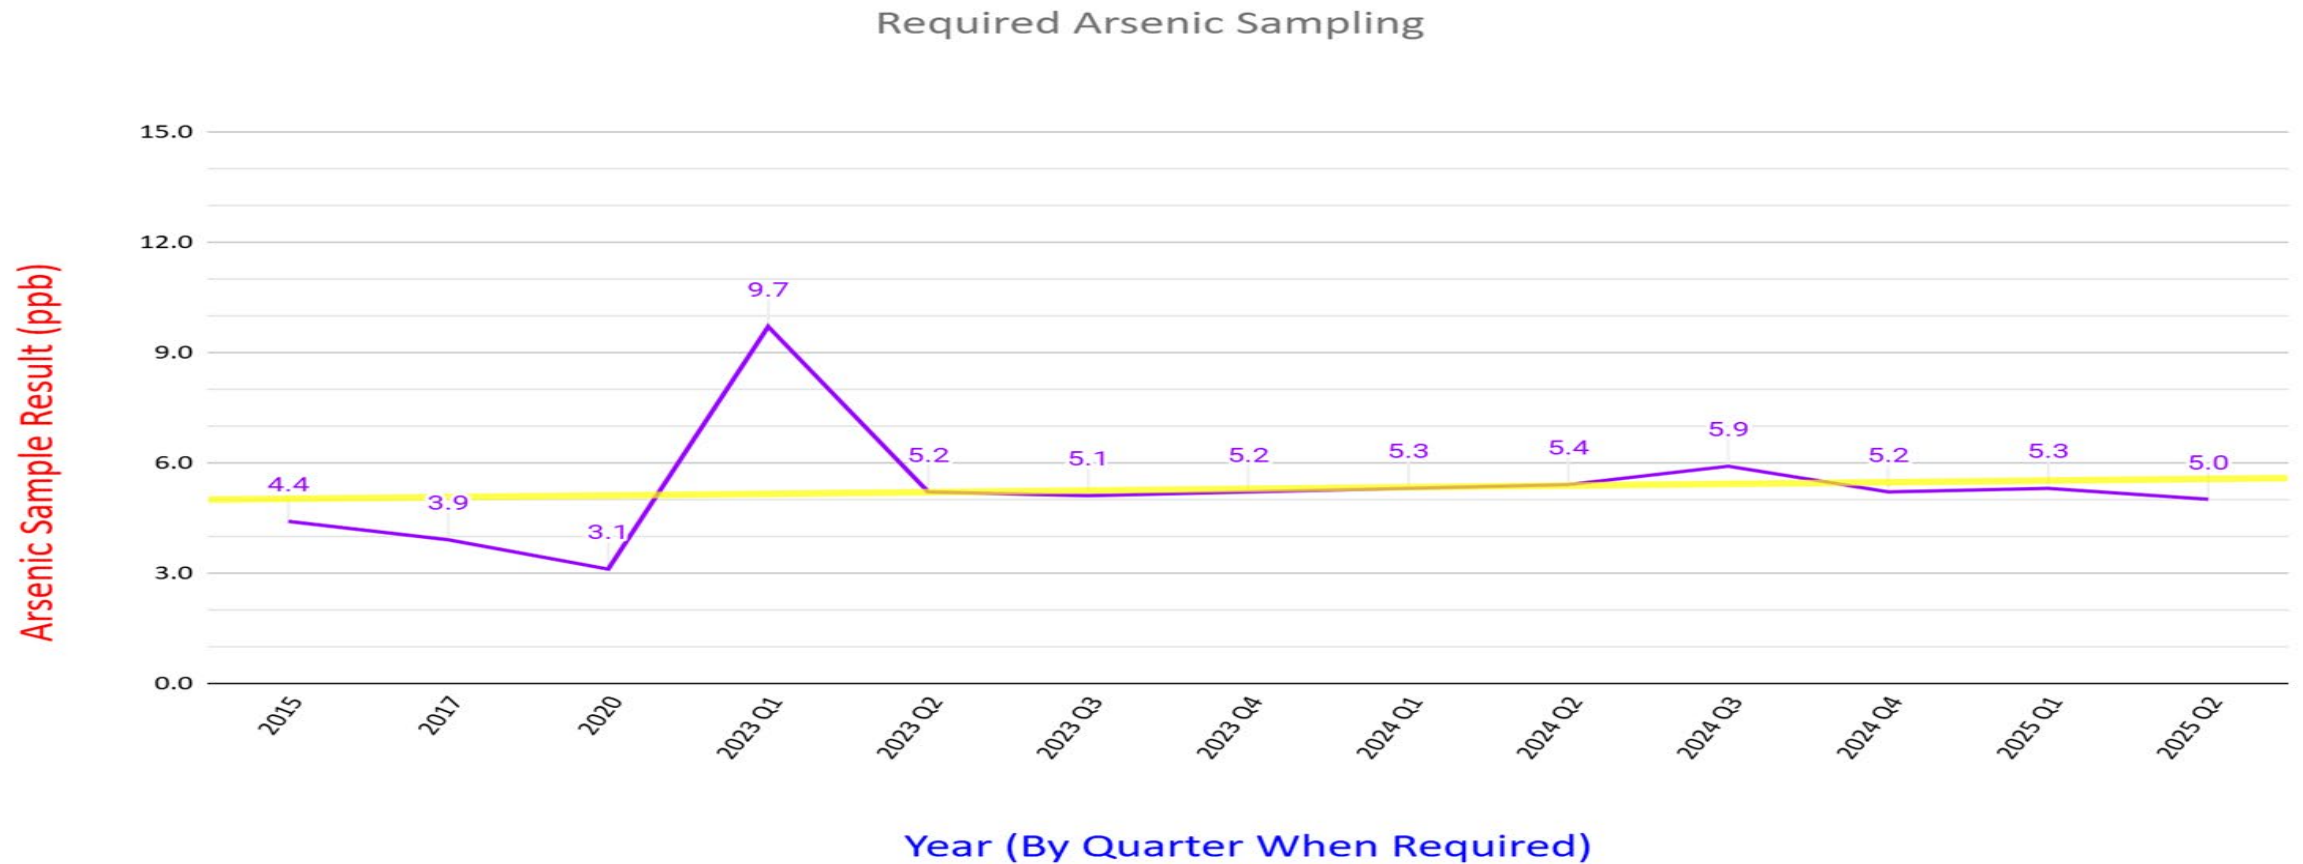

New Detected Contaminants

Department of Drinking Waters 2023-2024 Guidelines

- HEXAVALENT CHROMIUM
- 2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)

HEXAVALENT CHROMIUM

- **HEXAVALENT CHROMIUM** is a form of the metallic element chromium. Chromium is a naturally occurring element found in rocks, animals, plants, soil, and volcanic dust and gases. , and are found in soils, sediment, and sand groundwater.
- The Public Health Goal (PHG) for Hexavalent Chromium in drinking water is 0.002 ppb (parts per billion).
- The Maximum Contaminant Level (MCL) for arsenic is 10 ppb.
- Therefore, **safe** levels of Hexavalent Chromium in drinking water is any level under 10 ppb, zero being the safest.

Detection Levels HEXAVALENT CHROMIUM

SOURCE	PHG ppb	MCL ppb	RESULT ppb	DATE
Chino 2	0.02	10	2.8	10/17/2024
City 2	0.02	10	0.97	10/17/2024
City 4A	0.02	10	0.58	10/17/2024
Rialto 3	0.02	10	1.7	10/17/2024
Miro 3	0.02	10	1.2	10/17/2024
EW-1	0.02	10	1.2	10/17/2024
SWTP	0.02	10	0.16	10/17/2024
Baseline Feeder	0.02	10	1.4	10/17/2024

2,3,7,8-

Tetrachlorodibenzo-p-dioxin (TCDD)

- **2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)** It's a colorless solid with no odor, and it's usually formed as a byproduct of burning processes or organic synthesis. and are found in soils, sediment, and sand groundwater.
- The Public Health Goal (PHG) for arsenic in drinking water is 0.05 PHG (picogram/liter).
- The Maximum Contaminant Level (MCL) for **2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)** is 30 picogram/liter.
- Therefore, **safe** levels of **2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)** in drinking water is any level under 30 picogram/liter, zero being the safest.

Detection Levels

2,3,7,8-Tetrachlorodibenzo-p-dioxin (TCDD)

SOURCE	PHG picogram/liter	MCL picogram/liter	RESULT picogram/liter	DATE
Chino 2	0.05	30	3.46	6/7/2023
City 2	0.05	30	2.64	6/7/2023
EW-1	0.05	30	4.92	6/7/2023
Miro 3	0.05	30	2.86	6/7/2023
Baseline Feeder	0.05	30	1.17	6/7/2023

QUESTIONS

The 2022, 2023, 2024, edition of the 2025
Public Health Goals Report

and

2024 Consumer Confidence Report