

# **RWS/Veolia Monthly Operations Report**

## **February 2026**

**Reporting period December 2025**



**RIALTO  
CUSTOMER SERVICE & REVENUE  
MONTHLY OPERATIONS REPORT**

**Reporting Period:  
December 2025**

**Prepared for: Rialto Water Services**

**Prepared by: Veolia Water West Operating Services**



## Table of Contents

<b>I. CUSTOMER SERVICE SUMMARY.....</b>	<b>3</b>
<b>II. CALL CENTER PERFORMANCE.....</b>	<b>3</b>
<b>III. AUTOMATED SERVICES.....</b>	<b>3</b>
<b>IV. CONSUMPTION &amp; BILLING.....</b>	<b>4</b>
<b>A. Consumption.....</b>	<b>4</b>
<b>B. Billing.....</b>	<b>4</b>
<b>V. REVENUE &amp; AGING.....</b>	<b>5</b>
<b>A. Revenue .....</b>	<b>5</b>
<b>B. Aging .....</b>	<b>6</b>
<b>C. Bad Debt.....</b>	<b>6</b>
<b>VI. SERVICE ORDERS .....</b>	<b>7</b>
<b>VII. OTHER ACTIVITIES .....</b>	<b>7</b>
<b>VIII. REVENUE REPORT .....</b>	<b>7</b>
<b>A. Revenue Summary.....</b>	<b>7</b>
<b>B. Non Rate Revenue - Extraterritorial Customers.....</b>	<b>7</b>
<b>C. Non-Rate Revenue – Other .....</b>	<b>8</b>
<b>D. Development Impact Fees.....</b>	<b>8</b>
<b>E. Rialto Basin Water Rights and Leasing .....</b>	<b>8</b>
<b>F. Payment Collection Method – Fiscal Year to Date.....</b>	<b>10</b>
<b>G. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison.....</b>	<b>10</b>
<b>H. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison .....</b>	<b>10</b>
<b>I. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date.....</b>	<b>11</b>
<b>J. Increase in Cash Collections and Fund Distribution—Prior Year Comparison .....</b>	<b>11</b>
<b>K. Non-Rate and Extraterritorial Customer Accounts Receivable Aging .....</b>	<b>12</b>

## I. CUSTOMER SERVICE SUMMARY


During this reporting month, the Customer Service team provided call service level of 88.7%. Out of 1,417 inbound calls answered 1,257 answered within the first 30 seconds.

Water consumption has decreased by 34.3% when compared against previous month. When compared against last year, consumption has decreased by 14.3%.

Sewer revenue has decreased by 2.2% compared to the prior month and increased by 6.2% from last year.

## II. CALL CENTER PERFORMANCE

During this reporting month, service level was 88.7% with 1,257 out of 1,417 being answered within the first 30 seconds. Overall average wait time was forty-seven (47) seconds.

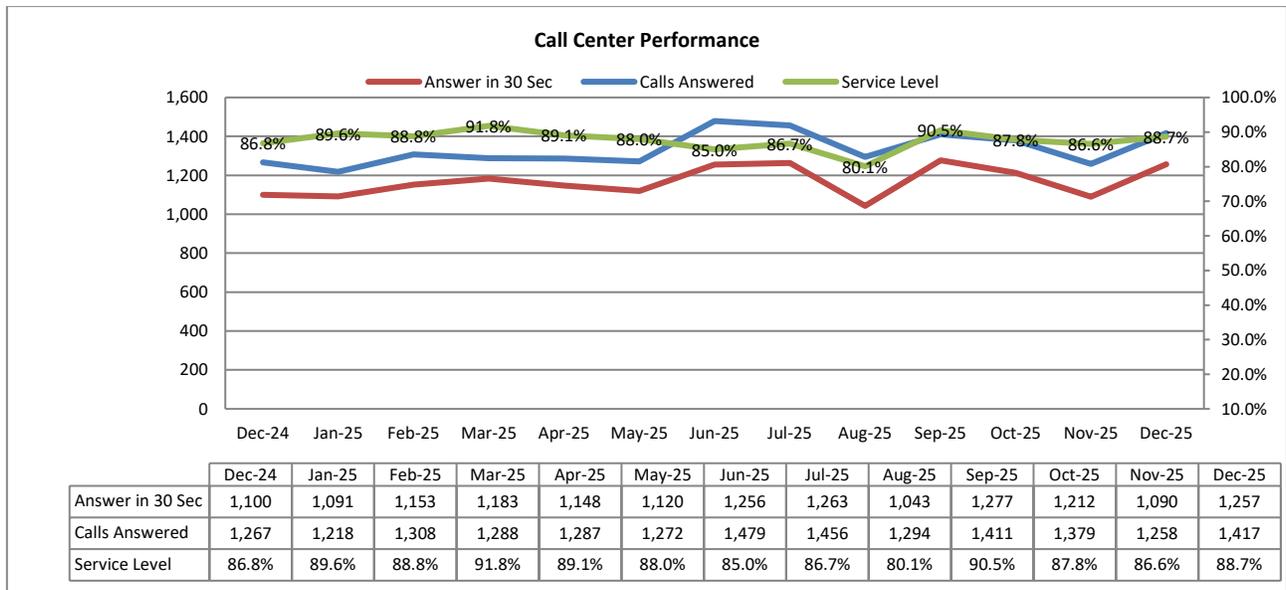

## III. AUTOMATED SERVICES



About 13,145 or 57.3 % of the rate payers have created log-ins to access their accounts online. Of these customers, with online access, 48.1% have chosen the e-bill option. This e-bill participation is 13.3% increase from December of the prior year.

	Dec-24	Jan-25	Feb-25	Mar-25	Apr-25	May-25	Jun-25	Jul-25	Aug-25	Sep-25	Oct-25	Nov-25	Dec-25
Number of Bills	22,575	22,587	22,604	22,657	22,694	22,705	22,770	22,792	22,838	22,864	22,875	22,927	22,913
Number of Bill Adjustments (during billing)	29	17	10	29	25	15	18	29	10	7	8	11	27
Automated Over the Phone Payments	2,436	2,509	2,040	2,509	2,454	2,276	2,578	2,596	2,344	2,531	2,560	2,089	2,404
Online Payment	10,320	9,747	7,676	9,912	9,798	8,434	9,800	10,260	8,691	11,224	10,369	7,614	10,432
E-bill Participants	5,959	5,997	6,031	6,069	5,969	6,000	6,074	6,134	6,185	6,233	6,290	6,332	6,372
Auto Pay Participants (New Portal)	4,367	4,420	4,467	4,536	4,554	4,630	4,696	4,728	4,776	4,834	4,881	4,923	4,978
PayNearMe	95	108	73	99	97	88	88	88	88	103	85	80	80

## IV. CONSUMPTION & BILLING

### A. Consumption

Water consumption has decreased by 34.3% when compared against previous month. When compared against last year, consumption has decreased 14.3%.

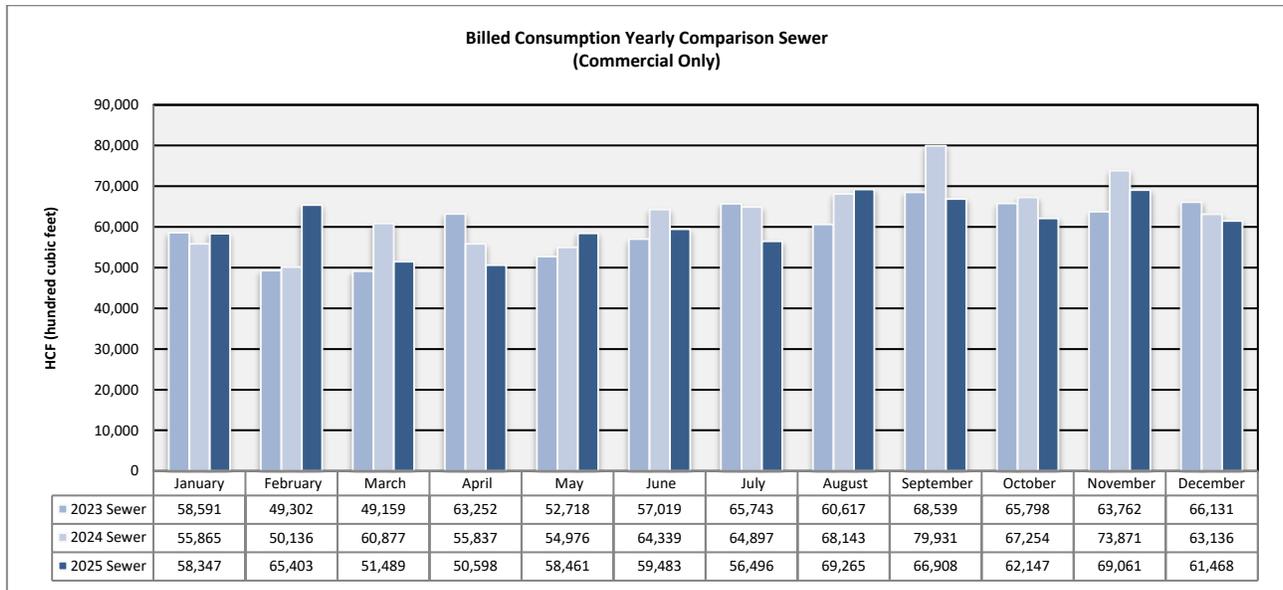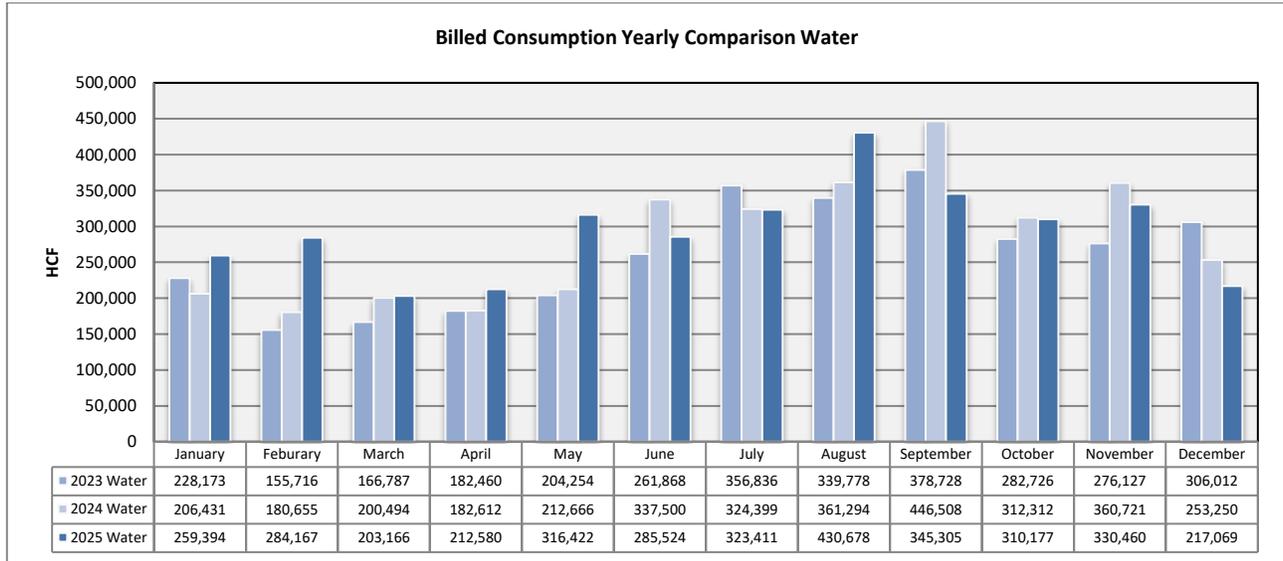


### B. Billing

A total of 22,913 bills were mailed or sent out electronically in December. Billing accuracy was 99.9% with twenty-seven (27) requiring adjustments after bill generation.


## V. REVENUE & AGING

### A. Revenue

Water revenue has decreased 21.9% when compared against the prior month and increased 4.3% when compared against previous year. Sewer revenue has decreased 2.2% compared to the prior month and increased by 6.2% from last year.


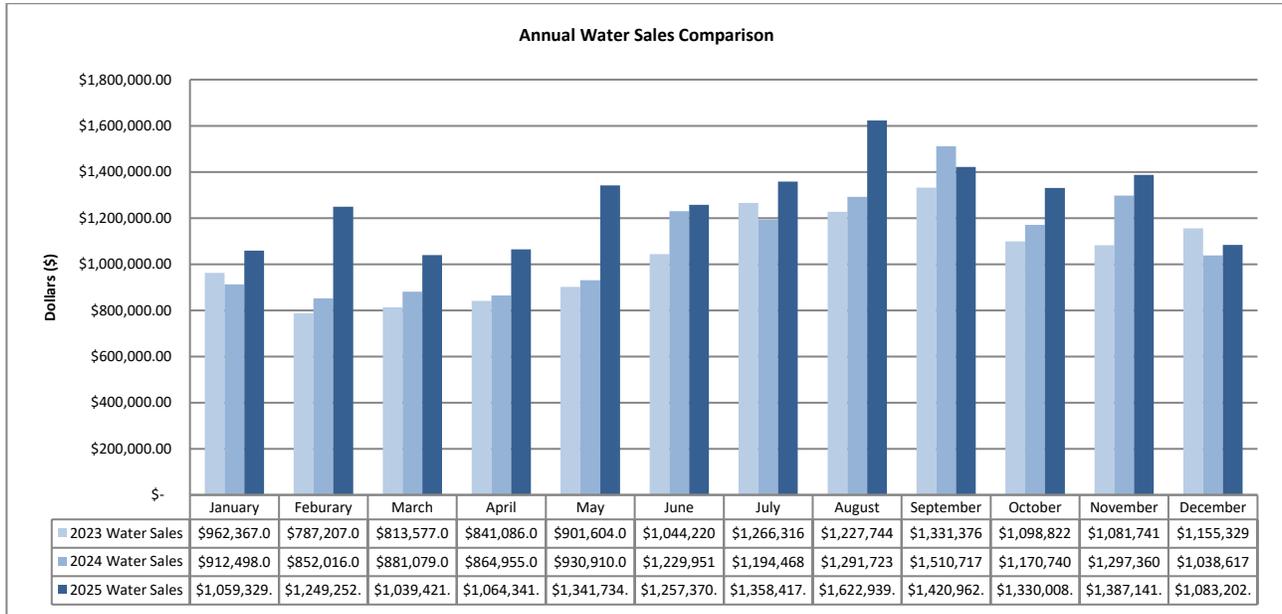


(Please consider the scale of the graph as doubled height does not mean double the amount)

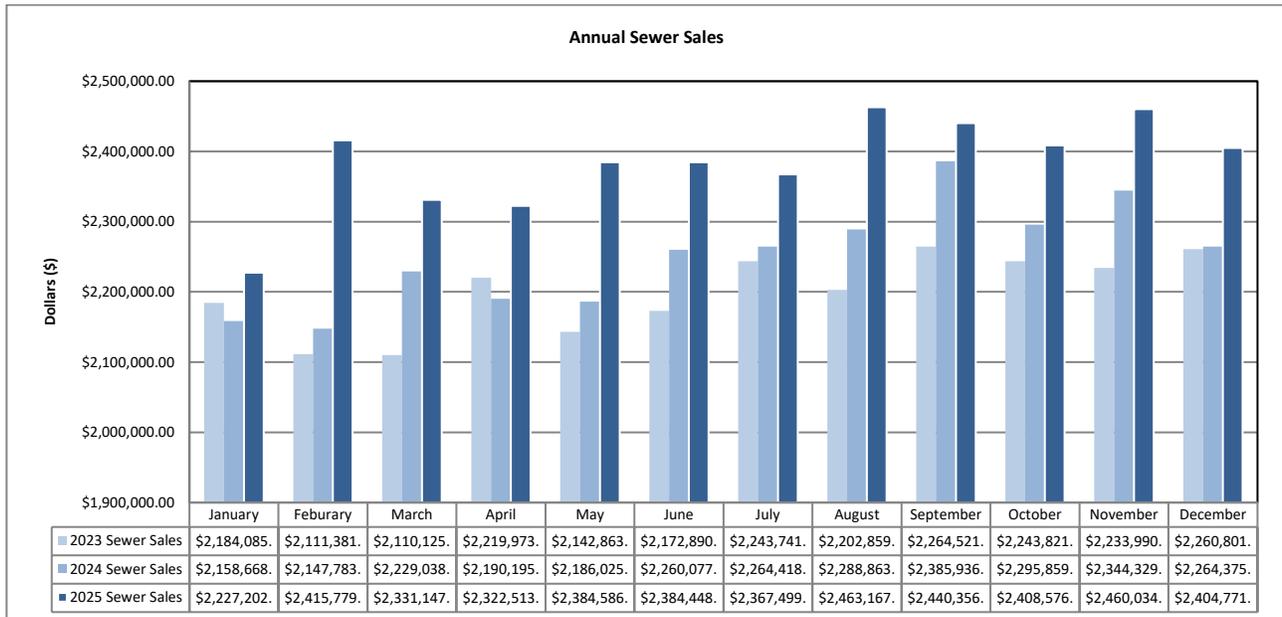

## B. Aging

The total aging balance has decreased by 4.3%, *see first table below*. For balances >30-days only, water has increased 10.4% and wastewater has increased by 19.7%. Sewer balances are expected to continue rising until tax roll in year 2026.

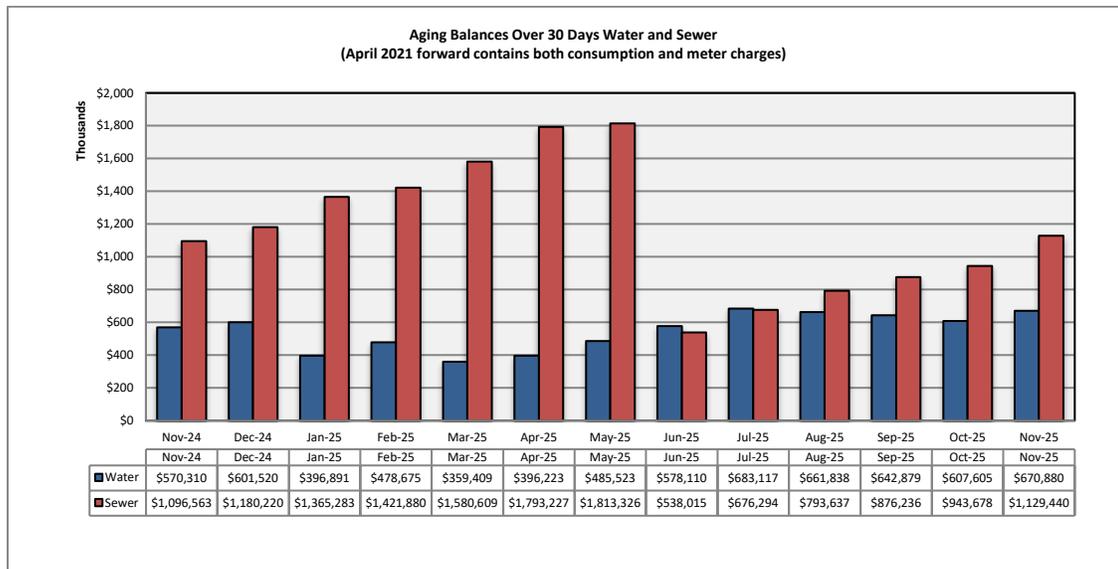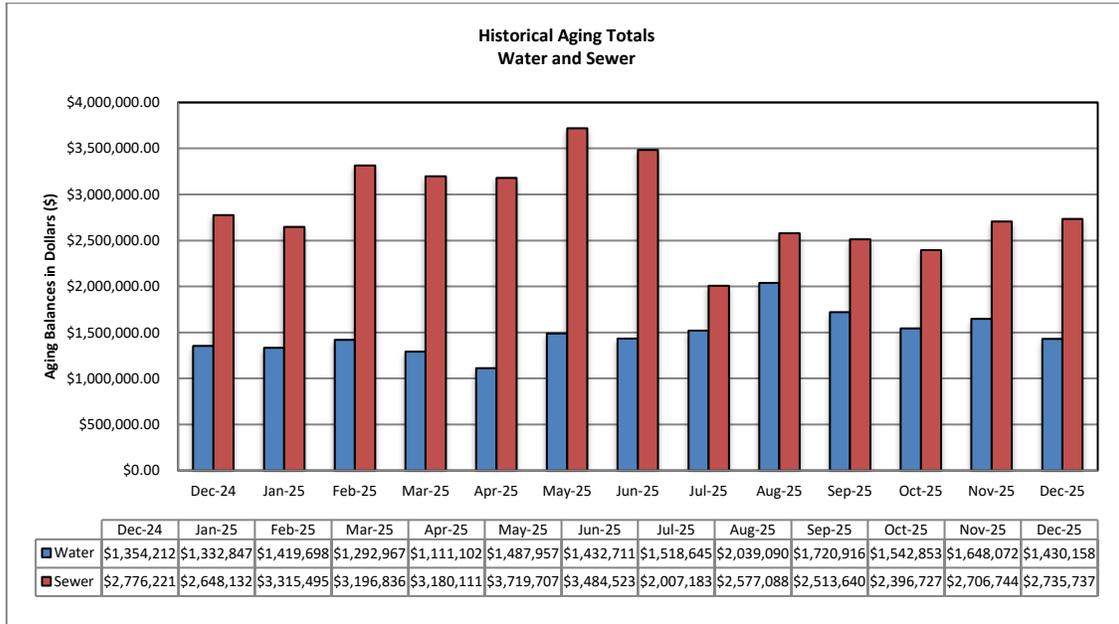

## C. Bad Debt

Fourteen (14) accounts were sent to collections for a total amount of \$3,341.05. These bad debts arise from customers moving out or selling the property and not closing the account with final payments.

## **VI. SERVICE ORDERS**

349 service orders were initiated by the customer service team during the reporting month. Of this total, 73 service orders or 21% were due to occupant changes.

214 service orders were initiated to accommodate water disconnection for non-payment and reconnection of water services when customer set up (or reinstate) a payment arrangement with down payment.

## **VII. OTHER ACTIVITIES**

CS department is operating with full staff with no injuries reported.

Total numbers of 1,104 disconnections were performed during the year 2025. This number is posted on rialtowater.com to comply with the SB998 requirements.

## **VIII. REVENUE REPORT**

### **A. Revenue Summary**

Cash Revenue is compiled and reconciled to the merchant account on a daily basis. Cash receipts and deposits are made daily and internal controls are reviewed regularly to ensure safeguarding of assets and proper recording of all transactions. Total revenue collected in December 2025 is \$4,289,000 whereas Non-Rate Revenue is \$547,000; Utility Revenue is \$3,673,000 and Tax / Ambulance Revenue at \$69,000.

RWS collects Utility User Taxes and Ambulance Fees on behalf of the City of Rialto. The Utility User Tax (UUT) rates are based on the total billed amount, therefore the collection fluctuates as billed amounts change. The total UUT charges collected in December 2025 and December 2024 are \$64,000 and \$269,000 respectively. The large variance in collection of UUT charges is due to the City exempting UUT charges to the Residential customers beginning January 2025 through December 2025. Ambulance Revenue is also collected on behalf of the City of Rialto totaling \$5,000 in December 2025 and \$5,000 in December 2024.

### **B. Non Rate Revenue - Extraterritorial Customers**

RWS bills the City of Fontana \$133,000 each month for extraterritorial sewer usage.

Colton Unified School District is in agreement with RWS to pay \$5,000 monthly for sewage connections based on enrollment rates provided each school year.

An extraterritorial agreement to provide sewer service was executed between the City of Rialto and the County of San Bernardino—County Service Area 70, Zone BL (Bloomington).

This housing development project generates extraterritorial sewer service revenue of \$20,000 per month.

The City has an agreement with Social Science Services dba Cedar House Life Change Center to provide extraterritorial sewer service providing sewer revenue of about \$5,000 each month.

**C. Non-Rate Revenue – Other**

Other revenue is generated by leasing space for cell towers to AT&T, which has two leases at \$2,073 and \$1,500. Sprint lease is at a currently contracted rate of \$2,000 each month. Vertical Bridge also provides \$2,400 a month of cell tower generated Revenue.

Rialto Bioenergy Solutions subleased a City property for \$10,750 a month.

The City and San Bernardino Valley Municipal Water District have entered into a Brine Line Capacity Agreement on December 23, 2021. This agreement pertains to the use of its interest in the SARI Line and discharge of certain brine waste to the SARI Line exclusively from the operation of Rialto Bioenergy Facilities within the City’s boundaries. The revenue generated in this agreement consists of quarterly rent of \$37,500 along with the Fixed Pipeline Capacity Fee of \$3,300 per month and Fixed Treatment Plant Capacity Fee of \$3,300 per month. In addition, a variable fee of any discharge costs are also billed.

The San Bernardino Valley Water District (SBVWD) reimburses RWS for water conservation programs provided to customers. A quarterly bill is delivered directly by the City.

**D. Development Impact Fees**

Development Impact Fees (“DIF”) are paid to the City of Rialto as various developments are completed in the City. As such, the City of Rialto receives monies from the various developments, which is then distributed to RWS. There was no DIF payment received in December of 2025.

**E. Rialto Basin Water Rights and Leasing**

A Standby Water Lease Agreement between Fontana Union Water Company and City of Rialto is in effect. For the 2024-2025 Water Year, RWS billed San Bernardino County the amount of \$349,264 for the Standby Charges and Production Charge. The County paid and has no further Water Lease obligations in the current year.

In addition, the County is also billed annually for Rialto Well #3’s summertime electricity costs based on peak usage.

### Cash Collections by Payment Method – Rialto Water Services

Payment Method	Description	Transaction Count	DECEMBER 2025	%
Carrier Deposits	Cash deposits prepared per day for transport to US Bank.	22	\$ 142,623	0.03407052
Remote Deposits	Scanned batches of checks payments made at the customer service counter	22	762,404	18.21%
EBOX	Batches of electronic customer payments posted to customer accounts at US Bank.	22	341,059	8.15%
PAYMENTUS - IVR / Paymentus / Walk-in Credit Card payment	Customer payments by credit cards and ACH / eCheck payments through an Interactive Voice Response system using a touchtone phone. Payments originated from Merchant online service	13,881	2,080,662	49.70%
Lockbox Deposits	Batches of customer payments mailed in to US Bank's lockbox	22	848,106	20.26%
Pay Near Me	Cash payment service that allows customers to pay at a local 7-Eleven, CVS, Walmart or Family Dollar stores.	86	11,254	0.27%
<b>Total Revenue per Bank</b>			<b>\$ 4,186,107</b>	<b>100.00%</b>
Recon to RUA Recap:				
Adj detailed in RUA			103,158	
Prior mo. Correction				
<b>RUA increase in Cash</b>			<b>\$ 4,289,265</b>	

*Transaction Counts for Carrier Deposits, Remote Deposits, UB Bill Conc Service (EBOX), and Lockbox Deposits reflect number of batches deposited to the bank. Transaction counts for credit card POS, IVR, and Pay-Near-Me transactions are per number of customer payments. IVR payments are received and process by Paymentus on the day the transactions are made. General ledger are posted and accounted for the following day the payments are processed.*

**F. Payment Collection Method – Fiscal Year to Date**

	Jul 2025	Aug 2025	SEPT 2025	OCT 2025	NOV 2025	DEC 2025	Total	%
Carrier Deposits	\$ 144,793	\$ 140,286	\$ 155,654	\$ 147,234	\$ 103,022	\$ 142,623	\$ 833,611	3.40%
Remote Deposits	499,489	241,420	686,008	995,009	311,584	762,404	\$ 3,495,913	14.27%
EBOX	407,888	286,741	367,169	378,253	237,351	341,059	\$ 2,018,462	8.24%
Paymentus, IVR, Credit Cards	2,118,383	1,853,657	2,370,061	2,278,360	1,572,041	2,080,662	\$12,273,164	50.11%
Lockbox Deposits	1,176,928	904,658	1,003,875	1,162,475	707,921	848,106	\$ 5,803,963	23.69%
Pay Near Me	11,821	11,616	14,142	11,316	9,254	11,254	\$ 69,404	0.28%
<b>Total Revenue to Bank</b>	<b>\$4,359,302</b>	<b>\$3,438,377</b>	<b>\$ 4,596,910</b>	<b>\$ 4,972,646</b>	<b>\$ 2,941,173</b>	<b>\$ 4,186,107</b>	<b>\$24,494,516</b>	<b>100.00%</b>
NSF	(10,757)	(15,745)	(17,442)	(15,892)	(14,628)	(20,682)	\$ (95,146)	
<b>Net deposits</b>	<b>\$4,348,546</b>	<b>\$3,422,632</b>	<b>\$ 4,579,468</b>	<b>\$ 4,956,754</b>	<b>\$ 2,926,545</b>	<b>\$ 4,165,425</b>	<b>\$24,399,370</b>	

**G. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison**

	DEC 2025	DEC 2024	Variance
UUT Water	\$ 25,719	\$ 86,944	\$ (61,225)
UUT Sewer	38,099	182,162	(144,063)
Ambulance	5,622	5,767	(146)
<b>Total</b>	<b>\$ 69,440</b>	<b>\$ 274,874</b>	<b>\$ (205,433)</b>

**H. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison**

	DEC 2025	DEC 2024	Variance
Non-Rate / Extra Territorial Revenue	\$ 547,200	\$ 143,345	\$ 403,855
Utility Revenue	\$3,672,625	\$3,692,515	(19,890)
<b>Total</b>	<b>\$4,219,825</b>	<b>\$3,835,861</b>	<b>\$ 383,965</b>

**I. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date**

	Jul 2025	Aug 2025	Sept 2025	Oct 2025	Nov 2025	Dec 2025	Total
<b>Non-Rate Revenue</b>							
Cell Tower Rent, Lease	21,485	17,154	15,080	53,897	13,580	14,324	135,520
Interest Income	-	-	-	-	-	-	-
NRR-FOG	-	-	-	-	-	-	-
Municipal Water Sales	-	-	-	-	-	349,264	349,264
Extra Terr- Sewage	169,483	6,711	107,820	583,011	35,551	174,217	1,076,793
Abatement of Expenses	-	-	-	-	-	-	-
Water Meter Lost/Damaged/Repl	22,650	17,176	13,295	16,075	14,366	1,557	85,120
Misc Fees - New Occ., Same Day Svc	10,815	7,182	7,522	9,355	6,949	7,834	49,657
Miscellaneous Revenue - Sewer	-	-	-	-	-	5	5
NSF	-	-	-	-	-	-	-
<b>Total Non-Rate Revenue</b>	<b>\$ 224,433</b>	<b>\$ 48,223</b>	<b>\$ 143,717</b>	<b>\$ 662,339</b>	<b>\$ 70,447</b>	<b>\$ 547,200</b>	<b>1,696,359</b>
<b>Utility Revenue</b>							
Water Penalty	30,460	33,752	31,754	37,988	34,640	29,186	197,780
Sewer Penalty	74,191	48,802	42,100	54,993	40,418	43,022	303,527
Turf Removal, Hi-Eff Rebate	(100)	-	-	-	-	-	(100)
Water Deposits Billed	16,142	15,863	16,027	17,938	13,085	7,527	86,582
Hydrant Deposits	315	158	161	68	-	197	899
Sewer Deposits Paid	-	-	-	-	-	-	-
Sewer Deposits Billed	16,204	16,667	15,480	15,055	12,065	9,677	85,147
Water	1,329,427	1,148,584	1,723,704	1,493,556	835,225	1,291,024	7,821,520
Sewer	2,760,649	1,949,745	2,492,623	2,526,711	1,594,009	2,385,765	13,709,502
Unapplied Credits	26,588	50,012	109,984	80,529	180,113	(93,772)	353,454
Bad Debt Sewer	-	-	-	-	-	-	-
Bad Debt Water	-	-	-	-	-	-	-
Tax Roll Sewer	-	-	-	-	-	-	-
Collection Agency - Water	-	-	-	-	-	-	-
Collection Agency - Sewer	-	-	-	-	-	-	-
Collection Agency - Misc Water	-	-	-	-	-	-	-
<b>Total Utility Revenue</b>	<b>\$4,253,876</b>	<b>\$3,263,582</b>	<b>\$4,431,832</b>	<b>\$ 4,226,839</b>	<b>\$ 2,709,556</b>	<b>\$ 3,672,625</b>	<b>\$ 22,558,310</b>
<b>Total Non-Rate + Utility Rev.</b>	<b>4,478,309</b>	<b>3,311,805</b>	<b>4,575,549</b>	<b>4,889,178</b>	<b>2,780,002</b>	<b>4,219,825</b>	<b>24,254,669</b>

**J. Increase in Cash Collections and Fund Distribution—Prior Year Comparison**

	Increase to Cash per Incode	Adjustments Required to GL Cash	Fund 660-Sewer	Fund 670-Water	Total Cash Per GL	Adjustments To Match RUA to Bank	Cash/CC/Cks Deposit To Bank
<b>Dec 2025</b>	4,289,265	24,159	2,478,266	1,786,840	4,289,265	(103,158)	<b>4,186,107</b>
<b>Dec 2024</b>	4,110,734	20,884	2,702,902	1,386,948	4,110,734	257,925	<b>4,368,659</b>

**K. Non-Rate and Extraterritorial Customer Accounts Receivable Aging**

Name	Total as of 12/31/2025	Current	31 to 60 days	61 to 90 days	>90 days
AT&T - Easton	\$ -	-	-	-	-
Cedar House	8,561	8,561	-	-	-
CITY OF FONTANA	131,182	131,182	-	-	-
Colton Unified School District	-	-	-	-	-
County of San Bernardino-CSA 70 BL	-	-	-	-	-
Rialto BioEnergy Facilities	124,782	124,782	-	-	-
Sprint-Nextel	5,530	-	-	-	5,530
San Bernardino Co Waste System Div	-	-	-	-	-
SB Valley Mun Water District	-	-	-	-	-
Vertical Bridge Holdco, LLC (CIG)	10,374	2,830	2,830	-	4,714
<b>Grand Total</b>	<b>\$ 280,429</b>	<b>\$ 267,356</b>	<b>\$ 2,830</b>	<b>\$ -</b>	<b>\$ 10,243</b>

**AT&T** makes annual payment of one cell tower rent and monthly dues on the other.

**Social Science Service (Cedar House)** balance reflects current service fees.

**City of Fontana** is current with its obligations.

**Colton Unified School District** has no balance due.

**County of San Bernardino** is current with its obligations.

**Rialto Bioenergy Solutions** is current with its obligations.

**Vertical Bridge Holdco, LLC and Sprint:** Vertical Bridge and Sprint have been contacted for open Invoices as well.

**San Bernardino County Waste System Division's** has no balance due.

**RIALTO WATER**  
**MONTHLY OPERATIONS REPORT**

**Reporting Period:**

**December 2025**

**Prepared for: Rialto Water Services**

**Prepared by: Veolia Water West Operating Services**

**RIALTO WATER**  
**OPERATIONS AND MAINTENANCE REPORT**

**Contents**

I.	EXECUTIVE SUMMARY	3
A.	Water Production Totals	4
B.	Static Water Levels	6
II.	REGULATORY	7
A.	Regulatory Submittals	7
B.	Sample Site Location Results	8
C.	Violations	10
D.	Source Water Total Dissolved Solids (TDS)	10
III.	HEALTH AND SAFETY	10
A.	Monthly Safety Program Overview	10
IV.	CHEMICAL USE	10
V.	ELECTRICAL USE	11
VI.	WATER QUALITY COMPLAINTS	11
VII.	OPERATIONS UPDATE	11
A.	Operational Wells	12
B.	Valve Activity	12
C.	Hydrant Flushing	12
D.	Sanitary Survey	13
VIII.	ASSET MANAGEMENT	13
A.	Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues	13
B.	Major Equipment and/or Machinery Outages	14
IX.	RAINFALL TOTALS	14

# RIALTO WATER

## MONTHLY OPERATIONS REPORT

### I. EXECUTIVE SUMMARY

Highlights of this month's Water O&M report include the following:

- The water distribution network achieved compliance with all permit requirements.
- No sample anomalies that require secondary sampling.
- No significant issues with water availability. The purchasing of water remained consistent and daily equalization tanks levels remained at anticipated volume for customer availability.
- The Preventative Maintenance Program, as well as Valve Exercising, continues to identify areas of focus for our Routine Repair and Replacement.

## A. Water Production Totals

Total water delivered into the Rialto system this month was 732.69 acre-feet. 639.96 acre-feet was delivered into the system from the groundwater wells (City 4A production is included in the well total). 39.29 acre-feet was delivered via the BLF transmission system (City 4A production has been deducted). 53.44 acre-feet came from the OPRTP.

DECEMBER 2025 DAILY PRODUCTION TOTALS IN ACRE FEET											
DATE	Chino 2	City 2	Rialto 3	Rialto 5	Miro 3	EW-1	Delivered Via BLF			OPRTP <sup>2</sup>	TOTAL <sup>3</sup>
							City 4A	6-9	Cactus <sup>1</sup>		
12/1/25	4.79	2.33	4.87	0.00	0.00	0.00	9.66	6.89	4.11	0.00	22.99
12/2/25	4.01	7.01	6.40	0.00	5.64	0.00	3.10	1.40	2.59	0.00	27.06
12/3/25	0.00	7.70	5.49	0.00	5.22	0.00	4.07	0.46	4.06	0.01	22.93
12/4/25	0.00	5.53	6.18	0.00	5.79	0.00	5.28	0.55	4.06	0.00	22.11
12/5/25	4.52	3.09	6.20	0.00	5.76	0.00	9.52	2.16	2.96	0.00	24.69
12/6/25	5.46	2.76	6.47	0.00	5.95	0.00	7.39	2.18	4.06	0.00	26.89
12/7/25	5.92	2.27	6.57	0.00	6.05	0.00	9.95	6.59	4.71	0.00	32.10
12/8/25	4.52	1.84	6.01	0.00	5.89	0.00	7.83	7.44	3.65	0.00	29.35
12/9/25	5.21	5.57	7.02	0.00	1.67	0.00	8.71	5.79	2.92	0.00	28.17
12/10/25	5.44	5.18	7.53	0.00	0.00	0.00	8.80	0.00	4.41	0.00	22.56
12/11/25	5.07	7.87	7.07	0.00	0.00	0.00	8.75	1.24	3.08	0.00	24.33
12/12/25	5.23	4.35	6.68	0.00	0.00	0.00	8.82	0.11	3.58	4.46	24.42
12/13/25	6.10	0.00	6.80	0.00	0.00	0.00	9.40	2.66	5.00	4.75	25.31
12/14/25	4.88	0.00	6.73	0.00	0.00	0.00	6.46	5.26	3.93	4.83	25.62
12/15/25	5.25	1.80	6.47	0.00	0.00	0.00	7.44	3.12	3.93	4.60	25.17
12/16/25	4.79	0.00	6.01	0.00	0.00	0.00	9.45	6.66	3.33	5.26	26.05
12/17/25	5.28	0.75	6.34	0.00	3.88	0.00	4.89	3.51	3.21	2.69	25.66
12/18/25	0.59	4.68	6.63	0.00	1.56	0.00	5.82	1.49	4.11	5.47	24.53
12/19/25	0.00	5.90	6.11	0.00	0.00	0.00	9.42	2.25	3.72	3.90	21.88
12/20/25	0.00	3.86	7.12	0.00	0.00	0.00	9.64	3.47	5.14	5.75	25.33
12/21/25	4.63	3.67	6.04	0.00	0.00	0.00	7.59	5.76	3.40	4.00	27.50
12/22/25	4.54	0.00	7.05	0.00	0.00	0.00	9.49	5.90	4.11	5.03	26.63
12/23/25	5.53	0.00	5.88	0.00	0.00	0.00	3.59	2.92	2.75	2.47	19.55
12/24/25	5.11	1.96	6.24	0.00	0.00	0.00	3.25	0.00	2.04	0.21	15.57
12/25/25	4.95	2.97	6.38	0.00	0.00	0.00	4.78	2.16	2.50	0.00	18.96
12/26/25	5.89	0.98	6.47	0.00	0.00	0.00	6.36	2.82	2.66	0.00	18.83
12/27/25	5.83	2.32	6.73	0.00	0.00	0.00	9.03	3.21	2.82	0.00	20.92
12/28/25	5.16	2.33	6.45	0.00	0.00	0.00	9.82	6.73	3.26	0.00	23.93
12/29/25	4.59	0.00	6.73	0.00	0.00	0.00	7.66	9.00	2.16	0.00	22.47
12/30/25	4.79	0.00	5.90	0.00	0.00	0.00	8.39	6.68	2.30	0.00	19.67
12/31/25	0.00	0.00	6.54	0.00	0.00	0.00	6.34	2.66	2.32	0.00	11.52
<b>TOTAL</b>	<b>128.08</b>	<b>86.71</b>	<b>199.10</b>	<b>0.00</b>	<b>47.40</b>	<b>0.00</b>	<b>230.71</b>	<b>111.07</b>	<b>106.89</b>	<b>53.44</b>	<b>732.69</b>
<b>MIN</b>	<b>0.00</b>	<b>0.00</b>	<b>4.87</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>3.10</b>	<b>0.00</b>	<b>2.04</b>	<b>0.00</b>	<b>11.52</b>
<b>MAX</b>	<b>6.10</b>	<b>7.87</b>	<b>7.53</b>	<b>0.00</b>	<b>6.05</b>	<b>0.00</b>	<b>9.95</b>	<b>9.00</b>	<b>5.14</b>	<b>5.75</b>	<b>32.10</b>
<b>AVE</b>	<b>4.13</b>	<b>2.80</b>	<b>6.42</b>	<b>0.00</b>	<b>1.53</b>	<b>0.00</b>	<b>7.44</b>	<b>3.58</b>	<b>3.45</b>	<b>1.72</b>	<b>23.64</b>

<sup>1</sup> Measured at point of connection at Cactus Reservoir site including production from City 4A. Amount may vary compared to billing.

<sup>2</sup> Measured at point of connection at Cedar Reservoir site. Amount may vary as compared to billing.

<sup>3</sup> City 4A is not included in total. It has been accounted for in the Purchased total.

**DECEMBER 2025 DAILY BOOSTER TOTALS IN ACRE FEET**

<b>DATE</b>	<b>Booster 1</b>	<b>Booster 2</b>	<b>Booster 3</b>	<b>Booster 4</b>	<b>Booster 5</b>	<b>Booster 6-9</b>	<b>Booster 10</b>	<b>Booster 11</b>
12/1/25	0.00	0.00	5.79	0.00	4.38	0.00	0.00	0.00
12/2/25	0.00	0.00	7.16	0.00	3.71	4.20	0.17	0.00
12/3/25	0.00	0.00	2.27	0.00	0.00	5.07	0.00	0.00
12/4/25	0.00	0.00	5.32	0.00	1.13	3.58	0.00	0.00
12/5/25	0.00	0.00	2.81	0.00	0.00	1.79	0.00	0.00
12/6/25	0.00	0.00	2.75	0.00	5.40	3.39	0.00	0.00
12/7/25	0.00	0.00	7.66	0.00	0.00	6.12	0.00	0.00
12/8/25	0.00	0.00	0.71	0.00	3.33	2.82	0.00	0.00
12/9/25	0.00	0.00	4.77	0.00	0.00	8.31	0.00	0.00
12/10/25	0.00	0.00	5.91	0.00	0.00	4.49	0.00	0.00
12/11/25	0.00	0.00	3.07	0.00	0.00	4.84	0.00	0.00
12/12/25	0.00	0.00	9.30	0.00	1.58	5.23	0.00	0.00
12/13/25	0.00	0.00	1.46	0.00	0.00	1.51	0.00	0.00
12/14/25	0.00	0.00	1.88	0.00	0.68	0.98	0.00	0.00
12/15/25	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12/16/25	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12/17/25	0.00	0.00	3.21	0.00	2.57	0.00	0.00	0.00
12/18/25	0.00	0.00	2.90	0.00	0.00	0.00	0.00	0.00
12/19/25	0.00	0.00	3.13	0.00	0.00	3.58	0.00	0.00
12/20/25	0.00	0.00	0.00	0.00	7.47	0.87	0.00	0.00
12/21/25	0.00	0.00	0.86	0.00	2.54	0.00	0.00	0.00
12/22/25	0.00	0.00	2.73	0.00	4.17	4.31	0.00	0.00
12/23/25	0.00	0.00	7.28	0.00	0.02	7.59	0.00	0.00
12/24/25	0.00	0.00	7.48	0.00	0.00	10.39	0.00	0.00
12/25/25	0.00	0.00	6.02	0.00	0.00	6.54	0.00	0.00
12/26/25	0.00	0.00	0.14	0.00	3.56	0.80	0.00	0.00
12/27/25	0.00	0.00	8.59	0.00	3.55	4.82	0.00	0.00
12/28/25	0.00	0.00	2.47	0.00	2.72	2.36	0.00	0.00
12/29/25	0.00	0.00	4.47	0.00	4.65	4.93	0.00	0.00
12/30/25	0.00	0.00	9.05	0.00	0.00	4.87	0.00	0.00
12/31/25	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>TOTAL</b>	<b>0.00</b>	<b>0.00</b>	<b>149.25</b>	<b>0.00</b>	<b>40.11</b>	<b>108.97</b>	<b>0.06</b>	<b>0.00</b>
<b>MIN</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>	<b>0.00</b>
<b>MAX</b>	<b>0.00</b>	<b>0.00</b>	<b>17.79</b>	<b>0.00</b>	<b>6.98</b>	<b>9.82</b>	<b>0.04</b>	<b>0.00</b>
<b>AVE</b>	<b>0.00</b>	<b>0.00</b>	<b>4.98</b>	<b>0.00</b>	<b>1.29</b>	<b>3.52</b>	<b>0.00</b>	<b>0.00</b>

## B. Static Water Levels

All City of Rialto wells are sounded each month, both active and inactive well sites. Depth-to-water is measured from the well head to the static water surface. Increases in depth-to-water represent a decrease in static water level.

<b>Well levels</b>														
<b>Wells Depth to Pump</b>	<b>Historical Maximum Depth to Water</b>	<b>Dec</b>	<b>Jan</b>	<b>Feb</b>	<b>Mar</b>	<b>Apr</b>	<b>May</b>	<b>Jun</b>	<b>Jul</b>	<b>Aug</b>	<b>Sept</b>	<b>Oct</b>	<b>Nov</b>	<b>Dec</b>
Chino # 1 (580 ft) <b>In-active well</b>	<b>429'</b>	410'	412'	414'	414'	413'	413'	413'	411'	410'	410'	410'	411'	411'
Chino # 2 (550 ft)	<b>369'</b>	342'	341'	335'	338'	335'	337'	334'	334'	333'	331'	333'	334'	334'
City # 1 (260 ft)	<b>392'</b>	121'	126'	121'	122'	119'	117'	119'	121'	120'	120'	122'	122'	117'
City # 2 (480 ft)	<b>402'</b>	147'	146'	128'	130'	128'	122'	129'	131'	125'	126'	126'	126'	128'
City # 3 (525 ft) <b>Out of Service</b>	<b>505'</b>	414'	414'	415'	416'	416'	414'	417'	418'	418'	417'	417''	417'	417'
City # 4A (528 ft)	<b>406'</b>	381'	374'	377'	375'	373'	362'	367'	370'	366'	360'	359'	363'	362'
City # 5 (385 ft) <b>In-active well</b>	<b>364'</b>	318'	318'	321'	318'	318'	316'	316'	316'	316'	317'	318'	319'	317'
Rialto # 1 (650 ft) <b>In-active well</b>	<b>588'</b>	561'	555'	571'	569'	565'	563'	564'	565'	562'	563'	566'	566'	565'
Rialto # 2 (550 ft) <b>In-active well</b>	<b>502'</b>	499'	501'	496'	495'	502'	496'	498'	498'	497'	496'	494'	496'	495'
Rialto # 3 (509 ft)	<b>478'</b>	472'	473'	473'	472'	472'	470'	470'	472'	471'	471'	474'	474'	474'
Rialto # 4 (450 ft) <b>In-active well</b>	<b>418'</b>	413'	414'	415'	416'	415'	415'	414'	413'	414'	413'	412'	412'	412'
Rialto # 5 (560 ft)	<b>387'</b>	385'	385'	384'	384'	386'	386'	387'	387'	387'	386'	386'	386'	386'
Rialto Well # 7 <b>In-active well</b>	<b>362'</b>	362'	360'	360'	359'	353'	356'	354'	356'	357'	357'	357'	359'	359'
Miro # 3 (563 ft)	<b>492'</b>	484'	484'	484'	484'	483'	483'	481'	480'	479'	480'	480'	478'	481'
EW-1 (780 ft)	<b>480'</b>	475'	474'	472'	475'	475'	474'	475'	460'	471'	467'	480'	477'	478'

## II. REGULATORY

All State of California and public health agency regulatory requirements were met.

### A. Regulatory Submittals

- Monthly Summary of Distribution System Coliform Monitoring
- NPDES Discharge Letter
- Conservation SAFER Report

Sample Test Result Standards			
Type of Sampling	Units of Measure	Detectable Limit for Reporting	Maximum Contaminant Level
Total Coliform	A	--	--
E. Coli	A	--	--
Nitrate as N	mg/L	0.20	10
Perchlorate (ClO <sub>4</sub> )	µg/L	1.0	6.0
Total Dissolved Solids	mg/L	--	500
P= Present A= Absent mg/L = parts per million µg/L = parts per billion			

Sample Date 12/03/2025	Sample Site Location Results									
	Chino 2	City 2	City 4A	Rialto 3	Rialto 5	Miro 3	EW-1	BLF Cactus	BLF 6-9	OPRT P
Total Coliform	A	A	A	A	A	A	OUT OF SERVICE	A	A	OUT OF SERVICE
E. Coli	A	A	A	A	A	A		A	A	
Nitrate as N	3.1									
Perchlorate (ClO <sub>4</sub> )	1.2*			5.9*	<1.0	7.8*				
Total Dissolved Solids	220	180	290	210	190	190		290	320	

\*Sample is from the well head so it is before disinfection & treatment. Treatment is performed before it goes into the distribution system. Water going into the distribution system is <1.0 (non-detect).

## B. Sample Site Location Results

<b>Rialto Distribution Sample Results</b>						
<b>December 2025</b>						
<b>Sample Location</b>	<b>Free Cl Res (Field)</b>	<b>Total Coliform</b>	<b>E. Coli</b>	<b>Apparent Color</b>	<b>Odor Threshold</b>	<b>Turbidity</b>
<b>CYCLE 1 - 12/02/25</b>	<b>mg/l</b>	<b>P/A</b>	<b>P/A</b>	<b>Color Units</b>	<b>TON</b>	<b>NTU</b>
335 W. Rialto	1.70	A	A			
1228 W. Merrill	1.50	A	A			
256 N. Fillmore	1.10	A	A			
987 W. Grove	1.10	A	A			
978 N. Driftwood	1.10	A	A			
1451 N. Linden	1.20	A	A			
469 W. Jackson	1.50	A	A			
935 E. Mariposa	1.10	A	A			
1000 N. Joyce	1.50	A	A			
766 N. Chestnut	1.20	A	A			
149 W. Victoria	1.00	A	A			
313 E. McKinley	1.10	A	A			
609 E. South	1.10	A	A			
273 E. Alru	1.40	A	A			
1161 S. Lilac	1.30	A	A			
101 E. Valley	1.50	A	A			
<b>CYCLE 2 - 12/09/25</b>	<b>mg/l</b>	<b>P/A</b>	<b>P/A</b>	<b>Color Units</b>	<b>TON</b>	<b>NTU</b>
210 N. Park	0.90	A	A	<3.0	1	<0.10
101 S. Larch	0.90	A	A	<3.0	1	<0.10
320 N. Wisteria	0.90	A	A	<3.0	1	<0.10
861 W. Grove	0.90	A	A	<3.0	1	<0.10
1168 N. Glenwood	0.90	A	A	<3.0	1	<0.10
1320 N. Fitzgerald	0.80	A	A	<3.0	1	<0.10
860 N. Willow	1.10	A	A	<3.0	1	<0.10
209 E. Cornell	1.30	A	A	<3.0	1	<0.10
643 E. Margarita	1.30	A	A	<3.0	1	<0.10
1170 N. Terrace Rd.	1.10	A	A	<3.0	1	<0.10
681 E. Erwin	1.00	A	A	<3.0	1	<0.10
402 E. Merrill	1.20	A	A	<3.0	1	<0.10
261 W. Wilson	1.10	A	A	<3.0	1	<0.10
532 S. Iris	1.20	A	A	<3.0	1	<0.10
281 W. Hawthorne	1.20	A	A	<3.0	1	<0.10
379 W. Valley	1.10	A	A	<3.0	1	<0.10

## Rialto Distribution Sample Results

October 2025

Sample Location	Free Cl Res (Field)	Total Coliform	E. Coli	Apparent Color	Odor Threshold	Turbidity
	mg/l	P/A	P/A	Color Units	TON	NTU
<b>CYCLE 3 – 12/17/25</b>						
236 N. Willow	1.20	A	A			
775 E. Foothill	1.10	A	A			
878 N. Primrose	1.30	A	A			
369 E. Van Koevering	1.30	A	A			
274 W. Valencia	1.20	A	A			
1566 N. Fillmore	1.60	A	A			
932 N. Idyllwild	1.10	A	A			
644 N. Smoketree	1.10	A	A			
605 W. Rosewood	1.30	A	A			
1189 W. Second	1.20	A	A			
775 W. Rialto	1.20	A	A			
211 E. Wilson	1.20	A	A			
595 E. Huff	1.40	A	A			
1005 S. Riverside	1.20	A	A			
794 S. Verde	1.00	A	A			
1055 W. Bloomington	1.20	A	A			
<b>CYCLE 4 - 12/23/25</b>						
375 S. Cactus	1.10	A	A			
101 S. Linden	1.00	A	A			
234 N. Larch	1.00	A	A			
575 N. Driftwood	0.90	A	A			
1355 W. Shamrock	0.90	A	A			
992 N. Yucca	1.30	A	A			
481 W. Cornell	1.20	A	A			
158. E. Shamrock	1.20	A	A			
749 E. Holly	1.30	A	A			
545 E. Victoria	1.30	A	A			
200 N. Sycamore	1.10	A	A			
407 E. Allen	1.10	A	A			
399 E. Montrose	1.20	A	A			
856 S. Orange	1.10	A	A			
911 S. Cactus	1.20	A	A			
220 W. Valley	1.20	A	A			
P/A + Present or Absent						

**C. Violations**

No violations were received during this reporting period.

**D. Source Water Total Dissolved Solids (TDS)**

Veolia has a goal of maintaining an acceptable blended TDS level between all its sources. This goal is achieved by shifting production to or from the lowest TDS wells or purchased low TDS water while adhering to the overall water supply strategy and meeting system demands. The TDS was 242 mg/L for the month of December as compared to 254 mg/L in November. The TDS levels are below the secondary maximum contaminant level requirements.

**III. HEALTH AND SAFETY**

**A. Monthly Safety Program Overview**

Category	Monthly Statistic
Safety Training Topics	LSR Q3 LSR Q4
Lost Time Incidents, count*	0
Recordable Incidents, count	0
Near Miss Incidents, count	3
Vehicle Incidents, count	0

\*A lost time incident has not occurred in the past 4370 days.

**IV. CHEMICAL USE**

Sodium hypochlorite is the only chemical added to the water system. A total of 2314 gallons of sodium hypochlorite was used in December as compared to 2491 gallons used in November.

## V. ELECTRICAL USE

Southern California Edison (SCE) data for December 2025. We will provide the data as it is received, thus will include yearly usage received to date.

SCE		kWh
Year	Month	Billed Usage
2024	October	529,208
2024	November	266,378
2024	December	247,546
2025	January	360,398
2025	February	294,421
2025	March	223,709
2025	April	428,976
2025	May	505,764
2024	June	575,467
2025	July	842,561
2025	August	669,021
2025	September	752,171
2025	October	654,454
2025	November	734,743
2025	December	647,384

## VI. WATER QUALITY COMPLAINTS

No complaints were received during this reporting period.

## VII. OPERATIONS UPDATE

The overall operational strategy is to meet the daily water demand. The City of Rialto water system has six operational wells, one of which is owned by the County of San Bernardino and operated by Veolia; Oliver P. Roemer Treatment Plant (OPRTP), which is jointly owned by the City (25%) and West Valley Water District (WVWD); purchased water through the Baseline Feeder (BLF) system from San Bernardino Valley Municipal Water District (SBVMWD); and, if required to meet demand, additional water can be supplied by the City of San Bernardino (CSB) through the BLF for emergency supply only with no guarantee of actual delivery. Water produced from City Well 4A discharges into

the BLF and its production is included in deliveries from that shared transmission line when City Well 4A is in service.

The overall pumping strategy is based on adjudicated rights, well availability, remediation requirements, and quality of source, cost to operate, and varying weather conditions. TDS effluent concentrations for the City of Rialto WWTP are taken into consideration when operating the facilities and water sources.

**A. Operational Wells**

EW-1 well was out of service due to pump issues. OPRTP meter was turned off in October.

**B. Valve Activity**

On the basis of information collected in 2019, Veolia now has a baseline assessment of all valves and has initiated a new cycle of valve exercising. Five valves were exercised in the month of December.

<b>Valve Turning Progress</b>	
	<b>Valves Turned</b>
2020	530
2021	340
2022	463
2023	750
2024	379
2025	338

**C. Hydrant Flushing**

There are 63 hydrant/dead ends that are flushed annually to maintain water quality. All annual flushing were completed in December.

<b>Hydrant/Dead End Flushing Progress</b>	
	<b>2025</b>
January	0
February	0
March	6
April	6
May	11
June	0

July	0
August	29
September	3
October	0
November	8
December	0
<b>Total</b>	<b>63</b>
<b>Progress % (100)</b>	

#### **D. Sanitary Survey**

DDW performed field site visits on May 22 and August 22, 2024. The results of the sanitary survey were received on September 19, 2024. All minor deficiencies have been corrected and submitted to DDW.

### **VIII. ASSET MANAGEMENT**

The following work orders were completed by Water production staff for the month of December:

- Preventive Maintenance –268
- Corrective Maintenance –0
- Predictive Maintenance –0

502– PMs planned for January 2026

#### **A. Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues**

The following work orders were completed by Water distribution staff for the month of December:

- Main line – 0
- Service line – 10
- Hydrants - 0
- Angle Meter Stop – 15
- Meter Box & Lid Replacement – 23

- Meter Leaks/ Replacements - 23

## B. Major Equipment and/or Machinery Outages

EW-1 well was out of service due to pump issues.

## IX. RAINFALL TOTALS

### Highland - Los Angeles Basin - Station 251

Month Year	Total ETo (in)	Total Precip (in)	Avg Sol Rad (Ly/day)	Avg Vap Pres (mBars)	Avg Max Air Temp (°F)	Avg Min Air Temp (°F)	Avg Air Temp (°F)	Avg Max Rel Hum (%)	Avg Min Rel Hum (%)	Avg Rel Hum (%)	Avg Dew Point (°F)	Avg Wind Speed (mph)	Avg Soil Temp (°F)
Jan 2025	2.81 K	1.87	261	5.4	66.4 K	38.9	52.5	65	26	42	27.1	4.0 K	49.8 K
Feb 2025	2.87	4.35	321	8.9 K	71.3 K	45.9 K	57.8 K	80	37	56 K	40.7 K	3.5	53.8
Mar 2025	3.66	3.01	389	9.7	67.2 K	45.8	55.7	87	43	65	43.5	4.0 K	56.8
Apr 2025	4.90	1.39	480 K	9.8	73.3	48.8	60.3	82	34	56	43.5	4.2 K	61.2 K
May 2025	6.07	3.76	558	13.1	80.1	55.7	66.9 K	85	39	61 K	51.7 K	4.3	66.6 L
Jun 2025	7.31	2.58	666	15.0	88.8	59.5 K	73.1	82	33	55	55.3	4.5 K	71.4
Jul 2025	8.05 K	1.96	676	15.1	92.1 K	60.9 K	75.6 K	80	27	50 L	55.5 L	4.5 K	73.6
Aug 2025	7.58	1.90 K	590	15.8	96.7	64.9	80.2	74	25	45	56.7	4.0 K	74.6
Sep 2025	5.31	2.32	452	16.7	89.6	64.1	75.6	79	35	56	58.2	3.8 K	73.7
Oct 2025	3.98 K	1.44	381	12.3	81.9 K	53.4	66.6 K	81	33	56 K	49.4 K	3.3 K	66.5
Nov 2025	2.39	3.31 K	260	10.6 K	75.7	49.6 K	61.2	82	37	59 K	45.7 K	2.8	60.3
Dec 2025	2.12 K	1.53 K	226 K	8.9 K	74.2 K	45.9 K	58.0 K	77 K	32 K	54 K	40.8 K	2.8 K	55.3 K
Tots/Avgs	57.05	29.4	438	11.8	79.8	52.8	65.3	80	33	55	47.3	3.8	63.6

**RIALTO WASTEWATER**  
**MONTHLY OPERATIONS REPORT**

**Reporting Period:**  
**December 2025**

Prepared for: - Rialto Water Services



Prepared by: - Veolia Water West Operating Services



# RIALTO WASTEWATER OPERATIONS AND MAINTENANCE REPORT

## Contents

### EXECUTIVE SUMMARY

- 1. Collection System / Customer Service Log**
  - a. Collection System Activities
  - b. S.S.O. dates
  - c. Customer Service Call Outs
- 2. Wastewater Treatment Plant - Monthly Overview**
  - a. Significant events during the month
- 3. Treatment Facility Performance / Laboratory Activities**
  - a. See attached Monthly Performance Summary
  - B. Summary of Notices and Laboratory Tests / Reports filed with government agencies
  - c. Effluent Specifications Exceedance Discussion
- 4. Monthly Safety Program Overview**
- 5. Biosolids, Chemicals, and Utilities**
  - a. Monthly Biosolids Production
  - b. Monthly Chemical Consumption
  - c. Monthly Utilities Consumption
- 6. Odor Complaints / Actions Taken**
- 7. Major Equipment and/or Machinery Outages**
- 8. Outside Agency Activities during the Month**
  - a. Government agency or property insurance inspections
  - b. Government agency environmental, health, or safety tests/monitoring
  - c. Government agency notice of violation received
  - d. Government agency monitoring
  - e. Other matters of concern
- 9. Complaint Logs**

### TABLES

- Treatment Facility – Monthly Performance Summary
- Collection System- Monthly Pipe Cleaned

# RIALTO WASTEWATER

## MONTHLY OPERATIONS REPORT

### EXECUTIVE SUMMARY

Highlights of this month's Wastewater O&M report include the following:

- The treatment plant performed well and met all compliance parameters.
- There were three residential call-outs for sewer-related issues.

### 1. Collection System/Customer Service Log

a. Collections group activities this month:

Category	Current Month Statistics	Prior Month Statistics	2025 Year to Date Statistics
Sanitary sewers are cleaned using the conventional method, including feet, which includes "Hot spot cleaning."	22,274	22,805	257,555
Sanitary sewers assessed using the SL-RAT method, feet	0	0	21,112
CCTV Inspection, miles (26 is the annual goal)*	2.11	2.09	27.91
Manhole Inspections	1	0	40
USA Dig Alert Markings, count	24	23	374
Residential call-outs	3	1	25
Sanitary Sewer Overflows	0	0	2

- b. S.S.O. N/A
- c. Customer Service Call Outs – See Item 9 for details.

### 2. Wastewater Treatment Plant – Monthly Overview

- NPDES discharge compliance parameters were achieved.

a. Significant events during the month were:

*None*

### 3. Treatment Facility Performance/Laboratory Activities

- a. See the attached Table 1, Monthly Performance Summary.
- b. Summary of Notices and Laboratory Tests/Reports filed with government agencies.  
The monthly submittal of State/Federal discharge monitoring reports was completed promptly.
- c. Effluent specification exceedance discussion  
See Section 2 above. N/A

#### 4. Monthly Safety Program Overview

Category	Monthly Statistic
Safety Training Topics	0
Lost Time Incidents count*	0
Recordable Incidents, count	0
Near Miss Incidents, count	0
Vehicle Incidents, count	0

\*A lost time incident has not occurred since 9-3-2020, totaling 1,944 days.

#### 5. Biosolids, Chemicals, and Utilities

##### a. Monthly Biosolids Production

Biosolids	Current Month Statistics	Prior Month Statistics	2025 Year-to-Date Statistics
Wet Tons Produced	1,620.2	1,074.56	14,096.76

10,245.84

##### b. Monthly Chemical Consumption

Chemical	Current Month Gallons Used	Prior Month Gallons Used
Sodium Hypochlorite, Tertiary Disinfection	30,904	28,886
Sodium Bisulfite, Discharge Dechlorination	11,054	10,031
Ferrous Chloride, Digester Gas Conditioning	4,070	4,180
Polymer, Gravity Belt Thickener	496	454
Polymer, Belt Filter Press	834	722
Alum, Tertiary Filters	1	1

##### c. Monthly Utilities Consumption

Utility		Prior Month Statistics
Electricity WWTP, KWH	460,600	377,336
Electricity Lilac LS, KWH	716	895
Electricity Sycamore LS, KWH	515	539
Electricity Ayala LS, KWH	8,376	8,561
Electricity Agua Mansa LS, KWH	2,547	2,867
Electricity Cactus LS, KWH	1,636	1,593
Electricity Ramrod LS, KWH	673	680
Frisbee Park LS, KWH	780	680
El Rancho Verde LS, KWH	2,188	2,085
Natural Gas WWTP, Therms	7,243	4,569

\* LS is in bypass mode, pending CIP completion

\*\* SCE has not updated this account.

#### 6. Odor Complaints Received/Actions Taken

None

#### 7. Major Equipment and/or Machinery Outages

- Sludge Holding Tank
- Aeration Basin #3 is currently offline.

**8. Outside Agency Activities during the Month**

- a. Government agency or property insurance inspections  
*None*
- b. Government agency environmental, health, or safety tests/monitoring  
Permit testing was completed for this month
- c. Government agency notices of violation received  
*None*
- d. Government agency monitoring  
Routine monitoring reports were submitted.
- e. Other matters of concern  
*None*

**9. Customer Service Callout Details Log**

Date	Address	Comments	Personnel	Manhole	To Manhole
12/11/2025	993 N Primrose	Resident called to report gurgling coming from their toilet. A collections member called the resident to inform them this was from sewer line cleaning.	BVO		
12/11/2025	168 E Baseline	The collections team responded to reports of SSO occurring behind Stater Bros. They spoke with a manager at the store and informed them that the grease interceptor line needed to be cleaned. This required a plumber. Containment was set up until the line was cleared.	ET		
12/22/2025	2562 W Vine	A resident called regarding a sewage backup at the property: the main sewer line was checked and was clear. The resident was instructed to have the plumber clean the lateral to the main line, which is longer than 75 feet.	PH		

## **Table 1 Summary**

# Table 1 Summary

December 2025

Date	Rialto	Rialto	Rialto	Rialto	Rialto	Rialto WRF Effluent			Rialto WRF Influent		Rialto WRF Effluent		
	Flow	Effluent Flow	BOD	BOD	Influent BOD Load	Effluent BOD	Effluent BOD Load	BOD % Removal	Influent TSS	Influent TSS Load	Effluent TSS	Effluent TSS Load	TSS % Removal
	MGD	MGD	mg/l	mg/l	lbs/day	mg/L	lbs/day	%	mg/L	lb s/day	mg/L	lb s/day	%
12/1/2025	6.57	7.45	380	380	20,822	3.4	211.25	99.10	240.00	13151.00	2.00	124.00	99.20
12/2/2025	6.63	7.13											
12/3/2025	6.93	7.64											
12/4/2025	6.59	6.98											
12/5/2025	7.10	6.76	320	320	18,948	<10.0	563.78	96.90					
12/6/2025	6.77	7.73											
12/7/2025	5.94	7.11											
12/8/2025	6.91	7.48											
12/9/2025	6.62	6.94	320	320	17,667	3.6	208.37	98.90	240.00	13251.00	1.00	58.00	99.60
12/10/2025	6.59	6.92											
12/11/2025	7.52	7.92											
12/12/2025	6.23	7.27	320	320	16,627	<5.0	303.16	98.40					
12/13/2025	7.01	6.63											
12/14/2025	5.97	6.94											
12/15/2025	6.80	7.50	420	420	23,819	3.7	231.44	99.10	220.00	12477.00	0.60	38.00	99.70
12/16/2025	6.85	7.13											
12/17/2025	7.55	6.87											
12/18/2025	5.77	7.05											
12/19/2025	6.56	6.84	360	360	19,696	2.7	154.02	99.30					
12/20/2025	6.72	6.88											
12/21/2025	6.46	7.38											
12/22/2025	6.70	7.08	440	440	24,586	2.8	165.33	99.40	280.00	15646.00	1.00	59.00	99.60
12/23/2025	6.92	6.99											
12/24/2025	7.25	7.27											
12/25/2025	8.95	7.78											
12/26/2025	6.18	7.98	360	360	18,555	2.5	166.38	99.30					
12/27/2025	6.99	7.26											
12/28/2025	6.76	7.54											
12/29/2025	6.82	6.86	320	320	18,201	2.6	148.75	99.20	270.00	15357.00	1.00	57.00	99.60
12/30/2025	6.84	7.35											
12/31/2025	6.83	7.09											
Minimum	5.77	6.63	320	320	16,627	2.5	148.75	96.90	220.00	12477.00	0.60	38.00	99.20
Maximum	8.95	7.98	440	440	24,586	<10.0	563.78	99.40	280.00	15646.00	2.00	124.00	99.70
Total	210.33	223.75	3,240	3,240	178,921	<36.3	2152.49	889.50	1250.00	69881.00	5.60	336.00	497.70
Average	6.79	7.22	360	360	19,880	<4.0	239.16	98.80	250.00	13976.00	1.12	67.00	99.50

## Table 2 Summary

## Table 2 Summary

December 2025

Date	Rialto	Rialto WRF Effluent		Rialto WRF Eff		Rialto WRF Effluent		Rialto	Rialto
	Influent Conductivity (uS/cm)	Eff Conductivity Daily Ave (uS/cm)	Influent COD mg/l	Final Effluent COD mg/l	Influent TDS mg/l	Filter Effluent TDS mg/l	EFF FINAL TDS mg/L	Influent Inorganic Nitrogen mg/L	Effluent Inorganic Nitrogen mg/l as N
12/1/2025	1460.00	947.00							
12/2/2025	1482.00	934.00	720	19.0	510.00	460.00	500.00	41.00	6.20
12/3/2025	1653.00	934.00							
12/4/2025	1356.00	926.00							
12/5/2025	1524.00	927.00							
12/6/2025	1403.00	960.00							
12/7/2025	1336.00	970.00							
12/8/2025	1549.00	943.00							
12/9/2025	1621.00	940.00							
12/10/2025	1458.00	951.00							
12/11/2025	1522.00	948.00							
12/12/2025	1623.00	941.00							
12/13/2025	1430.00	955.00							
12/14/2025	1204.00	965.00							
12/15/2025	1491.00	958.00							
12/16/2025	1549.00	958.00							
12/17/2025	1519.00	931.00							
12/18/2025	1474.00	902.00							
12/19/2025	1600.00	902.00							
12/20/2025	1388.00	928.00							
12/21/2025	1373.00	955.00							
12/22/2025	1578.00	949.00							
12/23/2025	1493.00	944.00							
12/24/2025	1373.00	943.00							
12/25/2025	1457.00	849.00							
12/26/2025	1391.00	846.00							
12/27/2025	1443.00	865.00							
12/28/2025	1322.00	887.00							
12/29/2025	1533.00	908.00							
12/30/2025	1636.00	904.00							
12/31/2025	1441.00	919.00							
Minimum	1204.00	846.00	720	19.0	510.00	460.00	500.00	41.00	6.20
Maximum	1653.00	970.00	720	19.0	510.00	460.00	500.00	41.00	6.20
Average	1474.00	929.00	720	19.0	510.00	460.00	500.00	41.00	6.20

## **Table 3 Summary**

\*(Cyanide not available at time of report)

### Table 3 Summary

December 2025

Date	Rialto WRF Influent		Rialto WRF Effluent		Rialto WRF Eff		Rialto WRF Effluent		Tranfer	Tranfer	Rialto	Tranfer Data
	Influent pH	24 hr avg. effl. pH	Effluent Temp	Effluent Ammonia	Effluent Total Coliform	Effluent Coliform 7 Day Median	Effluent Cyanide, Free Available	Eff D(2-ethylhexyl) phthalate (DEHP)	FIT-8321 ADG #2 Flow	FIT-8321 ADG #2 Flow	Natural Gas Daily Use	FIT-8321 ADG #2 Flow
	SU	SU	Deg C	mg/L	MPN/100ML	MPN/100ML	ug/L	ug/l	cu ft/day	cu ft/day	cf/day	cu ft/day
12/1/2025	23.90	7.30	24.30	0.08	<1.8	<1.80			172394.00	172394.00	21900.00	172394.00
12/2/2025	6.82	7.30	23.70		<1.8	<1.80		<5.00	149777.00	149777.00	23200.00	149777.00
12/3/2025	7.02	7.29	24.00		<1.8	<1.80			153091.00	153091.00	23000.00	153091.00
12/4/2025	6.96	7.26	23.60		<1.8	<1.80			154011.00	154011.00	22200.00	154011.00
12/5/2025	6.85	7.27	23.20		<1.8	<1.80			171541.00	171541.00	36400.00	171541.00
12/6/2025	7.02	7.21	23.50		<1.8	<1.80			163193.00	163193.00	42700.00	163193.00
12/7/2025	7.25	7.20	23.90		1.8	<1.80			169752.00	169752.00	36900.00	169752.00
12/8/2025	6.97	7.26	23.90		<1.8	<1.80			178276.00	178276.00	25200.00	178276.00
12/9/2025	7.09	7.31	23.80	0.09	<1.8	<1.80			167439.00	167439.00	20000.00	167439.00
12/10/2025	6.93	7.28	23.70		<1.8	<1.80			167274.00	167274.00	15700.00	167274.00
12/11/2025	7.39	7.31	23.90		<1.8	<1.80			183262.00	183262.00	18400.00	183262.00
12/12/2025	7.13	7.28	23.90		<1.8	<1.80			167853.00	167853.00	27000.00	167853.00
12/13/2025	7.22	7.26	23.90		<1.8	<1.80			179412.00	179412.00	21000.00	179412.00
12/14/2025	7.53	7.21	24.40		<1.8	<1.80			170081.00	170081.00	21900.00	170081.00
12/15/2025	7.08	7.26	23.90	0.09	4.5	<1.80			158436.00	158436.00	22700.00	158436.00
12/16/2025	6.82	7.31	23.70		<1.8	<1.80			139831.00	139831.00	24200.00	139831.00
12/17/2025	6.93	7.27	23.90		<1.8	<1.80			182108.00	182108.00	20900.00	182108.00
12/18/2025	7.20	7.26	23.90		2.0	<1.80			182613.00	182613.00	22800.00	182613.00
12/19/2025	6.90	7.14	23.80		<1.8	<1.80			180945.00	180945.00	24300.00	180945.00
12/20/2025	6.96	7.22	23.60		<1.8	<1.80			171648.00	171648.00	18300.00	171648.00
12/21/2025	7.36	7.08	23.80		<1.8	<1.80			152908.00	152908.00	20000.00	152908.00
12/22/2025	7.47	7.11	23.70	0.10	2.0	<1.80			171765.00	171765.00	19700.00	171765.00
12/23/2025	7.35	7.07	23.80		<1.8	<1.80			175059.00	175059.00	20800.00	175059.00
12/24/2025	7.32	6.98	24.10		<1.8	<1.80			164857.00	164857.00	19000.00	164857.00
12/25/2025	7.34	6.99	23.70		<1.8	<1.80			164095.00	164095.00	20100.00	164095.00
12/26/2025	7.74	6.97	23.40		<1.8	<1.80			172530.00	172530.00	19000.00	172530.00
12/27/2025	7.89	7.11	23.10		<1.8	<1.80			157378.00	157378.00	39500.00	157378.00
12/28/2025	7.81	6.90	22.90		<1.8	<1.80			178641.00	178641.00	40600.00	178641.00
12/29/2025	7.64	7.16	21.80	0.10	<1.8	<1.80			168972.00	168972.00	16800.00	168972.00
12/30/2025	7.76	7.25	21.60		<1.8	<1.80			170726.00	170726.00	20100.00	170726.00
12/31/2025	8.22	7.22	22.10		<1.8	<1.80			175606.00	175606.00	19300.00	175606.00
Minimum	6.82	6.90	21.60	0.08	<1.8	<1.80		<5.00	139831.00	139831.00	15700.00	139831.00
Maximum	23.90	7.31	24.40	0.10	4.5	<1.80		<5.00	183262.00	183262.00	42700.00	183262.00
Average	7.80	7.19	23.60	0.09	<1.9	<1.80		<5.00	168241.00	168241.00	23987.00	168241.00

## **Monthly Sewer Line Cleaned**

# Pipe Cleaning - December 2025

Map Centre Coords  
x: 2067771, y: 967413  
Date Printed: 12/02/2024  
Scale: 1:95000

0.5 miles

