

City of Rialto

*Council Chambers
150 S. Palm Ave.
Rialto, CA 92376*



Regular Meeting - Final

Tuesday, April 15, 2025

REGULAR MEETING - 6:00 P.M.

Rialto City Hall, Council Chambers, 150 S. Palm Ave. Rialto CA 92376

Utilities Commission

*Chairperson Barbara Rickman
Commissioner Kevin C. Kobbe
Commissioner James M. Shields*

In compliance with the Americans with Disabilities Act, if you need special assistance to participate in this meeting, please contact the Public Works Department at (909) 820-2602. Notification 48-hours prior to the meeting will enable the City to make reasonable arrangements to ensure accessibility to this meeting [28 CFR 35.102-35.104 ADA Title II].

Members of the public are given an opportunity to speak on any listed agenda items. Please notify the Utilities Division if you wish to do so. All agendas are posted in the City Hall Administration Building (150 South Palm Avenue, Rialto, CA 92376) at least 72-hours in advance of the meeting. Copies of the staff reports relating to each item on the agenda are on file in the Utilities Division. Please call (909) 421-4907 to inquire about any items described on the agenda.

Based upon the open meeting laws (the Brown Act), additional items may be added to the agenda and acted upon by the Utilities Commission only if it is considered to be a "subsequent need" or "emergency item" and is added by a two-thirds vote. Matters raised under Oral Communications may not be acted upon at that meeting other than as provided above.

CALL TO ORDER

ROLL CALL

Chairperson Barbara Rickman, Commissioner Kevin C. Kobbe, Commissioner James M. Shields

PLEDGE OF ALLEGIANCE

MOMENT OF SILENCE/INVOCATION

APPROVAL OF MINUTES

[UC-25-0278](#) Regular Meeting of March 18, 2025

Attachments: [Minutes 3-18-25](#)

ORAL COMMUNICATIONS

NEW BUSINESS

[UC-25-0287](#) Monthly Activity Report for City of Rialto Waste Management Services

[UC-25-0279](#) Veolia's Monthly Operations Report - April 2025 (Reporting period February 2025).

Attachments: [Veolia Monthly Operation Report Reporting Period February 2025 APRIL REPORT](#)

OLD BUSINESS

[UC-25-0281](#) Previous Discussion Update

[UC-25-0280](#) To-Do List

UTILITIES DIRECTOR UPDATES

[UC-25-0282](#)

Utilities Director Update:

- 1) Final Construction Work Authorization (FCWA) for Well City3A
- 2) RFP for Rate Consultant

COMMISSIONER REPORTS

ADJOURNMENT



City of Rialto

Legislation Text

File #: UC-25-0278, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting April 15, 2025

TO: Honorable Chairperson and Commission

APPROVAL: John Rossi, Interim Utilities Director

FROM: Nicole Hemmans, Senior Administrative Analyst

Regular Meeting of March 18, 2025



CITY OF RIALTO
REGULAR MEETING OF THE UTILITIES COMMISSION
February 18, 2025 - 6:00 P.M.
MINUTES

The Regular meeting of the Utilities Commission of the City of Rialto was held in the Civic Center Council Chambers located at 150 S. Palm Avenue, Rialto, California 92376, on Tuesday, March 18, 2025.

o0o

This meeting was in accordance with the provision of the **Government Code §54956** of the State of California.

o0o

CALL TO ORDER

Chair Barbara Rickman called the meeting to order at 6:00 p.m.

o0o

ROLL CALL

The roll call was taken by Nicole Hemmans, Senior Administrative Analyst.

Present:

Chair Barbara Rickman
Commissioner James M. Shields
Commissioner Kevin C. Kobbe

Absent:

None.

City staff present:

John Rossi, Interim Utilities Director
Amy Crow, Administrative Analyst
Nicole Hemmans, Senior Administrative Analyst
Lona Laymon, Deputy City Attorney

Also present:

Nancy Jackson, Customer Service Manager – RWS/Veolia
Andrew Coleman, Field Operations Supervisor – RWS/Veolia
Jason Howard, CIP Project Engineer – RWS/Veolia
Frank Garza, Wastewater Chief Plant Operator – RWS/Veolia

o0o

PLEDGE OF ALLEGIANCE

Chair Barbara Rickman led the pledge of allegiance.

o0o

**MOMENT OF SILENCE/
INVOCATION**

Nicole Hemmans led the invocation.

o0o

APPROVAL OF MINUTES

Regular Meeting of March 18, 2025.

Chair Rickman asked if there were any comments pertaining to the minutes.

- ◆ None.

Action

- ◆ Commissioner Kobbe made a motion to approve.
- ◆ Commissioner Shields seconded.
- ◆ All in favor.
- ◆ Motion passed.

o0o

ORAL COMMUNICATIONS

Chair Rickman asked if there was oral communication from the audience of items not on the agenda.

- ◆ None.

o0o

NEW BUSINESS ITEMS

UC-25-0203

Monthly activity report for City of Rialto Waste Management Services. (RECEIVE AND FILE)

Amy Crow went over the Monthly Waste Management Report for the month of March 2025. (February Reporting Period).

Questions & Comments

- ◆ None

o0o

UC-25-0199

Update of Federal and State Grants

Utilities Director, John Rossi, provided an update on the Federal and State Grants for the Rialto Utilities Authority.

Questions & Comments

- ◆ None

o0o

UC-25-0198

Veolia's Operations and

Receive and file the Monthly Operations Report from Veolia for the month of February 2025 (December 2024 Reporting Period).

Customer Service update provided by Nancy Jackson:

Questions & Comments

- ◆ Chair Rickman asked what caused the consumption to increase by 25.7% between what was reported in January 2024 compared to the January 2025 reporting?
 - Nancy Jackson advised that she will return with an update at the next Utilities Commission meeting.

Water update provided by Andrew Coleman:

Questions & Comments

- ◆ None

Wastewater update provided by Kenneth Aplon:

Questions & Comments

- ◆ None

CIP update provided by Jason Howard:

Questions & Comments

- ◆ Commissioners asked what is the difference between wet barrel and dry barrel hydrants?
 - Andrew Colmen advised that the difference between wet barrel hydrants and dry barrel hydrants lies in their water storage. Wet barrel hydrants always have water in the barrel, while dry barrel hydrants turn off underground, preventing freezing in cold climates.
- ◆ In relation to the Safe Routes to School project, explain the need for concrete pads around the hydrants.
 - Andrew Coleman advised that the concrete pads are installed to prevent property damage and conserve water.

o0o

OLD BUSINESS

UC-25-0200

Previous Discussion

There were no items for discussion.

o0o

UC-25-0201

To-Do List

No agenda items were posted for future discussion.

o0o

**UTILITIES DIRECTOR
UPDATES**

UC-25-0202

Utilities Director Update

Interim Utilities Director John Rossi provided an update to the commissioners on the following items:

- 1) Update on Fire Preparedness
- 2) Retirement of RWS's Rolf Ohlemutz
- 3) Update on City's Commission Appointment Process
- 4) Update on AMI Project
- 5) Update on Nature Center CEQA Process

Questions & Comments:

- ◆ Chair Rickman asked if the Utility User Tax (UUT) that the City Council waived for one year will include the UUT on gas, electricity, and cable or if it is just for water and sewer utilities.
 - John Rossi advised he will confirm this information and provide an update at the next Utilities Commission meeting.

o0o

COMMISSIONER REPORTS

There were no Commissioner Reports.

o0o

ADJOURNMENT

Action

- ◆ Commissioner Kobbe made a motion to adjourn.
- ◆ Commissioner Shields seconded.
- ◆ All in favor.

- ◆ Motion carried.
- ◆ Meeting adjourned at 6:38 p.m.



City of Rialto

Legislation Text

File #: UC-25-0287, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting [April 15, 2025]

TO: Honorable Utilities Commission Members

APPROVAL: John Rossi, Interim Utilities Director

FROM: Amy Crow, Administrative Analyst

Monthly Activity Report for City of Rialto Waste Management Services

BACKGROUND:

The City of Rialto Municipal Code Chapter 2.24 establishes and defines the Rialto Utilities Commission. The responsibilities assigned to the Commission include acting “as an advisor to the City Council and City Administration regarding solid waste policies, recycling, source reduction, and other related state mandates.” This report provides general information to the Commission on the activities and events for the Public Works Department’s Waste Management Division.

ANALYSIS/DISCUSSION:

Items relating to the City’s Solid Waste Management services and of interest to the Commission are as follows:

- **Hazardous Household Waste** - During the month of March:
 - 124 residents served,
 - 165 gallons of used motor oil,
 - 2 pallets of paint,
 - 9 drums of miscellaneous poisons and other toxic liquids,
 - 4 barrels of sharps, including needles, lancets, and syringes used by residents for their home healthcare and medical needs

During the month of April, the Household Hazardous Waste site was open on 11th and 12th and will be open on April 25th and 26th from 8 am until 12 noon.

- **Burrtec Waste Tonnage Report** - Available tonnage reports will be distributed at the meeting.

RECOMMENDATION:

Staff recommends the Utilities Commission receive this report for the month of April, 2025.



City of Rialto

Legislation Text

File #: UC-25-0279, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting April 15, 2025

TO: Honorable Chairperson and Commission

APPROVAL: John Rossi, Interim Utilities Director

FROM: Nicole Hemmans, Senior Administrative Analyst

Veolia's Monthly Operations Report - April 2025 (Reporting period February 2025).

RECOMMENDATION

Staff recommends that the Utilities Commission receive and file this report for April 2025.

Utility Commission Report APRIL 2025

Reporting period February 2025



**RIALTO
CUSTOMER SERVICE & REVENUE
MONTHLY OPERATIONS REPORT**

**Reporting Period:
February 2025**

Prepared for: Rialto Water Services

Prepared by: Veolia Water West Operating Services



Table of Contents

| | |
|--|-----------|
| I. CUSTOMER SERVICE SUMMARY..... | 3 |
| II. CALL CENTER PERFORMANCE..... | 3 |
| III. AUTOMATED SERVICES..... | 3 |
| IV. CONSUMPTION & BILLING..... | 4 |
| A. Consumption..... | 4 |
| B. Billing..... | 5 |
| V. REVENUE & AGING..... | 5 |
| A. Revenue | 5 |
| B. Aging | 6 |
| C. Bad Debt..... | 7 |
| VI. SERVICE ORDERS | 7 |
| VII. OTHER ACTIVITIES | 7 |
| VIII. REVENUE REPORT | 7 |
| A. Revenue Summary..... | 7 |
| B. Non Rate Revenue - Extraterritorial Customers..... | 7 |
| C. Non-Rate Revenue – Other | 8 |
| D. Development Impact Fees..... | 8 |
| E. Rialto Basin Water Rights and Leasing | 8 |
| F. Cash Collections by Payment Method – Rialto Water Services..... | 9 |
| G. Payment Collection Method – Fiscal Year to Date..... | 10 |
| H. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison..... | 10 |
| I. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison | 10 |
| J. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date..... | 11 |
| K. Increase in Cash Collections and Fund Distribution—Prior Year Comparison | 11 |
| L. Non-Rate and Extraterritorial Customer Accounts Receivable Aging | 12 |

I. CUSTOMER SERVICE SUMMARY


During this reporting month, the Customer Service team provided call service level of 88.8%. Out of 1,308 inbound calls answered 1,153 were answered within the first 30 seconds.

Water consumption has increased by 9.6% when compared against previous month. When compared against last year, consumption has increased by 57.3%. This increase is attributed to number of days between the billing. Another month or two needs to be observed to determine the actual trend.

Sewer revenue has increased by 8.5% compared to the prior month and increased by 12.5% from last year.

II. CALL CENTER PERFORMANCE

During this reporting month, service level was 88.8% with 1,153 out of 1,308 being answered within the first 30 seconds. Overall average wait time was twenty-six (26) seconds.

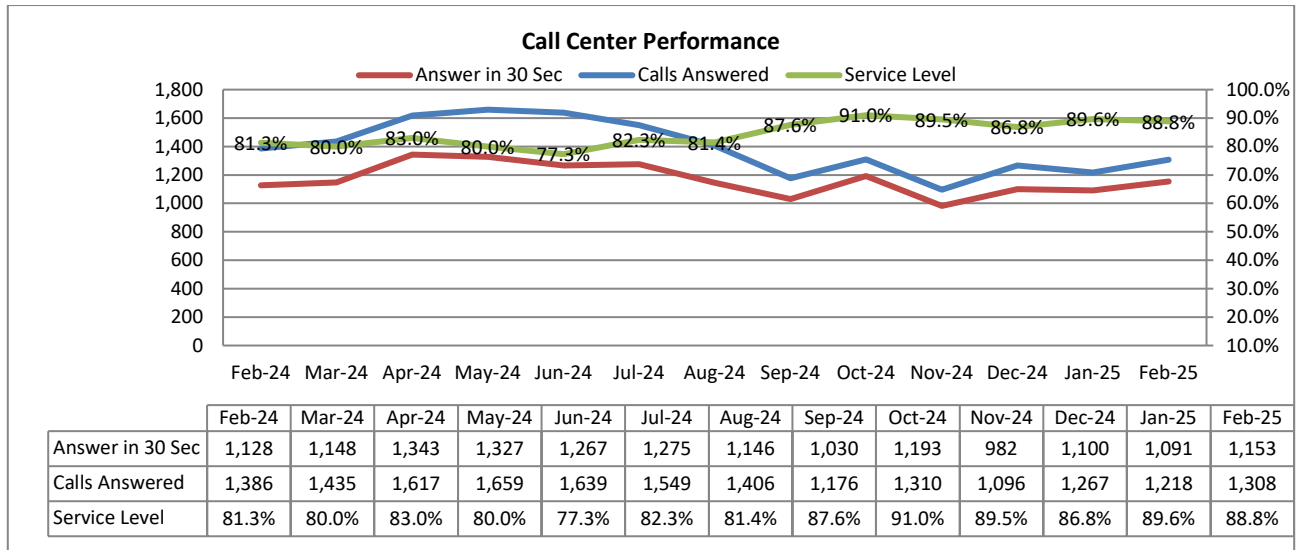

III. AUTOMATED SERVICES



About 12,377 or 54.7% of the rate payers have created log-ins to access their accounts online. Of these customers, with online access, 48.8% have chosen the e-bill option. This e-bill participation is 8.9% increase from February of the prior year.

| | Feb-24 | Mar-24 | Apr-24 | May-24 | Jun-24 | Jul-24 | Aug-24 | Sep-24 | Oct-24 | Nov-24 | Dec-24 | Jan-25 | Feb-25 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Number of Bills | 22,246 | 22,202 | 22,369 | 22,331 | 22,372 | 22,410 | 22,425 | 22,470 | 22,541 | 22,571 | 22,575 | 22,587 | 22,604 |
| Number of Bill Adjustments (during billing) | 18 | 10 | 12 | 16 | 10 | 11 | 9 | 5 | 11 | 9 | 29 | 17 | 10 |
| Automated Over the Phone Payments | 2,539 | 2,539 | 2,592 | 2,382 | 2,058 | 2,250 | 2,310 | 2,050 | 2,483 | 2,092 | 2,436 | 2,509 | 2,040 |
| Online Payment | 8,553 | 7,756 | 9,888 | 9,126 | 7,457 | 9,828 | 9,302 | 7,538 | 9,302 | 7,804 | 10,320 | 9,747 | 7,676 |
| E-bill Participants | 5,534 | 5,564 | 5,610 | 5,654 | 5,683 | 5,731 | 5,770 | 5,814 | 5,855 | 5,922 | 5,959 | 5,997 | 6,031 |
| Auto Pay Participants (New Portal) | 4,007 | 4,054 | 4,082 | 4,129 | 4,165 | 4,221 | 4,273 | 4,278 | 4,305 | 4,343 | 4,367 | 4,420 | 4,467 |
| PayNearMe | 100 | 115 | 118 | 111 | 88 | 114 | 118 | 92 | 95 | 93 | 95 | 108 | 73 |

IV. CONSUMPTION & BILLING

A. Consumption

Water consumption has increased by 9.6% when compared against previous month. When compared against last year, consumption has increased by 57.3%. This increase is attributed to number of days between the billing. Another month or two needs to be observed to determine the actual trend.

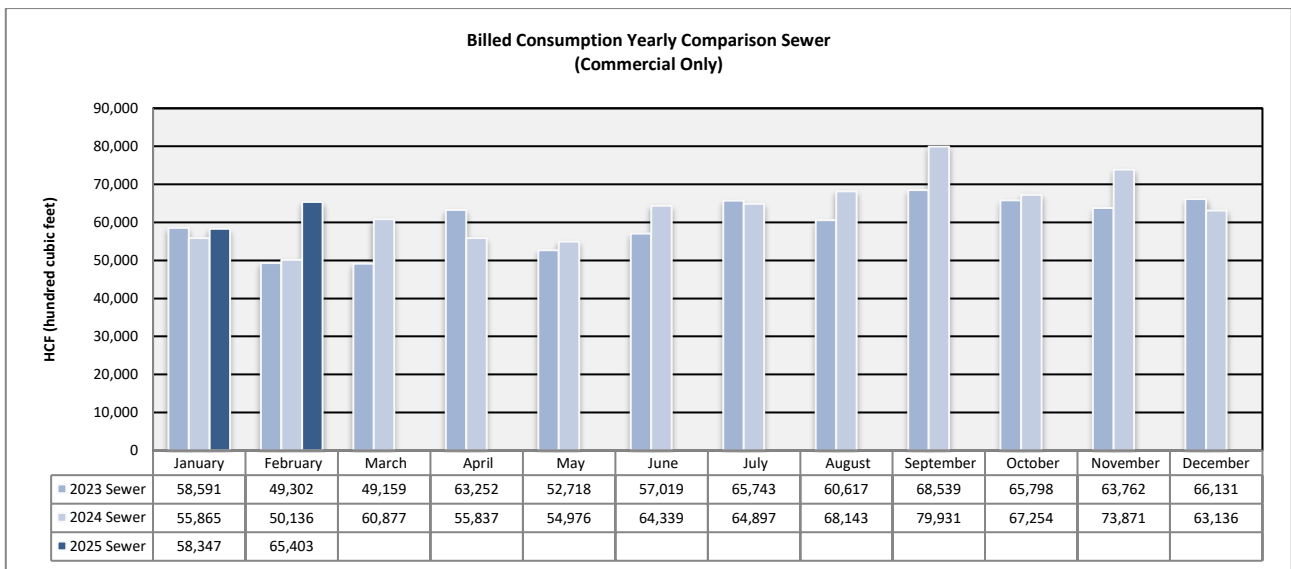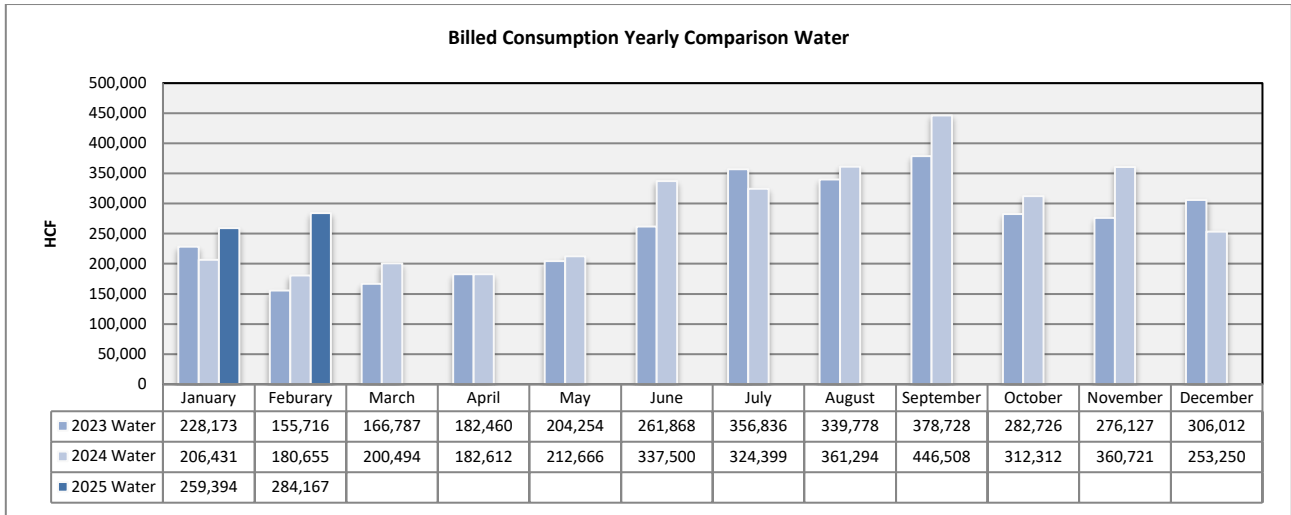



B. Billing

A total of 22,604 bills were mailed or sent out electronically in February. Billing accuracy was 99.96% with ten (10) requiring adjustments after bill generation.

V. REVENUE & AGING



A. Revenue

Water revenue has increased 17.9% when compared against the prior month and increased 46.6% when compared against previous year. Sewer revenue has increased by 8.5% compared to the prior month and increased by 12.5% from last year. These increases are attributed to higher water consumption and changes to the rate schedule.

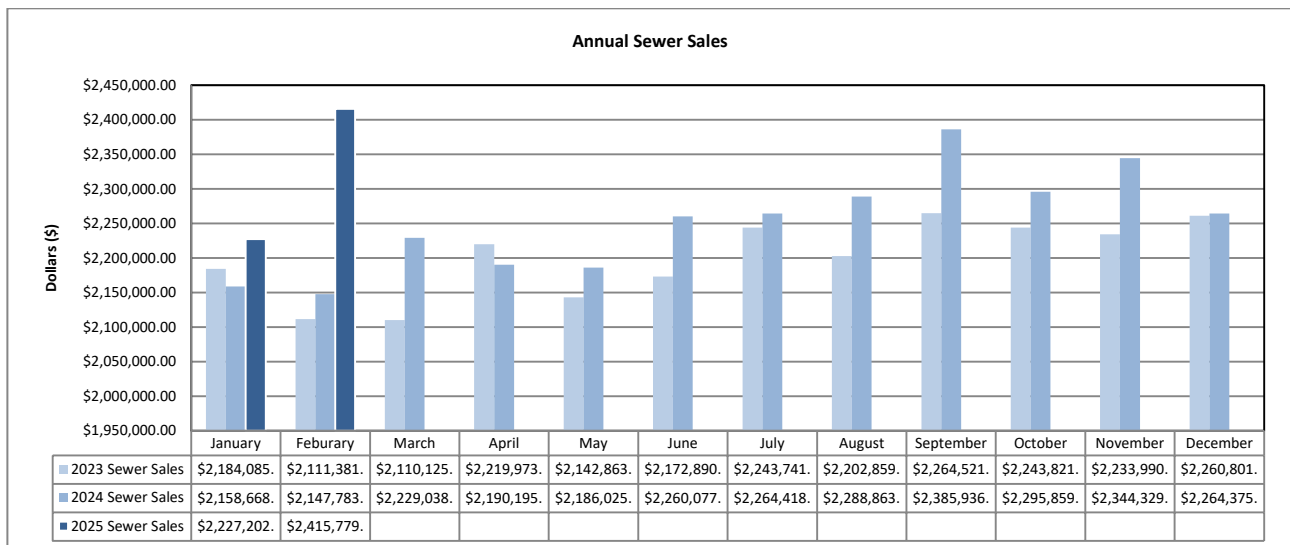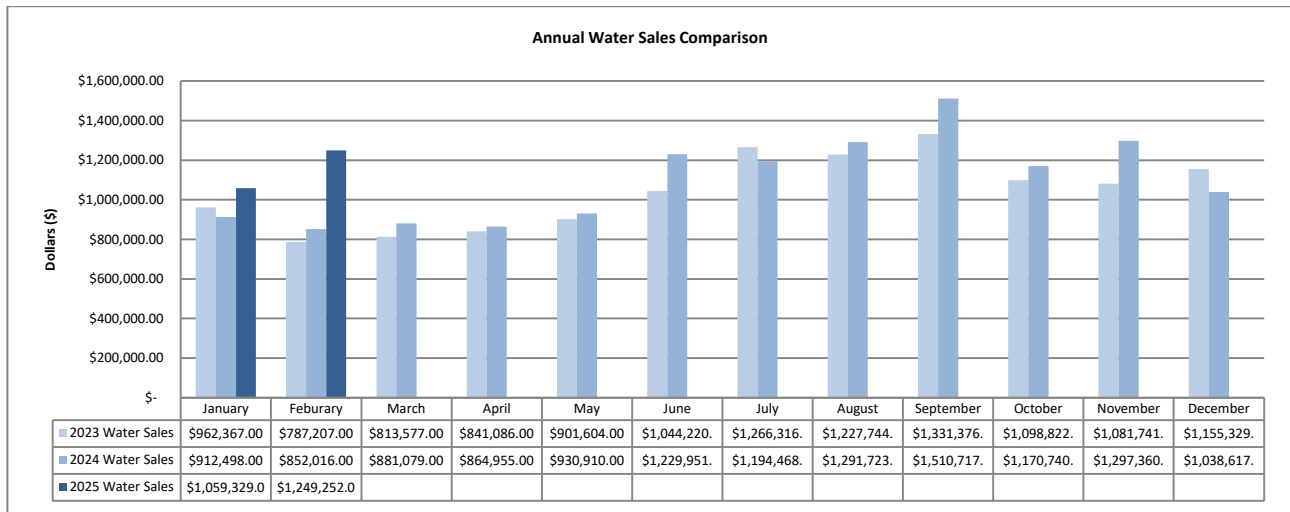

B. Aging

The total aging balance has increased by 18.9%, see first table below. For balances >30-days only, water has decreased 34% and wastewater has increased by 15.7%.

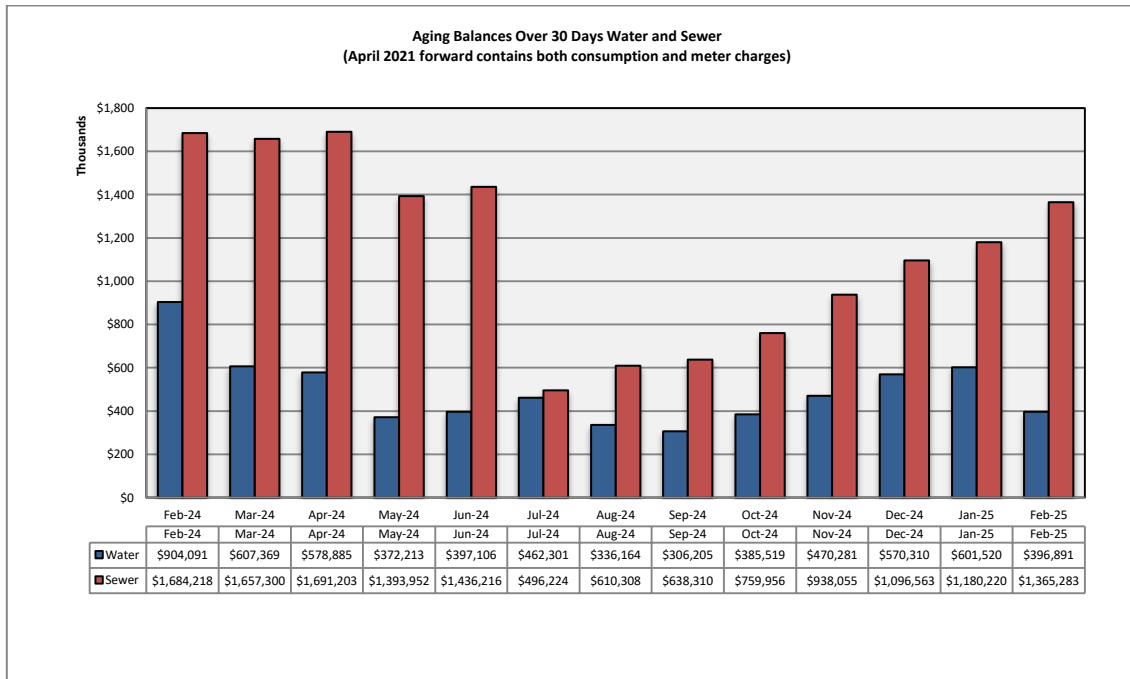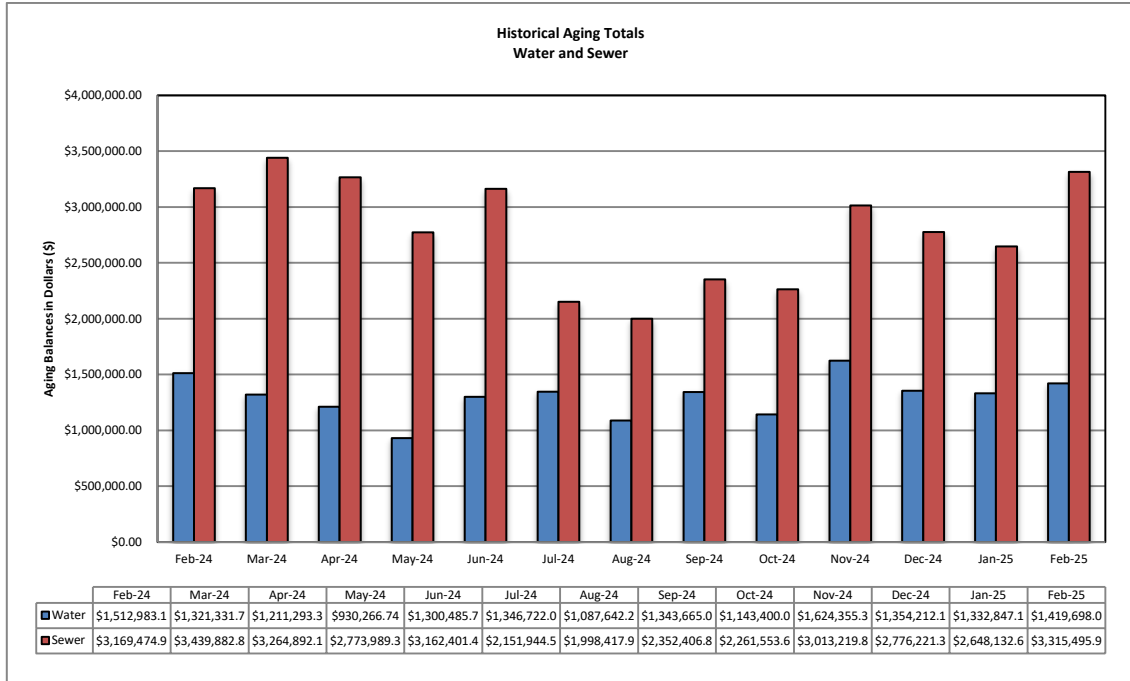

C. Bad Debt

Twenty-eight (28) accounts were sent to collections for a total amount of \$9,776.54. These collections typically arise when renter or property owner move out without paying their bills.

VI. SERVICE ORDERS

371 service orders were initiated by the customer service team during the reporting month. Of this total, 70 service orders or 19% were due to occupant changes.

223 service orders were initiated to accommodate water disconnection for non-payment and reconnection of water services when customer set up (or reinstate) a payment arrangement with down payment.

VII. OTHER ACTIVITIES

Rate changes and UUT exemptions, effective January 1, 2025, were applied to February 2025 bills. This was to ensure that no water consumptions from December 2024 were changed with the new rates.

VIII. REVENUE REPORT

A. Revenue Summary

Cash Revenue is compiled and reconciled to the merchant account on a daily basis. Cash receipts and deposits are made daily and internal controls are reviewed regularly to ensure safeguarding of assets and proper recording of all transactions. Total revenue collected in February 2025 is \$3,711,000 whereas Non-Rate Revenue is \$262,000; Utility Revenue is \$3,302,000 and Tax / Ambulance Revenue at \$147,000.

RWS collects Utility User Taxes and Ambulance Fees on behalf of the City of Rialto. The Utility User Tax (UUT) rates are based on the total billed amount, therefore the collection fluctuates as billed amounts change. The total UUT charges collected in February 2025 and February 2024 are \$143,000 and \$217,000 respectively. Ambulance Revenue is also collected on behalf of the City of Rialto totaling \$4,000 in February 2025 and \$5,000 in February 2024.

B. Non Rate Revenue - Extraterritorial Customers

RWS bills the City of Fontana \$133,000 each month for extraterritorial sewer usage.

Colton Unified School District is in agreement with RWS to pay \$5,000 monthly for sewage connections based on enrollment rates provided each school year.

An extraterritorial agreement to provide sewer service was executed between the City of Rialto and the County of San Bernardino—County Service Area 70, Zone BL (Bloomington). This housing development project generates extraterritorial sewer service revenue of \$20,000 per month.

The City has an agreement with Social Science Services dba Cedar House Life Change Center to provide extraterritorial sewer service providing sewer revenue of about \$5,000 each month.

C. Non-Rate Revenue – Other

Other revenue is generated by leasing space for cell towers to AT&T, which has two leases at \$2,073 and \$1,500. Sprint lease is at a currently contracted rate of \$2,000 each month. Vertical Bridge also provides \$2,400 a month of cell tower generated Revenue.

Rialto Bioenergy Solutions subleased a City property for \$10,750 a month.

The City and San Bernardino Valley Municipal Water District have entered into a Brine Line Capacity Agreement on February 23, 2021. This agreement pertains to the use of its interest in the SARI Line and discharge of certain brine waste to the SARI Line exclusively from the operation of Rialto Bioenergy Facilities within the City’s boundaries. The revenue generated in this agreement consists of quarterly rent of \$37,500 along with the Fixed Pipeline Capacity Fee of \$3,300 per month and Fixed Treatment Plant Capacity Fee of \$3,300 per month. In addition, a variable fee of any discharge costs are also billed.

The San Bernardino Valley Water District (SBVWD) reimburses RWS for water conservation programs provided to customers. A quarterly bill is delivered directly by the City.

D. Development Impact Fees

Development Impact Fees (“DIF”) are paid to the City of Rialto as various developments are completed in the City. As such, the City of Rialto receives monies from the various developments, which is then distributed to RWS. There was no DIF payment received in February of 2024.

E. Rialto Basin Water Rights and Leasing

A Standby Water Lease Agreement between Fontana Union Water Company and City of Rialto is in effect. For the Water 2023-2024 Water Year, RWS received a payment from San Bernardino County the amount of \$332,624 for Standby Charges and Production Charge.

In addition, the County is also billed annually for Rialto Well #3’s summertime electricity costs based on peak usage.

F. Cash Collections by Payment Method – Rialto Water Services

| Payment Method | Description | Transaction Count | FEBRUARY 2025 | % |
|---|---|--------------------------|----------------------|-------------|
| Carrier Deposits | Cash deposits prepared per day for transport to US Bank | 19 | \$ 117,076 | 3.12% |
| Remote Check Deposits | Scanned batches of checks payments made at the customer service counter | 19 | 1,113,745 | 29.69% |
| EBOX | Batches of electronic customer payments posted to customer accounts at US Bank. | 19 | 252,149 | 6.72% |
| PAYMENTUS - IVR / Paymentus / Walk-in Credit Card payment | Customer payments by credit cards and ACH / eCheck payments through an Interactive Voice Response system using a touchtone phone. Payments originated from Merchant online service | 10,772 | 1,553,121 | 41.41% |
| Lockbox Deposits | Batches of customer payments mailed in to US Bank's lockbox. | 19 | 706,631 | 18.84% |
| Pay Near Me | Cash payment service that allows customers to pay at a local 7-Eleven, CVS, or Family Dollar stores. | 73 | 7,957 | 0.21% |
| Total Revenue per Bank | | | \$ 3,750,680 | 100% |
| Recon to RUA Recap: | | | | |
| Adj detailed in RUA | | | (39,624) | |
| Prior mo. Correction | | | | |
| | | | | |
| RUA increase in Cash | | | \$ 3,711,056 | |

Transaction Counts for Carrier Deposits, Remote Deposits, UB Bill Conc Service (EBOX), and Lockbox Deposits reflect number of batches deposited to the bank. Transaction counts for credit card POS, IVR, and Pay-Near-Me transactions are per number of customer payments. IVR payments are received and process by Paymentus on the day the transactions are made. General ledger are posted and accounted for the following day the payments are processed.

G. Payment Collection Method – Fiscal Year to Date

| | Jul 2024 | Aug 2024 | Sept 2024 | Oct 2024 | Nov 2024 | Dec 2024 | Jan 2025 | Feb2025 | TOTAL | % |
|------------------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|----------------------|----------------|
| Cash Deposits | \$ 122,310 | \$ 116,600 | \$ 111,287 | \$ 121,951 | \$ 89,627 | \$ 122,268 | \$ 120,688 | \$ 117,076 | \$ 921,808 | 2.93% |
| Remote Check Deposits | 227,143 | 953,011 | 383,642 | 394,629 | 613,264 | 685,915 | 291,981 | 1,113,745 | \$ 4,663,329 | 14.84% |
| EBOX | 334,259 | 346,067 | 289,347 | 349,088 | 288,522 | 322,671 | 332,865 | 252,149 | \$ 2,514,968 | 8.00% |
| Paymentus, IVR, Credit Cards | 1,827,817 | 1,855,221 | 1,688,345 | 2,034,573 | 1,499,559 | 2,049,055 | 2,011,139 | 1,553,121 | \$ 14,518,830 | 46.21% |
| Lockbox Deposits | 1,169,619 | 1,273,243 | 1,089,604 | 1,285,860 | 903,561 | 1,175,827 | 1,098,091 | 706,631 | \$ 8,702,435 | 27.70% |
| Pay Near Me | 14,561 | 14,530 | 10,989 | 11,968 | 10,491 | 12,923 | 12,774 | 7,957 | \$ 96,194 | 0.31% |
| Total Revenue to Bank | \$ 3,695,709 | \$ 4,558,672 | \$ 3,573,214 | \$ 4,198,068 | \$ 3,405,024 | \$ 4,368,659 | \$ 3,867,538 | \$ 3,750,680 | \$ 31,417,564 | 100.00% |
| NSF | (7,962) | (4,947) | (8,970) | (8,950) | (21,124) | (20,764) | (9,479) | (10,322) | \$ (92,517) | |
| Net deposits | \$ 3,687,747 | \$ 4,553,726 | \$ 3,564,244 | \$ 4,189,118 | \$ 3,383,900 | \$ 4,347,895 | \$ 3,858,059 | \$ 3,740,358 | \$ 31,325,047 | |

H. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison

| | Feb 2025 | Feb 2024 | Variance |
|--------------|-------------------|-------------------|--------------------|
| UUT Water | \$ 49,244 | \$ 65,221 | \$ (15,977) |
| UUT Sewer | 94,238 | 152,172 | (57,934) |
| Ambulance | 4,178 | 5,009 | (832) |
| Total | \$ 147,660 | \$ 222,402 | \$ (74,742) |

I. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison

| | Feb 2025 | Feb 2024 | Variance |
|--------------------------------------|---------------------|---------------------|--------------------|
| Non-Rate / Extra Territorial Revenue | \$ 261,726 | \$ 667,131 | \$ (405,405) |
| Utility Revenue | \$ 3,301,670 | \$ 2,964,863 | \$ 336,807 |
| Total | \$ 3,563,396 | \$ 3,631,994 | \$ (68,598) |

J. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date

| | Jul 2024 | Aug 2024 | Sept 2024 | Oct 2024 | Nov 2024 | Dec 2024 | Jan 2025 | Feb 2025 | TOTAL |
|--------------------------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|----------------------|
| Non-Rate Revenue | | | | | | | | | |
| Cell Tower Rent, Lease | 5,647 | 19,985 | 21,506 | 66,161 | 55,391 | 9,235 | 12,824 | 29,957 | 220,704 |
| Interest Income | 19,290 | 9,559 | - | - | - | - | - | - | 28,850 |
| NRR-FOG | - | - | - | - | - | - | - | - | - |
| Municipal Water Sales | - | - | - | - | 332,624 | - | - | - | 332,624 |
| Extra Terr- Sewage | 31,463 | 252,123 | 161,340 | 185,039 | 136,360 | 128,586 | 145,544 | 225,208 | 1,265,662 |
| Abatement of Expenses | - | - | - | - | - | - | - | - | - |
| Water Meter Lost/Damaged/Repl | 1,419 | 710 | 2,129 | 5,171 | - | - | 4,924 | 492 | 14,845 |
| Misc Fees - New Occ, Same Day Svc | 5,877 | 4,453 | 4,939 | 5,629 | 3,067 | 5,525 | 5,945 | 6,069 | 41,503 |
| Miscellaneous Revenue - Sewer | - | - | - | - | - | - | - | - | - |
| NSF | - | 342 | - | 152 | 35 | - | 30 | - | 559 |
| Total Non-Rate Revenue | \$ 63,697 | \$ 287,171 | \$ 189,913 | \$ 262,152 | \$ 527,477 | \$ 143,345 | \$ 169,267 | \$ 261,726 | \$ 1,904,748 |
| Utility Revenue | | | | | | | | | |
| Water Penalty | 3,154 | 15,321 | 10,183 | 5,903 | 2,602 | 720 | 101 | 6,016 | 43,998 |
| Sewer Penalty | 5,200 | 33,061 | 18,283 | 7,639 | 3,313 | 1,435 | 700 | 11,411 | 81,041 |
| Turf Removal, Hi-Eff Rebate | (1,000) | (100) | - | - | - | - | - | - | (1,100) |
| Water Deposits Billed | 17,289 | 8,629 | 9,906 | 8,629 | 8,686 | 10,057 | 11,411 | 11,856 | 86,463 |
| Hydrant Deposits | 574 | - | - | - | 420 | 282 | - | - | 1,276 |
| Sewer Deposits Paid | - | - | - | - | - | - | - | - | - |
| Sewer Deposits Billed | 11,760 | 12,823 | 9,518 | 10,900 | 15,201 | 8,822 | 11,737 | 8,959 | 89,721 |
| Water | 1,171,886 | 1,540,256 | 1,194,449 | 1,386,681 | 884,906 | 1,229,369 | 1,086,436 | 1,126,085 | 9,620,068 |
| Sewer | 2,327,246 | 2,418,456 | 1,959,890 | 2,448,917 | 1,669,263 | 2,454,711 | 2,380,281 | 1,745,679 | 17,404,442 |
| Unapplied Credits | (101,077) | (54,176) | (140,916) | (81,949) | (69,090) | (35,829) | (43,709) | (83,121) | (609,868) |
| Bad Debt Sewer | 12,029 | 9,909 | - | - | - | - | 4,560 | - | 26,499 |
| Bad Debt Water | - | - | - | - | - | - | - | - | - |
| Tax Roll - Sewer | 15,596 | 2,790 | - | - | - | 22,950 | 399,116 | 474,784 | 915,235 |
| Collection Agency - Water | - | - | - | - | - | - | - | - | - |
| Collection Agency - Sewer | - | - | - | - | - | - | - | - | - |
| Collection Agency - Misc Water | - | - | - | - | - | - | - | - | - |
| Total Utility Revenue | \$ 3,462,656 | \$ 3,986,969 | \$ 3,061,313 | \$ 3,786,719 | \$ 2,515,301 | \$ 3,692,515 | \$ 3,850,632 | \$ 3,301,670 | \$ 27,657,776 |
| Total Non-Rate + Utility Rev. | 3,526,353 | 4,274,141 | 3,251,226 | 4,048,871 | 3,042,778 | 3,835,861 | 4,019,899 | 3,563,396 | 29,562,523 |

K. Increase in Cash Collections and Fund Distribution—Prior Year Comparison

| | Increase to Cash per CIS | Adjustments Required to GL Cash | Fund 660-Sewer | Fund 670-Water | Total Cash Per GL | Adjustments To Match RUA to Bank | Cash/CC/Cks Deposit To Bank |
|----------------------|--------------------------|---------------------------------|----------------|----------------|-------------------|----------------------------------|-----------------------------|
| February 2025 | 3,711,056 | 10,534 | 2,465,556 | 1,234,966 | 3,711,056 | 39,624 | 3,750,680 |
| February 2024 | 3,854,396 | 13,714 | 2,794,153 | 1,046,529 | 3,854,396 | (103,101) | 3,751,294 |

L. Non-Rate and Extraterritorial Customer Accounts Receivable Aging

| Name | Total as of 02/28/2025 | Current | 31-60 days | 61-90 days | >90 days |
|--------------------------------------|---------------------------|-------------------|------------------|-------------|------------------|
| AT&T - Easton | \$ (26,383) | (26,383) | - | - | - |
| Social Science Service - Cedar House | 5,434 | 5,434 | - | - | - |
| CITY OF FONTANA | 133,713 | 133,713 | - | - | - |
| Colton Unified School District | - | - | - | - | - |
| County of San Bernardino-CSA 70 BL | - | - | - | - | - |
| Rialto BioEnergy Solutions | 67,441 | 10,750 | 56,691 | - | - |
| Sprint-Nextel SBA 2012 TC Assets | 9,331 | - | - | - | 9,331 |
| San Bernardino Co Waste System Div. | - | - | - | - | - |
| SB Valley Mun Water District | - | - | - | - | - |
| Vertical Bridge Holdco, LLC (CIG) | 10,374 | 2,830 | 2,830 | - | 4,714 |
| Grand Total | \$ 199,910 | \$ 126,344 | \$ 59,522 | \$ - | \$ 14,045 |

AT&T The credit indicates annual payment of cell tower rent.

Social Science Service (Cedar House) balance reflects current service fees.

City of Fontana is current with its obligations.

Colton Unified School District is current with its obligations.

County of San Bernardino is current with its obligations.

Rialto Bioenergy Solutions RWS shows a current Invoice balance in February. The past due balance of \$56,691 has been satisfied subsequently in March.

Vertical Bridge Holdco, LLC and Sprint: Vertical Bridge and Sprint have been contacted for open Invoices as well.

RIALTO WATER
MONTHLY OPERATIONS REPORT

Reporting Period:

February 2025

Prepared for: Rialto Water Services

Prepared by: Veolia Water West Operating Services

RIALTO WATER
OPERATIONS AND MAINTENANCE REPORT

Contents

| | | |
|-------|--|----|
| I. | EXECUTIVE SUMMARY | 3 |
| A. | Water Production Totals | 4 |
| B. | Static Water Levels | 6 |
| II. | REGULATORY | 7 |
| A. | Regulatory Submittals | 7 |
| B. | Sample Site Location Results | 8 |
| C. | Violations | 10 |
| D. | Source Water Total Dissolved Solids (TDS) | 10 |
| III. | HEALTH AND SAFETY | 10 |
| A. | Monthly Safety Program Overview | 10 |
| IV. | CHEMICAL USE | 10 |
| V. | ELECTRICAL USE | 11 |
| VI. | WATER QUALITY COMPLAINTS | 11 |
| VII. | OPERATIONS UPDATE | 11 |
| A. | Operational Wells | 12 |
| B. | Valve Activity | 12 |
| C. | Hydrant Flushing | 12 |
| D. | Sanitary Survey | 13 |
| VIII. | ASSET MANAGEMENT | 13 |
| A. | Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues | 13 |
| B. | Major Equipment and/or Machinery Outages | 13 |
| IX. | RAINFALL TOTALS | 14 |

RIALTO WATER

MONTHLY OPERATIONS REPORT

I. EXECUTIVE SUMMARY

Highlights of this month's Water O&M report include the following:

- The water distribution network achieved compliance with all permit requirements.
- No sample anomalies that require secondary sampling.
- No significant issues with water availability. The purchasing of water remained consistent and daily equalization tanks levels remained at anticipated volume for customer availability.
- The Preventative Maintenance Program, as well as Valve Exercising, continues to identify areas of focus for our Routine Repair and Replacement.

A. Water Production Totals

Total water delivered into the Rialto system this month was 624.93 acre-feet. 543.39 acre-feet was delivered into the system from the groundwater wells (City 4A production is included in the well total). -27.42 acre-feet was delivered via the BLF transmission system (City 4A production has been deducted). 108.96 acre-feet came from the OPRTP.

| FEBRUARY 2025 DAILY PRODUCTION TOTALS IN ACRE FEET | | | | | | | | | | | |
|--|--------------|---------------|-------------|-------------|--------------|---------------|-------------------|---------------------|--------------|--------------------|--------------------|
| DATE | Chino 2 | City 2 | Rialto 3 | Rialto 5 | Miro 3 | EW-1 | Delivered Via BLF | | | | TOTAL ³ |
| | | | | | | | City 4A | Purchased | | OPRTP ² | |
| | | | | | | | BOOSTER 6-9 | Cactus ¹ | | | |
| 2/1/25 | 5.30 | 5.19 | 0.00 | 0.00 | 3.56 | 5.69 | 7.85 | 1.84 | 2.46 | 3.94 | 27.98 |
| 2/2/25 | 6.08 | 0.10 | 0.00 | 0.00 | 3.70 | 6.37 | 8.82 | 5.97 | 0.02 | 4.36 | 26.60 |
| 2/3/25 | 5.10 | 0.00 | 0.00 | 0.00 | 3.78 | 6.13 | 9.61 | 8.84 | 0.03 | 3.76 | 27.64 |
| 2/4/25 | 4.91 | 0.00 | 0.00 | 0.00 | 3.80 | 5.11 | 0.00 | 6.68 | 0.02 | 5.65 | 26.17 |
| 2/5/25 | 4.38 | 0.00 | 0.00 | 0.00 | 3.90 | 6.53 | 12.12 | 2.16 | 0.01 | 3.48 | 20.47 |
| 2/6/25 | 6.29 | 0.00 | 0.00 | 0.00 | 0.90 | 5.28 | 0.37 | 1.81 | 0.01 | 4.34 | 18.62 |
| 2/7/25 | 4.59 | 0.00 | 0.00 | 0.00 | 3.66 | 5.86 | 5.38 | 0.64 | 4.34 | 4.17 | 23.27 |
| 2/8/25 | 5.03 | 0.00 | 0.00 | 0.00 | 0.01 | 5.90 | 8.74 | 5.07 | 2.91 | 3.56 | 22.48 |
| 2/9/25 | 5.21 | 1.98 | 0.00 | 0.00 | 0.00 | 6.01 | 0.00 | 0.00 | 0.00 | 0.00 | 13.20 |
| 2/10/25 | 5.37 | 2.49 | 0.00 | 0.00 | 0.00 | 5.74 | 4.83 | 0.51 | 0.01 | 9.22 | 23.34 |
| 2/11/25 | 5.10 | 0.00 | 0.00 | 0.00 | 0.00 | 5.82 | 10.60 | 7.94 | 1.05 | 4.17 | 24.08 |
| 2/12/25 | 5.21 | 0.00 | 0.00 | 0.00 | 0.00 | 5.56 | 8.89 | 7.16 | 0.00 | 4.80 | 22.73 |
| 2/13/25 | 0.41 | 2.30 | 0.00 | 0.00 | 0.00 | 5.89 | 0.28 | 0.85 | 0.01 | 4.12 | 13.58 |
| 2/14/25 | 0.00 | 1.18 | 0.00 | 0.00 | 0.00 | 5.90 | 6.76 | 7.19 | 0.01 | 0.00 | 14.28 |
| 2/15/25 | 0.00 | 11.48 | 0.00 | 0.00 | 0.00 | 5.79 | 12.01 | 3.03 | 4.38 | 0.00 | 24.68 |
| 2/16/25 | 0.00 | 11.58 | 0.00 | 0.00 | 0.00 | 5.92 | 7.11 | 3.21 | 3.46 | 0.07 | 24.24 |
| 2/17/25 | 0.00 | 10.24 | 0.00 | 0.00 | 0.00 | 6.10 | 4.87 | 0.00 | 4.12 | 4.82 | 25.28 |
| 2/18/25 | 0.00 | 7.21 | 0.00 | 0.00 | 0.00 | 6.26 | 2.39 | 0.00 | 0.03 | 3.69 | 17.19 |
| 2/19/25 | 0.00 | 11.13 | 0.00 | 0.00 | 0.00 | 5.59 | 2.75 | 0.37 | 0.02 | 5.39 | 22.50 |
| 2/20/25 | 0.00 | 8.04 | 0.00 | 0.00 | 0.00 | 5.53 | 0.11 | 0.21 | 2.75 | 3.70 | 20.23 |
| 2/21/25 | 0.00 | 8.20 | 0.00 | 0.00 | 0.00 | 5.83 | 0.00 | 0.00 | 0.03 | 4.60 | 18.66 |
| 2/22/25 | 0.00 | 9.90 | 0.00 | 0.00 | 0.00 | 5.65 | 0.00 | 0.00 | 0.02 | 4.20 | 19.77 |
| 2/23/25 | 0.00 | 12.93 | 0.00 | 0.00 | 0.00 | 5.99 | 9.92 | 4.77 | 0.04 | 5.23 | 28.96 |
| 2/24/25 | 3.88 | 7.64 | 0.00 | 0.00 | 0.00 | 5.96 | 2.96 | 0.00 | 0.03 | 3.43 | 20.94 |
| 2/25/25 | 4.71 | 11.33 | 0.00 | 0.00 | 0.00 | 5.73 | 0.00 | 0.00 | 0.03 | 5.99 | 27.79 |
| 2/26/25 | 4.75 | 7.56 | 0.00 | 0.00 | 0.00 | 6.15 | 0.00 | 0.00 | 1.36 | 3.84 | 23.66 |
| 2/27/25 | 5.99 | 7.05 | 0.00 | 0.00 | 0.00 | 5.25 | 0.00 | 0.00 | 0.03 | 4.24 | 22.56 |
| 2/28/25 | 4.51 | 6.25 | 0.00 | 0.00 | 0.00 | 5.56 | 0.00 | 1.92 | 1.60 | 4.19 | 24.03 |
| TOTAL | 86.82 | 143.78 | 0.00 | 0.00 | 23.31 | 163.11 | 126.37 | 70.17 | 28.78 | 108.96 | 624.93 |
| MIN | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 5.11 | 0.00 | 0.00 | 0.00 | 0.00 | 13.20 |
| MAX | 6.29 | 12.93 | 0.00 | 0.00 | 3.90 | 6.53 | 12.12 | 8.84 | 4.38 | 9.22 | 28.96 |
| AVE | 3.10 | 5.14 | 0.00 | 0.00 | 0.83 | 5.83 | 4.51 | 2.51 | 1.03 | 3.89 | 22.32 |

¹ Measured at point of connection at Cactus Reservoir site including production from City 4A. Amount may vary compared to billing.

² Measured at point of connection at Cedar Reservoir site. Amount may vary as compared to billing.

³ City 4A is not included in total. It has been accounted for in the Purchased total.

FEBRUARY 2025 DAILY BOOSTER TOTALS IN ACRE FEET

| DATE | Booster 1 | Booster 2 | Booster 3 | Booster 4 | Booster 5 | Booster 6-9 | Booster 10 | Booster 11 |
|--------------|------------------|------------------|------------------|------------------|------------------|--------------------|-------------------|-------------------|
| 2/1/25 | 0.00 | 0.00 | 12.84 | 0.00 | 2.44 | 1.84 | 0.00 | 0.00 |
| 2/2/25 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 5.97 | 0.00 | 0.00 |
| 2/3/25 | 0.00 | 0.00 | 6.11 | 0.00 | 0.00 | 8.84 | 0.00 | 0.00 |
| 2/4/25 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 6.68 | 0.00 | 0.00 |
| 2/5/25 | 0.00 | 0.00 | 1.48 | 0.00 | 0.00 | 2.16 | 0.00 | 0.00 |
| 2/6/25 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.81 | 0.00 | 0.00 |
| 2/7/25 | 0.00 | 0.00 | 0.00 | 0.00 | 4.34 | 0.64 | 0.00 | 0.00 |
| 2/8/25 | 0.00 | 0.00 | 0.00 | 0.00 | 2.90 | 5.07 | 0.00 | 0.00 |
| 2/9/25 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/10/25 | 0.00 | 0.00 | 4.16 | 0.00 | 0.00 | 0.51 | 0.00 | 0.00 |
| 2/11/25 | 0.00 | 0.00 | 6.67 | 0.00 | 1.04 | 7.94 | 0.00 | 0.00 |
| 2/12/25 | 0.00 | 0.00 | 5.67 | 0.00 | 0.00 | 7.16 | 0.00 | 0.00 |
| 2/13/25 | 0.00 | 0.00 | 1.65 | 0.00 | 0.00 | 0.85 | 0.00 | 0.00 |
| 2/14/25 | 0.00 | 0.00 | 8.51 | 0.00 | 0.00 | 7.19 | 0.00 | 0.00 |
| 2/15/25 | 0.00 | 0.00 | 10.45 | 0.00 | 4.36 | 3.03 | 0.00 | 0.00 |
| 2/16/25 | 0.00 | 0.00 | 7.01 | 0.00 | 3.44 | 3.21 | 0.00 | 0.00 |
| 2/17/25 | 0.00 | 0.00 | 6.60 | 0.00 | 4.09 | 0.00 | 0.00 | 0.00 |
| 2/18/25 | 0.00 | 0.00 | 4.34 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/19/25 | 0.00 | 0.00 | 6.65 | 0.00 | 0.00 | 0.37 | 0.00 | 0.00 |
| 2/20/25 | 0.00 | 0.00 | 4.21 | 0.00 | 2.73 | 0.21 | 0.00 | 0.00 |
| 2/21/25 | 0.00 | 0.00 | 4.51 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/22/25 | 0.00 | 0.00 | 5.05 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/23/25 | 0.00 | 0.00 | 13.68 | 0.00 | 0.00 | 4.77 | 0.00 | 0.00 |
| 2/24/25 | 0.00 | 0.00 | 7.57 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/25/25 | 0.00 | 0.00 | 10.73 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/26/25 | 0.00 | 0.00 | 8.00 | 0.00 | 1.33 | 0.00 | 0.00 | 0.00 |
| 2/27/25 | 0.00 | 0.00 | 6.57 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 2/28/25 | 0.00 | 0.00 | 6.17 | 0.00 | 1.56 | 1.92 | 0.00 | 0.00 |
| TOTAL | 0.00 | 0.00 | 148.63 | 0.00 | 28.23 | 70.17 | 0.00 | 0.00 |
| MIN | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| MAX | 0.00 | 0.00 | 13.68 | 0.00 | 4.36 | 8.84 | 0.00 | 0.00 |
| AVE | 0.00 | 0.00 | 5.31 | 0.00 | 1.01 | 2.51 | 0.00 | 0.00 |

B. Static Water Levels

All City of Rialto wells are sounded each month, both active and inactive well sites. Depth-to-water is measured from the well head to the static water surface. Increases in depth-to-water represent a decrease in static water level.

| Depth to Water | | | | | | | | | | | | | |
|------------------------------------|-----------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| Wells Depth to Pump | Historical Maximum Depth to Water | Mar | Apr | May | Jun | Jul | Aug | Sept | Oct | Nov | Dec | Jan | Feb |
| Chino # 1 (580 ft) In-active well | 429' | 420' | 417' | 411' | 414' | 414' | 412' | 411' | 411' | 411' | 410' | 412' | 414' |
| Chino # 2 (550 ft) | 369' | 342' | 346' | 354' | 347' | 352' | 347' | 347' | 343' | 340' | 342' | 341' | 335' |
| City # 1 (260 ft) | 392' | 247' | 164' | 158' | 158' | 151' | 150' | 247' | 247' | 251' | 121' | 126' | 121' |
| City # 2 (480 ft) | 402' | 171' | 182' | 164' | 164' | 164' | 171' | 210' | 137' | 139' | 147' | 146' | 128' |
| City # 3 (525 ft) Out of Service | 505' | 450' | 423' | 423' | 423' | 418 | 417' | 416' | 416' | 417' | 414' | 414' | 415' |
| City # 4A (528 ft) | 406' | 361' | 373' | 373' | 374' | 380' | 379' | 380' | 380' | 380' | 381' | 374' | 377' |
| City # 5 (385 ft) In-active well | 364' | 339' | 340' | 339' | 335' | 333' | 334' | 332' | 322' | 320' | 318' | 318' | 321' |
| Rialto # 1 (650 ft) In-active well | 588' | 564' | 569' | 569' | 571' | 571' | 571' | 571' | 553' | 552' | 561' | 555' | 571' |
| Rialto # 2 (550 ft) In-active well | 502' | 500' | 500' | 500' | 501' | 500' | 501' | 502' | 501' | 501' | 499' | 501' | 496' |
| Rialto # 3 (509 ft) | 478' | 475' | 474' | 475' | 474' | 477' | 477' | 473' | 476' | 473' | 472' | 473' | 473' |
| Rialto # 4 (450 ft) In-active well | 418' | 415' | 415' | 415' | 415' | 416' | 415' | 418' | 418' | 414' | 413' | 414' | 415' |
| Rialto # 5 (560 ft) | 386' | 385' | 386' | 386' | 386' | 386' | 385' | 384' | 384' | 384' | 385' | 385' | 384' |
| Rialto Well # 7 In-active well | 362' | 361' | 362' | 362' | 361' | 361' | 362' | 362' | 362' | 361' | 362' | 360' | 360' |
| Miro # 3 (563 ft) | 492' | 486' | 487' | 488' | 487' | 489' | 487' | 485' | 485' | 484' | 484' | 484' | 484' |
| EW-1 (780 ft) | 476' | 475' | 476' | 476' | 473' | 474' | 475' | 474' | 473' | 475' | 475' | 474' | 472' |

II. REGULATORY

All State of California and public health agency regulatory requirements were met.

A. Regulatory Submittals

- Monthly Summary of Distribution System Coliform Monitoring
- NPDES Discharge Letter
- Conservation SAFER Report

| Sample Test Result Standards | | | |
|---|------------------|--------------------------------|---------------------------|
| Type of Sampling | Units of Measure | Detectable Limit for Reporting | Maximum Contaminant Level |
| Total Coliform | A | -- | -- |
| E. Coli | A | -- | -- |
| Nitrate as N | mg/L | 0.20 | 10 |
| Perchlorate (ClO ₄) | µg/L | 1.0 | 6.0 |
| Total Dissolved Solids | mg/L | -- | 500 |
| P= Present A= Absent mg/L = parts per million µg/L = parts per billion | | | |

| Sample Date | Sample Site Location Results | | | | | | | | | |
|---------------------------------|------------------------------|--------|---------|----------|----------|--------|------|------------|---------|--------|
| | Chino 2 | City 2 | City 4A | Rialto 3 | Rialto 5 | Miro 3 | EW-1 | BLF Cactus | BLF 6-9 | OPRT P |
| 02/19/2025 | | | | | | | | | | |
| Type of Sampling | | | | | | | | | | |
| Total Coliform | A | A | A | A | A | A | A | A | A | A |
| E. Coli | A | A | A | A | A | A | A | A | A | A |
| Nitrate as N | 2.9 | | | | | | | | | |
| Perchlorate (ClO ₄) | 1.1* | | | 4.4* | <1.0 | 8.0* | 100* | | | |
| Total Dissolved Solids | 260 | 200 | 280 | 240 | 210 | 220 | 230 | 320 | 280 | 190 |

*Sample is from the well head so it is before disinfection & treatment. Treatment is performed before it goes into the distribution system. Water going into the distribution system is <1.0 (non-detect).

B. Sample Site Location Results

| Rialto Distribution Sample Results | | | | | | |
|---|----------------------------|-----------------------|----------------|-----------------------|-----------------------|------------------|
| February 2025 | | | | | | |
| Sample Location | Free Cl Res (Field) | Total Coliform | E. Coli | Apparent Color | Odor Threshold | Turbidity |
| CYCLE 1 - 02/03/25 | mg/l | P/A | P/A | Color Units | TON | NTU |
| 335 W. Rialto | 1.14 | A | A | | | |
| 1228 W. Merrill | 1.14 | A | A | | | |
| 256 N. Fillmore | 1.17 | A | A | | | |
| 987 W. Grove | 0.88 | A | A | | | |
| 978 N. Driftwood | 0.72 | A | A | | | |
| 1451 N. Linden | 0.75 | A | A | | | |
| 469 W. Jackson | 0.98 | A | A | | | |
| 935 E. Mariposa | 1.11 | A | A | | | |
| 1000 N. Joyce | 1.01 | A | A | | | |
| 766 N. Chestnut | 1.03 | A | A | | | |
| 149 W. Victoria | 1.00 | A | A | | | |
| 313 E. McKinley | 1.18 | A | A | | | |
| 609 E. South | 1.15 | A | A | | | |
| 273 E. Alru | 1.15 | A | A | | | |
| 1161 S. Lilac | 1.26 | A | A | | | |
| 101 E. Valley | 1.13 | A | A | | | |
| CYCLE 2 - 02/11/25 | mg/l | P/A | P/A | Color Units | TON | NTU |
| 210 N. Park | 0.70 | A | A | | | |
| 101 S. Larch | 0.88 | A | A | | | |
| 320 N. Wisteria | 1.01 | A | A | | | |
| 861 W. Grove | 0.92 | A | A | | | |
| 1168 N. Glenwood | 1.16 | A | A | | | |
| 1320 N. Fitzgerald | 1.11 | A | A | | | |
| 860 N. Willow | 1.13 | A | A | | | |
| 209 E. Cornell | 1.00 | A | A | | | |
| 643 E. Margarita | 1.18 | A | A | | | |
| 1170 N. Terrace Rd. | 0.93 | A | A | | | |
| 681 E. Erwin | 1.01 | A | A | | | |
| 402 E. Merrill | 1.30 | A | A | | | |
| 261 W. Wilson | 1.02 | A | A | | | |
| 532 S. Iris | 1.06 | A | A | | | |
| 281 W. Hawthorne | 1.25 | A | A | | | |
| 379 W. Valley | 1.07 | A | A | | | |

Rialto Distribution Sample Results

February 2025

| Sample Location | Free Cl Res (Field) | Total Coliform | E. Coli | Apparent Color | Odor Threshold | Turbidity |
|---------------------------|---------------------|----------------|---------|----------------|----------------|-----------|
| | mg/l | P/A | P/A | Color Units | TON | NTU |
| CYCLE 3 - 02/19/25 | | | | | | |
| 236 N. Willow | 1.01 | A | A | | | |
| 775 E. Foothill | 0.73 | A | A | | | |
| 878 N. Primrose | 1.12 | A | A | | | |
| 369 E. Van Koevering | 1.03 | A | A | | | |
| 274 W. Valencia | 1.05 | A | A | | | |
| 1566 N. Fillmore | 1.13 | A | A | | | |
| 932 N. Idyllwild | 1.06 | A | A | | | |
| 644 N. Smoketree | 1.02 | A | A | | | |
| 605 W. Rosewood | 1.09 | A | A | | | |
| 1189 W. Second | 1.10 | A | A | | | |
| 775 W. Rialto | 1.03 | A | A | | | |
| 211 E. Wilson | 1.16 | A | A | | | |
| 595 E. Huff | 1.08 | A | A | | | |
| 1005 S. Riverside | 1.22 | A | A | | | |
| 794 S. Verde | 1.26 | A | A | | | |
| 1055 W. Bloomington | 0.97 | A | A | | | |
| CYCLE 4 - 02/25/25 | | | | | | |
| 375 S. Cactus | 1.07 | A | A | <3.0 | 1 | 0.15 |
| 101 S. Linden | 1.21 | A | A | <3.0 | 1 | 0.23 |
| 234 N. Larch | 1.06 | A | A | <3.0 | 1 | <0.10 |
| 575 N. Driftwood | 1.13 | A | A | <3.0 | 1 | <0.10 |
| 1355 W. Shamrock | 0.99 | A | A | <3.0 | 1 | <0.10 |
| 992 N. Yucca | 1.16 | A | A | <3.0 | 1 | <0.10 |
| 481 W. Cornell | 1.17 | A | A | <3.0 | 1 | <0.10 |
| 158. E. Shamrock | 1.20 | A | A | <3.0 | 1 | <0.10 |
| 749 E. Holly | 1.14 | A | A | <3.0 | 1 | <0.10 |
| 545 E. Victoria | 1.12 | A | A | <3.0 | 1 | <0.10 |
| 200 N. Sycamore | 1.08 | A | A | <3.0 | 1 | <0.10 |
| 407 E. Allen | 1.03 | A | A | <3.0 | 1 | <0.10 |
| 399 E. Montrose | 1.22 | A | A | <3.0 | 1 | <0.10 |
| 856 S. Orange | 1.39 | A | A | <3.0 | 1 | <0.10 |
| 911 S. Cactus | 1.26 | A | A | <3.0 | 1 | <0.10 |
| 220 W. Valley | 1.30 | A | A | <3.0 | 1 | <0.10 |
| P/A + Present or Absent | | | | | | |

C. Violations

No violations were received during this reporting period.

D. Source Water Total Dissolved Solids (TDS)

Veolia has a goal of maintaining an acceptable blended TDS level between all its sources. This goal is achieved by shifting production to or from the lowest TDS wells or purchased low TDS water while adhering to the overall water supply strategy and meeting system demands. The TDS was 226 mg/L for the month of February as compared to 232 mg/L in January. The TDS levels are below the secondary maximum contaminant level requirements.

III. HEALTH AND SAFETY

A. Monthly Safety Program Overview

| Category | Monthly Statistic |
|-----------------------------|--|
| Safety Training Topics | Emergency Action Plan (EAP) Fire Prevention |
| Lost Time Incidents, count* | 0 |
| Recordable Incidents, count | 0 |
| Near Miss Incidents, count | 0 |
| Vehicle Incidents, count | 0 |

*A lost time incident has not occurred in the past 4156 days.

IV. CHEMICAL USE

Sodium hypochlorite is the only chemical added to the water system. A total of 1716 gallons of sodium hypochlorite was used in February as compared to 2079 gallons used in January.

V. ELECTRICAL USE

Southern California Edison (SCE) has not provided all the data for February 2025. We will provide the data as it is received, thus will include yearly usage received to date.

| SCE | | kWh |
|------|-----------|--------------|
| Year | Month | Billed Usage |
| 2024 | January | 208,007 |
| 2024 | February | 186,792 |
| 2024 | March | 421,268 |
| 2024 | April | 463,324 |
| 2024 | May | 428,050 |
| 2024 | June | 629,344 |
| 2024 | July | 550,202 |
| 2024 | August | 650,431 |
| 2024 | September | 562,739 |
| 2024 | October | 529,208 |
| 2024 | November | 266,378 |
| 2024 | December | 380,580 |

VI. WATER QUALITY COMPLAINTS

No complaints were received during this reporting period.

VII. OPERATIONS UPDATE

The overall operational strategy is to meet the daily water demand. The City of Rialto water system has six operational wells, one of which is owned by the County of San Bernardino and operated by Veolia; Oliver P. Roemer Treatment Plant (OPRTP), which is jointly owned by the City (25%) and West Valley Water District (WVWD); purchased water through the Baseline Feeder (BLF) system from San Bernardino Valley Municipal Water District (SBVMWD); and, if required to meet demand, additional water can be supplied by the City of San Bernardino (CSB) through the BLF for emergency supply only with no guarantee of actual delivery. Water produced from City Well 4A discharges into the BLF and its production is included in deliveries from that shared transmission line when City Well 4A is in service.

The overall pumping strategy is based on adjudicated rights, well availability, remediation requirements, and quality of source, cost to operate, and varying weather conditions. TDS effluent concentrations for the City of Rialto WWTP are taken into consideration when operating the facilities and water sources.

A. Operational Wells

All wells were operational.

B. Valve Activity

On the basis of information collected in 2019, Veolia now has a baseline assessment of all valves and has initiated a new cycle of valve exercising. 41 valves were exercised for the month of February.

| Valve Turning Progress | |
|-------------------------------|----------------------|
| | Valves Turned |
| 2020 | 530 |
| 2021 | 340 |
| 2022 | 463 |
| 2023 | 750 |
| 2024 | 379 |
| 2025 | 121 |

C. Hydrant Flushing

There are 63 hydrant/dead ends that are flushed annually to maintain water quality. Zero flushings were performed in February.

| Hydrant/Dead End Flushing Progress | |
|---|-------------|
| | 2025 |
| January | 0 |
| February | 0 |
| Total | 63 |
| Progress % (0) | |

D. Sanitary Survey

DDW performed field site visits on May 22 and August 22, 2024. The results of the sanitary survey were received on September 19, 2024. All minor deficiencies have been corrected and submitted to DDW.

VIII. ASSET MANAGEMENT

The following work orders were completed for the month of February:

- Preventive Maintenance –9
- Corrective Maintenance –0
- Predictive Maintenance –0

13– PMs planned for March 2025

A. Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues

Corrective Work Order labor hours were dedicated to five pipe line and one hydrant repairs.

B. Major Equipment and/or Machinery Outages

All wells were operational.

IX. RAINFALL TOTALS

| SEASON | JUL | AUG | SEP | OCT | NOV | DEC | JAN | FEB | MAR | APR | MAY | JUN | TOTAL |
|---------|------|------|------|------|------|------|------|-------|------|------|------|------|-------|
| 2019-20 | 0.00 | 0.00 | 0.00 | 0.00 | 0.64 | 1.52 | 0.23 | 0.33 | 1.18 | 3.42 | 0.00 | 0.00 | 7.32 |
| 2020-21 | 0.00 | 0.00 | 0.00 | 0.00 | 0.85 | 1.02 | 2.55 | 0.05 | 1.13 | 0.00 | 0.00 | 0.00 | 5.60 |
| 2021-22 | 0.53 | 0.00 | 0.00 | 0.55 | 0.00 | 7.27 | 0.00 | 0.00 | 0.77 | 0.45 | 0.03 | 0.00 | 9.60 |
| 2022-23 | 0.00 | 0.00 | 0.24 | 0.38 | 2.15 | 1.80 | 5.06 | 4.14 | 7.73 | 0.20 | 0.59 | 0.00 | 22.29 |
| 2023-24 | 0.00 | 2.62 | 0.00 | 0.09 | 0.60 | 1.18 | 1.00 | 10.38 | 1.87 | 0.53 | 0.34 | 0.00 | 18.61 |
| 2024-25 | 0.00 | 0.00 | 0.00 | 0.00 | 0.45 | 0.00 | 0.21 | 3.68 | | | | | 4.34 |

| | | |
|-----------------------------------|---|-------------|
| July 24- June 25 | = | 4.34 INCHES |
| YEAR TO DATE FOR 2025 | = | 3.89 INCHES |
| AVG. RAINFALL FOR LAST FIVE YEARS | = | 8.87 INCHES |

AVG. RAINFALL FOR SAN BERNARDINO COUNTY FOR THE LAST 100 YEARS : 16.25 INCHES

| 2025 | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | Total |
|--------|------|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-------|
| Totals | 0.21 | 3.68 | | | | | | | | | | | 3.89 |

Highland - Los Angeles Basin - Station 251

| Month Year | Total ETo (in) | Total Precip (in) | Avg Sol Rad (Ly/day) | Avg Vap Pres (mBars) | Avg Max Air Temp (°F) | Avg Min Air Temp (°F) | Avg Air Temp (°F) | Avg Max Rel Hum (%) | Avg Min Rel Hum (%) | Avg Rel Hum (%) | Avg Dew Point (°F) | Avg Wind Speed (mph) | Avg Soil Temp (°F) |
|------------|----------------|-------------------|----------------------|----------------------|-----------------------|-----------------------|-------------------|---------------------|---------------------|-----------------|--------------------|----------------------|--------------------|
| Jan 2025 | 2.81 K | 1.87 | 261 | 5.4 | 66.4 K | 38.9 | 52.5 | 65 | 26 | 42 | 27.1 | 4.0 K | 49.8 K |
| Feb 2025 | 2.87 | 4.35 | 321 | 8.9 K | 71.3 K | 45.9 K | 57.8 K | 80 | 37 | 56 K | 40.7 K | 3.5 | 53.8 |
| Tots/Avgs | 5.68 | 6.2 | 291 | 7.2 | 68.9 | 42.4 | 55.2 | 73 | 32 | 49 | 33.9 | 3.8 | 51.8 |

RIALTO WASTEWATER
MONTHLY OPERATIONS REPORT

Reporting Period:
February 2025

Prepared for: - Rialto Water Services



Prepared by: - Veolia Water West Operating Services



RIALTO WASTEWATER OPERATIONS AND MAINTENANCE REPORT

Contents

EXECUTIVE SUMMARY

- 1. Collection System / Customer Service Log**
 - a. Collection System Activities
 - b. S.S.O. dates
 - c. Customer Service Call Outs
- 2. Wastewater Treatment Plant - Monthly Overview**
 - a. Significant events during the month
- 3. Treatment Facility Performance / Laboratory Activities**
 - a. See attached Monthly Performance Summary
 - b. Summary of Notices and Laboratory Tests / Reports filed with government agencies
 - c. Effluent Specifications Exceedance Discussion
- 4. Monthly Safety Program Overview**
- 5. Biosolids, Chemicals, and Utilities**
 - a. Monthly Biosolids Production
 - b. Monthly Chemical Consumption
 - c. Monthly Utilities Consumption
- 6. Odor Complaints / Actions Taken**
- 7. Major Equipment and/or Machinery Outages**
- 8. Outside Agency Activities during the Month**
 - a. Government agency or property insurance inspections
 - b. Government agency environmental, health, or safety tests/monitoring
 - c. Government agency notice of violation received
 - d. Government agency monitoring
 - e. Other matters of concern
- 9. Complaint Logs**

TABLES

- Treatment Facility – Monthly Performance Summary
- Collection System- Monthly Pipe Cleaned

RIALTO WASTEWATER

MONTHLY OPERATIONS REPORT

EXECUTIVE SUMMARY

Highlights of this month’s Wastewater O&M report include the following:

- The treatment plant performed well and met all compliance parameters.
- There was one residential call-out for sewer collection issues.

1. Collection System/Customer Service Log

a. Collections group activities this month:

| Category | Current Month Statistics | Prior Month Statistics | 2024 Year to Date Statistics |
|--|--------------------------|------------------------|------------------------------|
| Sanitary sewers are cleaned using the conventional method, including feet, which includes “Hot spot cleaning.” | 24,435 | 11,383 | 35,818 |
| Sanitary sewers assessed using the SL-RAT method, feet | 0 | 0 | 0 |
| CCTV Inspection, miles (26 is the annual goal)* | 1.88 | 0 | 1.88 |
| Manhole Inspections | 15 | 0 | 15 |
| USA Dig Alert Markings, count | 37 | 40 | 77 |
| Residential call outs | 1 | 2 | 3 |
| Sanitary sewer overflows | 0 | 1 | 1 |

- b. S.S.O. N/A
- c. Customer Service Call Outs – See Item 9 for details.

2. Wastewater Treatment Plant – Monthly Overview

- NPDES discharge compliance parameters were achieved.

a. Significant events during the month were: None.

3. Treatment Facility Performance/Laboratory Activities

- a. See the attached Table 1 Monthly Performance Summary.
- b. Summary of Notices and Laboratory Tests/Reports filed with government agencies.
The monthly submittal of State/Federal discharge monitoring reports was completed promptly.
- c. Effluent specification exceedance discussion
See Section 2 above. N/A

4. Monthly Safety Program Overview

| Category | Monthly Statistic |
|-----------------------------|-------------------|
| Safety Training Topics | 1 |
| Lost Time Incidents count* | 0 |
| Recordable Incidents, count | 0 |
| Near Miss Incidents, count | 1 |
| Vehicle Incidents, count | 0 |

*A lost time incident has not occurred since 9-3-2020, totaling 1,638 days.

5. Biosolids, Chemicals, and Utilities

a. Monthly Biosolids Production

| Biosolids | Current Month Statistics | Prior Month Statistics | 2024 Year-to-Date Statistics |
|-------------------|--------------------------|------------------------|------------------------------|
| Wet Tons Produced | 803.4 | 1357.15 | 2160.55 |

b. Monthly Chemical Consumption

| Chemical | Current Month Gallons Used | Prior Month Gallons Used |
|---|----------------------------|--------------------------|
| Sodium Hypochlorite, Tertiary Disinfection | 23,865 | 33,883 |
| Sodium Bisulfite, Discharge Dechlorination | 9,937 | 11,407 |
| Ferrous Chloride, Digester Gas Conditioning | 4,038 | 4,251 |
| Polymer, Gravity Belt Thickener | 442 | 402 |
| Polymer, Belt Filter Press | 550 | 658 |
| Alum, Tertiary Filters | 1 | 0 |

c. Monthly Utilities Consumption

| Utility | Current Month Statistics | Prior Month Statistics |
|--------------------------------|--------------------------|------------------------|
| Electricity WWTP, KWH | ** | 422070 |
| Electricity Lilac LS, KWH | ** | 888 |
| Electricity Sycamore LS, KWH | ** | 519 |
| Electricity Ayala LS, KWH | ** | 8000 |
| Electricity Agua Mansa LS, KWH | ** | 3936 |
| Electricity Cactus LS, KWH | 1719 | 1523 |
| Electricity Ramrod LS, KWH | 675 | 673 |
| Frisbee Park LS, KWH | ** | 818 |
| El Rancho Verde LS, KWH | 1880 | 1839 |
| Natural Gas WWTP, Therms | 6196 | 5647 |

* LS is in bypass mode, pending CIP completion

** SCE has not updated this account.

6. Odor Complaints Received/Actions Taken

No odor complaints were received this month.

7. Major Equipment and/or Machinery Outages

- Sludge Holding Tank
- Aeration Basin #1 is currently offline.
- Gravity Belt Thickener #1

8. Outside Agency Activities during the Month

- a. Government agency or property insurance inspections
None
- b. Government agency environmental, health, or safety tests/monitoring
Permit testing was completed for this month
- c. Government agency notices of violation received
No notices were received.
- d. Government agency monitoring
Routine monitoring reports were submitted.
- e. Other matters of concern
None

9. Customer Service Callout Details Log

| Date | Address | Comments | Personnel | Manhole | To Manhole |
|-----------|------------------|---|-----------|---------|------------|
| 2/10/2025 | 2440 N Beechwood | The resident called for a blocked lateral. The house was on a cul-de-sac, and the lateral was visible in a manhole. The sewer line was verified to be clear. The resident was informed to call public works for reference on resident lateral responsibility. | BVO | NA | NA |
| | | | | | |
| | | | | | |

Table 1 Summary

Table 1 Summary MOR

February 2025

| Date | Rialto | Rialto | | | Rialto | Rialto WRF Effluent | | | Rialto WRF Influent | | Rialto WRF Effluent | | |
|-----------|---------------------|---------------|--------------|--------------|-------------------|---------------------|-------------------|---------------|---------------------|-------------------|---------------------|-------------------|---------------|
| | Influent daily flow | Effluent Flow | Influent BOD | Influent BOD | Influent BOD Load | Effluent BOD | Effluent BOD Load | BOD % Removal | Influent TSS | Influent TSS Load | Effluent TSS | Effluent TSS Load | TSS % Removal |
| | MGD | MGD | mg/l | mg/l | lbs/day | mg/L | lbs/day | % | mg/L | lbs/day | mg/L | lbs/day | % |
| 2/1/2025 | 6.43 | 7.16 | | | | | | | | | | | |
| 2/2/2025 | 6.94 | 7.32 | | | | | | | | | | | |
| 2/3/2025 | 7.10 | 6.98 | 380 | 380 | 22,501 | 6.9 | 401.67 | 98.20 | 260.00 | 15396.00 | 0.70 | 41.00 | 99.70 |
| 2/4/2025 | 6.75 | 7.37 | | | | | | | | | | | |
| 2/5/2025 | 6.78 | 6.59 | | | | | | | | | | | |
| 2/6/2025 | 6.82 | 6.83 | | | | | | | | | | | |
| 2/7/2025 | 7.38 | 7.24 | 320 | 320 | 19,696 | 4.5 | 271.72 | 98.60 | | | | | |
| 2/8/2025 | 6.92 | 7.73 | | | | | | | | | | | |
| 2/9/2025 | 6.94 | 7.45 | | | | | | | | | | | |
| 2/10/2025 | 6.78 | 7.25 | 450 | 450 | 25,445 | 2.7 | 163.26 | 99.40 | 270.00 | 15267.00 | 0.90 | 54.00 | 99.70 |
| 2/11/2025 | 6.98 | 6.93 | | | | | | | | | | | |
| 2/12/2025 | 6.67 | 7.01 | | | | | | | | | | | |
| 2/13/2025 | 7.57 | 6.70 | | | | | | | | | | | |
| 2/14/2025 | 12.39 | 10.50 | 280 | 280 | 28,933 | <5.0 | 437.85 | 98.20 | | | | | |
| 2/15/2025 | 6.46 | 7.38 | | | | | | | | | | | |
| 2/16/2025 | 6.87 | 7.28 | | | | | | | | | | | |
| 2/17/2025 | 6.80 | 7.34 | | | | | | | | | | | |
| 2/18/2025 | 7.07 | 6.79 | 300 | 300 | 17,689 | 2.5 | 141.57 | 99.20 | 300.00 | 17689.00 | 1.00 | 57.00 | 99.70 |
| 2/19/2025 | 6.77 | 7.44 | | | | | | | | | | | |
| 2/20/2025 | 6.70 | 7.24 | | | | | | | | | | | |
| 2/21/2025 | 6.82 | 6.13 | 430 | 430 | 24,458 | 4.0 | 204.50 | 99.10 | | | | | |
| 2/22/2025 | 6.54 | 6.58 | | | | | | | | | | | |
| 2/23/2025 | 6.81 | 7.02 | | | | | | | | | | | |
| 2/24/2025 | 7.06 | 7.25 | 320 | 320 | 18,842 | 4.2 | 253.95 | 98.70 | 170.00 | 10010.00 | 0.80 | 48.00 | 99.50 |
| 2/25/2025 | 6.77 | 6.81 | | | | | | | | | | | |
| 2/26/2025 | 6.93 | 7.06 | | | | | | | | | | | |
| 2/27/2025 | 6.96 | 6.51 | | | | | | | | | | | |
| 2/28/2025 | 6.58 | 6.99 | 460 | 460 | 25,244 | 3.4 | 198.21 | 99.30 | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| Minimum | 6.43 | 6.13 | 280 | 280 | 17,689 | 2.5 | 141.57 | 98.20 | 170.00 | 10010.00 | 0.70 | 41.00 | 99.50 |
| Maximum | 12.39 | 10.50 | 460 | 460 | 28,933 | 6.9 | 437.85 | 99.40 | 300.00 | 17689.00 | 1.00 | 57.00 | 99.70 |
| Total | 197.59 | 200.88 | 2,940 | 2,940 | 182,808 | <33.2 | 2072.72 | 790.60 | 1000.00 | 58362.00 | 3.40 | 200.00 | 398.60 |
| Average | 7.06 | 7.17 | 368 | 368 | 22,851 | <4.2 | 259.09 | 98.80 | 250.00 | 14591.00 | 0.85 | 50.00 | 99.70 |

Table 2 Summary

Table 2 Summary MOR

February 2025

| Date | Rialto | Rialto WRF | Effluent | Rialto WRF | Eff | Rialto WRF | Effluent | Rialto | Rialto |
|-----------|-------------------------------|------------------------------------|---------------------|---------------------------|---------------------|----------------------------|----------------------|------------------------------------|---|
| | Influent Conductivity (uS/cm) | Eff Conductivity Daily Ave (uS/cm) | Influent COD (mg/l) | Final Effluent COD (mg/l) | Influent TDS (mg/l) | Filter Effluent TDS (mg/l) | EFF FINAL TDS (mg/L) | Influent Inorganic Nitrogen (mg/L) | Effluent Inorganic Nitrogen (mg/l as N) |
| 2/1/2025 | 1057.00 | 783.00 | | | | | | | |
| 2/2/2025 | 1345.00 | 787.00 | | | | | | | |
| 2/3/2025 | 1362.00 | 787.00 | | | | | | | |
| 2/4/2025 | 1325.00 | 794.00 | 750 | 20.0 | 510.00 | 420.00 | 470.00 | 42.00 | 11.00 |
| 2/5/2025 | 1264.00 | 788.00 | | | | | | | |
| 2/6/2025 | 1456.00 | 778.00 | | | | | | | |
| 2/7/2025 | 1184.00 | 755.00 | | | | | | | |
| 2/8/2025 | 1088.00 | 767.00 | | | | | | | |
| 2/9/2025 | 1328.00 | 797.00 | | | | | | | |
| 2/10/2025 | 1315.00 | 799.00 | | | | | | | |
| 2/11/2025 | 1341.00 | 798.00 | | | | | | | |
| 2/12/2025 | 1552.00 | 801.00 | | | | | | | |
| 2/13/2025 | 1051.00 | 767.00 | | | | | | | |
| 2/14/2025 | 995.00 | 642.00 | | | | | | | |
| 2/15/2025 | 1312.00 | 751.00 | | | | | | | |
| 2/16/2025 | 1348.00 | 834.00 | | | | | | | |
| 2/17/2025 | 1343.00 | 799.00 | | | | | | | |
| 2/18/2025 | 1349.00 | 778.00 | | | | | | | |
| 2/19/2025 | 1770.00 | 777.00 | | | | | | | |
| 2/20/2025 | 1306.00 | 777.00 | | | | | | | |
| 2/21/2025 | 1473.00 | 771.00 | | | | | | | |
| 2/22/2025 | 1269.00 | 796.00 | | | | | | | |
| 2/23/2025 | 1255.00 | 815.00 | | | | | | | |
| 2/24/2025 | 1590.00 | 797.00 | | | | | | | 7.40 |
| 2/25/2025 | 1411.00 | 785.00 | | | | | | | |
| 2/26/2025 | 1338.00 | 781.00 | | | | | | | |
| 2/27/2025 | 1409.00 | 787.00 | | | | | | | |
| 2/28/2025 | 1503.00 | 801.00 | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| Minimum | 995.00 | 642.00 | 750 | 20.0 | 510.00 | 420.00 | 470.00 | 42.00 | 7.40 |
| Maximum | 1770.00 | 834.00 | 750 | 20.0 | 510.00 | 420.00 | 470.00 | 42.00 | 11.00 |
| Average | 1334.00 | 782.00 | 750 | 20.0 | 510.00 | 420.00 | 470.00 | 42.00 | 9.20 |

Table 3 Summary

Table 3 Summary MOR


February 2025

| Date | Rialto WRF Influent | | Rialto WRF Effluent | | Rialto WRF Eff | | Rialto WRF Effluent | | Tranfer | Tranfer | Rialto | Tranfer Data |
|-----------|---------------------|---------------------|---------------------|------------------|-------------------------|--------------------------------|----------------------------------|---------------------------------------|----------------------|----------------------|-----------------------|----------------------|
| | Influent pH | 24 hr avg. effl. pH | Effluent Temp | Effluent Ammonia | Effluent Total Coliform | Effluent Coliform 7 Day Median | Effluent Cyanide, Free Available | Eff Di(2-ethylhexyl) phthalate (DEHP) | FIT-8321 ADG #2 Flow | FIT-8321 ADG #2 Flow | Natural Gas Daily Use | FIT-8321 ADG #2 Flow |
| | SU | SU | Deg C | mg/L | MPN/100mL | MPN/100ML | ug/L | ug/l | cu ft/day | cu ft/day | cf/day | cu ft/day |
| 2/1/2025 | 7.75 | 7.21 | 20.90 | | <1.8 | <1.80 | | | 135111.00 | 135111.00 | 21500.00 | 135111.00 |
| 2/2/2025 | 7.72 | 7.11 | 21.20 | | <1.8 | <1.80 | | | 143180.00 | 143180.00 | 20500.00 | 143180.00 |
| 2/3/2025 | 7.76 | 7.19 | 21.60 | 0.06 | <1.8 | <1.80 | | | 155115.00 | 155115.00 | 20400.00 | 155115.00 |
| 2/4/2025 | 7.42 | 6.95 | 21.70 | | <1.8 | <1.80 | | <5.00 | 145716.00 | 145716.00 | 1000.00 | 145716.00 |
| 2/5/2025 | 7.46 | 6.94 | 21.50 | | <1.8 | <1.80 | | | 168512.00 | 168512.00 | 20800.00 | 168512.00 |
| 2/6/2025 | 7.36 | 6.95 | 21.20 | | <1.8 | <1.80 | | | 112150.00 | 112150.00 | 21000.00 | 112150.00 |
| 2/7/2025 | 7.51 | 6.94 | 21.30 | | <1.8 | <1.80 | | | 146595.00 | 146595.00 | 21200.00 | 146595.00 |
| 2/8/2025 | 7.74 | 7.00 | 20.50 | | <1.8 | <1.80 | | | 150218.00 | 150218.00 | 20900.00 | 150218.00 |
| 2/9/2025 | 7.79 | 6.88 | 20.50 | | <1.8 | <1.80 | | | 145605.00 | 145605.00 | 21400.00 | 145605.00 |
| 2/10/2025 | 7.75 | 6.99 | 20.70 | 0.05 | <1.8 | <1.80 | | | 148828.00 | 148828.00 | 20900.00 | 148828.00 |
| 2/11/2025 | 7.65 | 7.13 | 20.80 | | <1.8 | <1.80 | | | 147721.00 | 147721.00 | 20700.00 | 147721.00 |
| 2/12/2025 | 7.12 | 7.25 | 20.70 | | <1.8 | <1.80 | | | 141899.00 | 141899.00 | 22600.00 | 141899.00 |
| 2/13/2025 | 7.21 | 7.18 | 20.80 | | <1.8 | <1.80 | | | 166981.00 | 166981.00 | 21300.00 | 166981.00 |
| 2/14/2025 | 7.11 | 7.20 | 19.30 | | <1.8 | <1.80 | | | 135669.00 | 135669.00 | 25000.00 | 135669.00 |
| 2/15/2025 | 7.80 | 7.26 | 19.30 | | <1.8 | <1.80 | | | 132715.00 | 132715.00 | 19500.00 | 132715.00 |
| 2/16/2025 | 7.75 | 7.32 | 19.90 | | 2.0 | <1.80 | | | 130940.00 | 130940.00 | 19000.00 | 130940.00 |
| 2/17/2025 | 7.76 | 7.34 | 20.20 | | <1.8 | <1.80 | | | 142649.00 | 142649.00 | 20900.00 | 142649.00 |
| 2/18/2025 | 7.38 | 7.36 | 20.70 | <0.10 | 2.0 | <1.80 | | | 150479.00 | 150479.00 | 21000.00 | 150479.00 |
| 2/19/2025 | 7.33 | 7.34 | 20.70 | | <1.8 | <1.80 | | | 145764.00 | 145764.00 | 22000.00 | 145764.00 |
| 2/20/2025 | 7.69 | 7.34 | 20.80 | | <1.8 | <1.80 | | | 168252.00 | 168252.00 | 20200.00 | 168252.00 |
| 2/21/2025 | 7.13 | 7.33 | 20.40 | | <1.8 | <1.80 | | | 152449.00 | 152449.00 | 21600.00 | 152449.00 |
| 2/22/2025 | 7.21 | 7.29 | 20.10 | | 2.0 | <1.80 | | | 131568.00 | 131568.00 | 21600.00 | 131568.00 |
| 2/23/2025 | 7.64 | 7.35 | 20.70 | | 2.0 | <1.80 | | | 137398.00 | 137398.00 | 1400.00 | 137398.00 |
| 2/24/2025 | 7.65 | 7.45 | 21.10 | <0.10 | <1.8 | <1.80 | | | 132583.00 | 132583.00 | 15100.00 | 132583.00 |
| 2/25/2025 | 7.34 | 7.31 | 21.30 | | 4.0 | <1.80 | | | 147663.00 | 147663.00 | 21200.00 | 147663.00 |
| 2/26/2025 | 7.69 | 7.04 | 21.50 | | <1.8 | <1.80 | | | 161146.00 | 161146.00 | 22500.00 | 161146.00 |
| 2/27/2025 | 7.60 | 7.11 | 21.30 | | <1.8 | <1.80 | | | 143728.00 | 143728.00 | 21700.00 | 143728.00 |
| 2/28/2025 | 7.61 | 7.34 | 21.00 | | <1.8 | <1.80 | | | 164757.00 | 164757.00 | 19500.00 | 164757.00 |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| Minimum | 7.11 | 6.88 | 19.30 | 0.05 | <1.8 | <1.80 | | <5.00 | 112150.00 | 112150.00 | 1000.00 | 112150.00 |
| Maximum | 7.80 | 7.45 | 21.70 | <0.10 | 4.0 | <1.80 | | <5.00 | 168512.00 | 168512.00 | 25000.00 | 168512.00 |
| Average | 7.53 | 7.18 | 20.80 | <0.08 | <1.9 | <1.80 | | <5.00 | 145907.00 | 145907.00 | 19514.00 | 145907.00 |

Monthly Sewer Line Cleaned

Pipe Cleaning - February 2025

Map Centre Coords
x: 2059487, y: 566307
Date Printed: 3/19/2025
Scale 1:140000

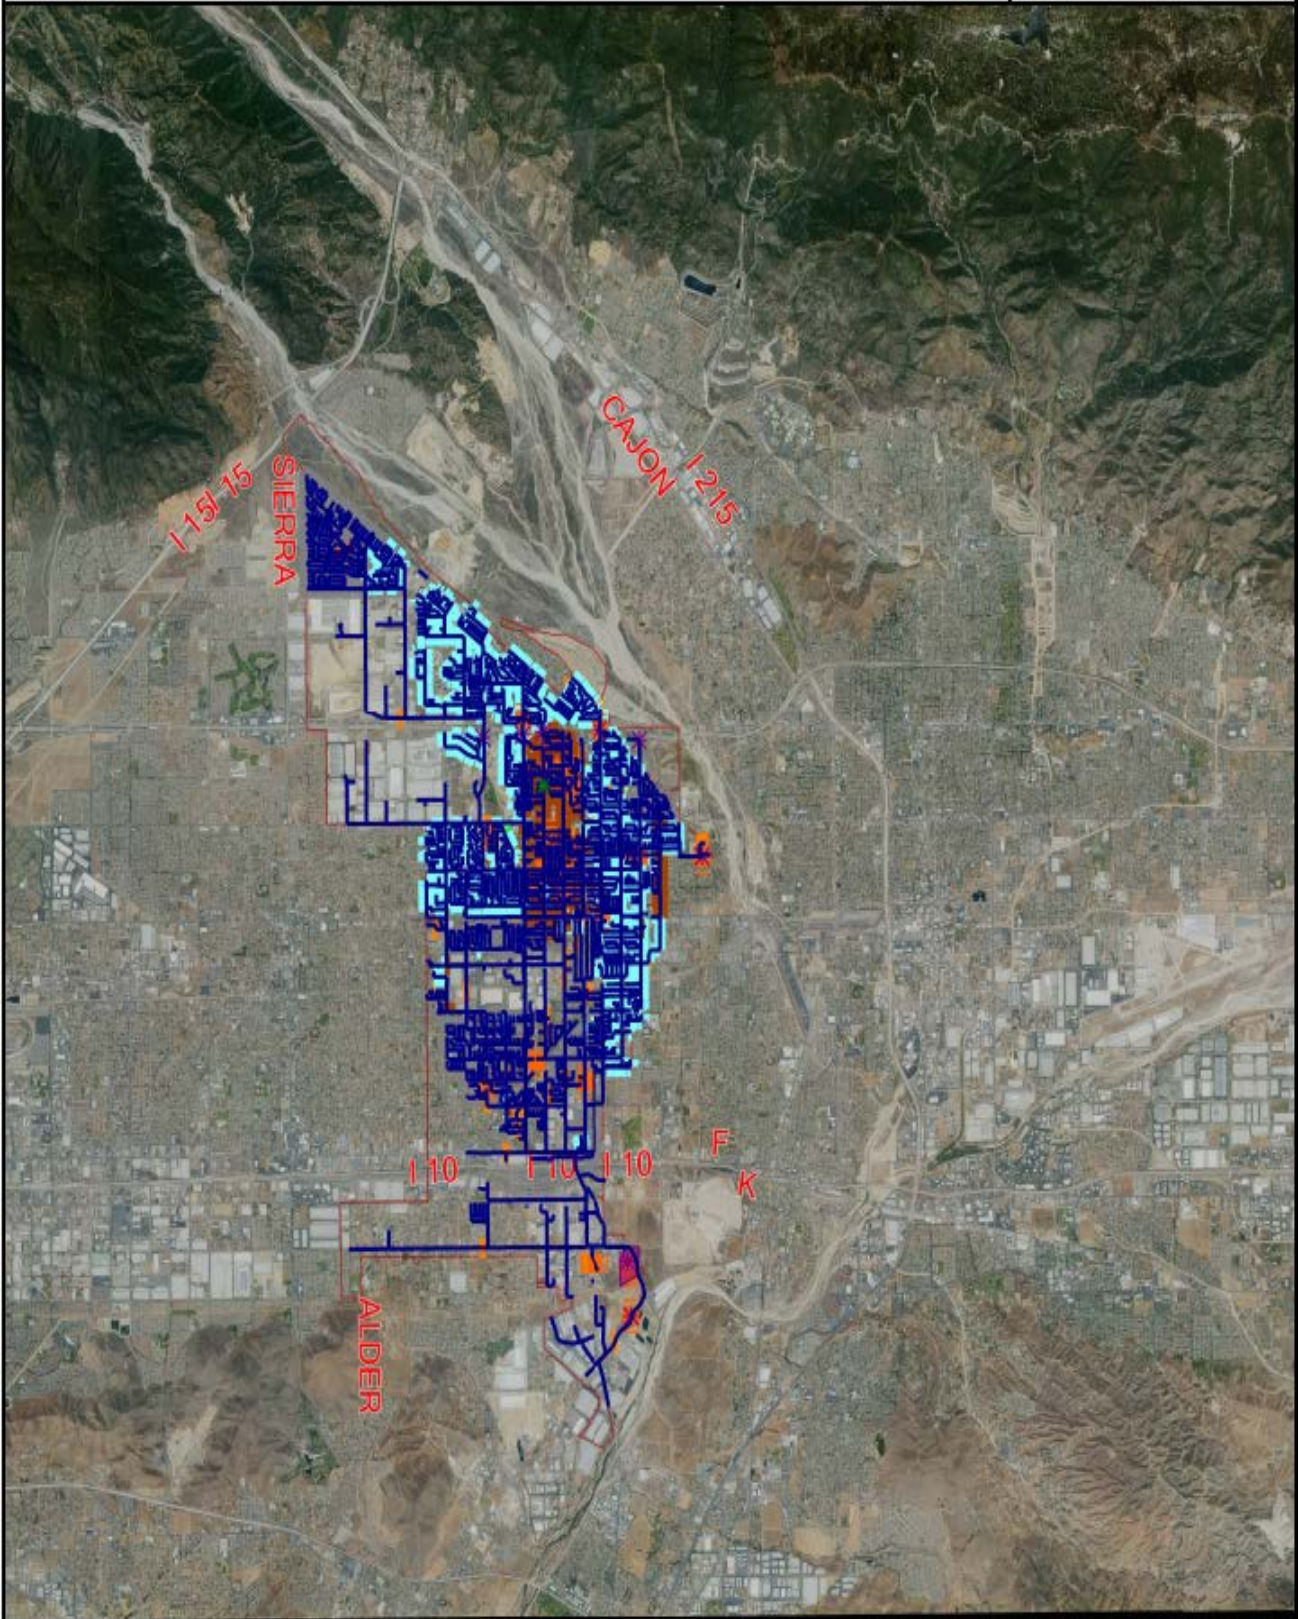

FIP-CIP Updates for March - 2025

1.. Rialto Solids Upgrade study: Basis of Design Report was finalized, reviewed and accepted by the City and Veolia. NTP on proceeding with 30% design provided to AECOM on 9/22/2023. AECOM is working on 30% design. Field visit completed on 11/15/2023 and 11/16/2023. 30% design will be completed by February 16, 2024. 30% design documents submitted by AECOM on February 16, 2024. This was shared with the City on 3/15/2024 after Veolia's internal reviews. 30% design review Page turn and in the field site visit with Stakeholders on 4/10/24 and in person (at WWTP) 4/19/24. Solids Handling 30% estimate developed and shared with RWS on 5/9/2024. June 2024: NTP provided to AECOM for the 60% design, GMP prep and Shop Drawings prep given at the end of May (ongoing). 60% design drawings are anticipated by 9/30/2024. Added design work change order in development for AECOM's added design efforts for the Centrifuge layout which was changed after the 30% and 60% design to reduce construction costs while optimizing project value and addressing other O&M concerns we raised during the reviews. 60% page turn completed with the City's consultant & City. Shared project cost pricing from AECOM-W.M. Lyles with the City. Awaiting direction on next steps. AECOM-W.M. Lyles continue working on the 100% design and the Guaranteed Maximum Price. A meeting with Stakeholders to vet the GMP - to be set up by Peter Luchetti in February. Veolia drafting a FCWA for review/approval. Veolia and Peter Luchetti are trying to set up a meeting to pick up the project before the GMP expires. [4/08/2025 - GMP review was held 4/07/2025. This project is scheduled for the Rialto Utility Authority meeting in May and then City Council on June 6/10/2025.](#)

2. Digester 1 Activation: AECOM is reviewing the options proposed by DN Tanks and will include their recommendation and cost for the appropriate cover in the GMP for the Solids Handling design. This work will be completed after Solids Handling project design is complete. [4/08/2025 - Work will be completed after solids Handling Project Completion](#)

3. Sycamore Sewer Trunk Line Project (Phase II): Design is complete and RFP documents sent to City (Tom) for review 8/15/23. The project needs to be completed during summer as it passes through a school zone and in order to get Sycamore Sewer Lift Station back online fully. [4/08/2025 - Funding has been identified. Veolia and the City of Rialto will coordinate next steps for the project.](#)

4. Acacia Sewer Trunk Line Project (Phase III): Design is underway and RFP documents are being updated. Funding needs to be identified. Design will be completed after funding is identified. [4/08/2025 - Funding has been identified. Veolia and the City of Rialto will coordinate next steps for the project.](#)

5. Etiwanda Ave Water Improvement Project: Water line improvements from Riverside Ave to Eucalyptus Ave. The project is in design and will have a design review once ready. [4/08/2025 - Funding has been identified. Veolia and the City of Rialto will coordinate next steps for the project.](#)

6. Safe Routes to Schools: SRTS is a project that includes the relocation of 6 fire hydrants at specified areas. 100% plans were submitted to Veolia on 10/07/2024. Plans have been reviewed and the contractor bid process is ongoing. The Merrill SRTS project is 95% complete with only concrete pads for hydrants remaining. This work is expected to take place in conjunction with the city's concrete contractor. The city contractor has poured sidewalks and plans, depending on weather conditions to pour hydrant pads the week of 3/17/2025. This will finish the conditions of the FCWA. The first progress invoice has been submitted to the City for payment. [4/08/25 - Weather caused more delays and the contractor is doing contract work that is time permitting to not interrupt residents' access to property and street. A schedule request has been sent to CJINC. \(City Contractor\) to coordinate and complete the necessary work. Per CJINC. Pads for the hydrants may be poured on the week of \(4/7-4/11/2025\) A final invoice to follow once the pads are poured, inspected, and punchlist is completed.](#)

7. City Well 3A (Phase 1): The first phase would include a pre/post video log of the well, bail and brush, a 60 hour development test that includes a 12hr step test at a 10 day constant pump rate, and a Dept. of Drinking Water required Title 22 sampling panel with the addition of PFOA/PFAS panel. This project is in the early stage and a FCWA is to be submitted to the city mid March. The Veolia team are finalizing the risk assessment and FCWA before submitting to the City. [4/08/2025 - The FCWA for phase 1 was submitted to the City on 3/25/2025 for approval. City agreed to move forward with presenting this project to the City Council and on April 22nd, 2025.](#)



City of Rialto

Legislation Text

File #: UC-25-0281, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting April 15, 2025

TO: Honorable Chairperson and Commission

APPROVAL: John Rossi, Interim Utilities Director

FROM: Nicole Hemmans, Senior Administrative Analyst

Previous Discussion Update

BACKGROUND

No previous discussion items.



City of Rialto

Legislation Text

File #: UC-25-0280, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting April 15, 2025

TO: Honorable Chairperson and Commission

APPROVAL: John Rossi, Interim Utilities Director

FROM: Nicole Hemmans, Senior Administrative Analyst

To-Do List

Future Agenda Items: NONE



City of Rialto

Legislation Text

File #: UC-25-0282, **Version:** 1, **Agenda #:**

For Utilities Commission Meeting April 15, 2025

TO: Honorable Chairperson and Commission

APPROVAL: John Rossi, Interim Utilities Director

Utilities Director Update:

- 1) Final Construction Work Authorization (FCWA) for Well City3A
- 2) RFP for Rate Consultant