


MATCHLINE - SEE BELOW LEFT



MATCHLINE - SEE ABOVE RIGHT

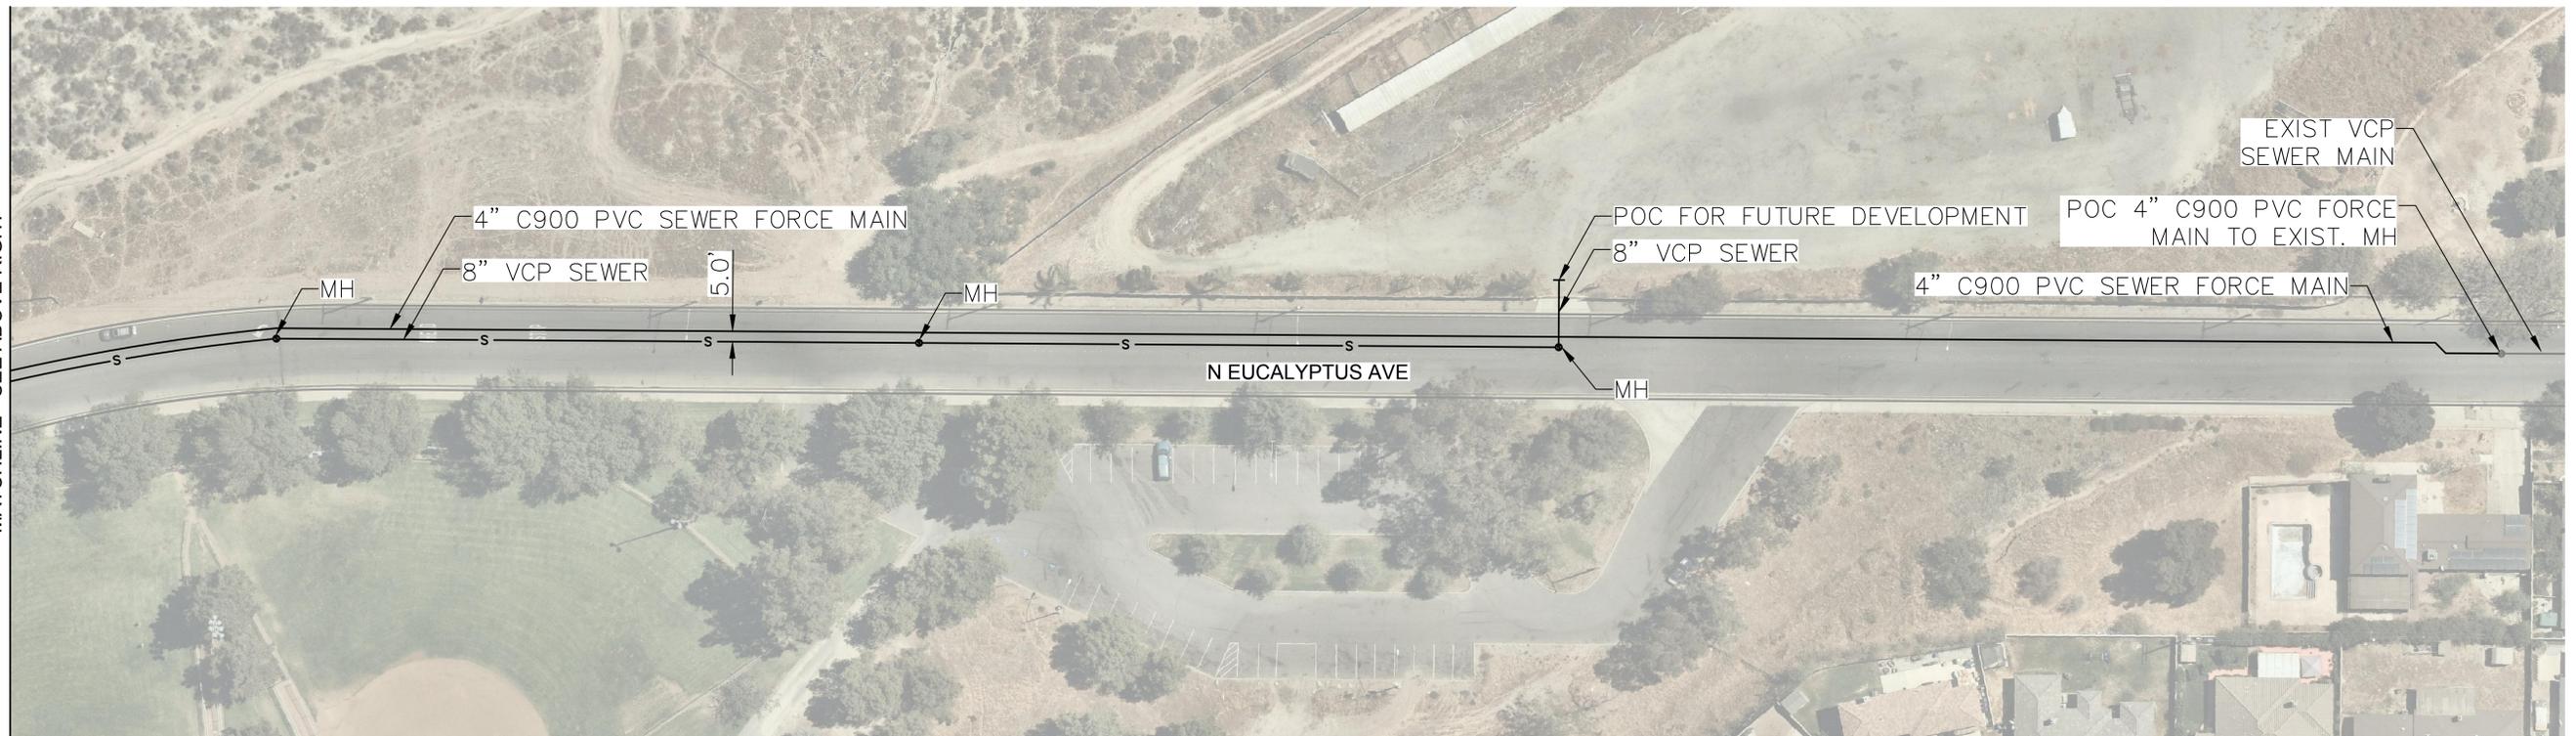

Plotted By: Miller, Morgan; Sheet Set: THIRTIETH AYALA ONSITE Layout.L1; March 07, 2019 02:16:03pm; K:\SND_WATER\05637008_Frisbie Park Lift Station\Design\Exhibits\2019.02.11 - Site Visit\2019.02.11 - Site Visit.dwg

UNDERGROUND SERVICE ALERT



MARK	REVISIONS	APPR.	DATE

DESIGNED BY: SM DRAWN BY: MM CHECKED BY: MA




PREPARED UNDER THE SUPERVISION OF:
 SAMUEL LAKE MCWHORTER, RCE 61788 DATE _____
 RECOMMENDED FOR APPROVAL BY LOCKWOOD ENGINEERING:
 CARLETON W. LOCKWOOD, JR., RCE 45935 DATE _____
 ROBERT G. EISENBEISZ, PUBLIC WORKS DIRECTOR/CITY ENGINEER, RCE 54931 DATE _____

Kimley»Horn
 401 B Street, Suite 600, San Diego, CA 92101
 Phone: (619) 234-9411
 WWW.KIMLEY-HORN.COM





CITY OF RIALTO
 FRISBIE PARK SEWER LIFT STATION
 CONCEPTUAL LAYOUT PLAN
 FOR: CITY OF RIALTO
 PLAN No. _____

FIGURE 1.1

Plotted By: Miller, Morgan; Sheet Set: THIRTIETH AYALA ONSITE; Layout: L2; March 07, 2019 02:16:11pm; K:\SAND_WATER\056937088 Frisbie Park Lift Station\Design\Exhibits\2019.02.11 - Site Visit.dwg

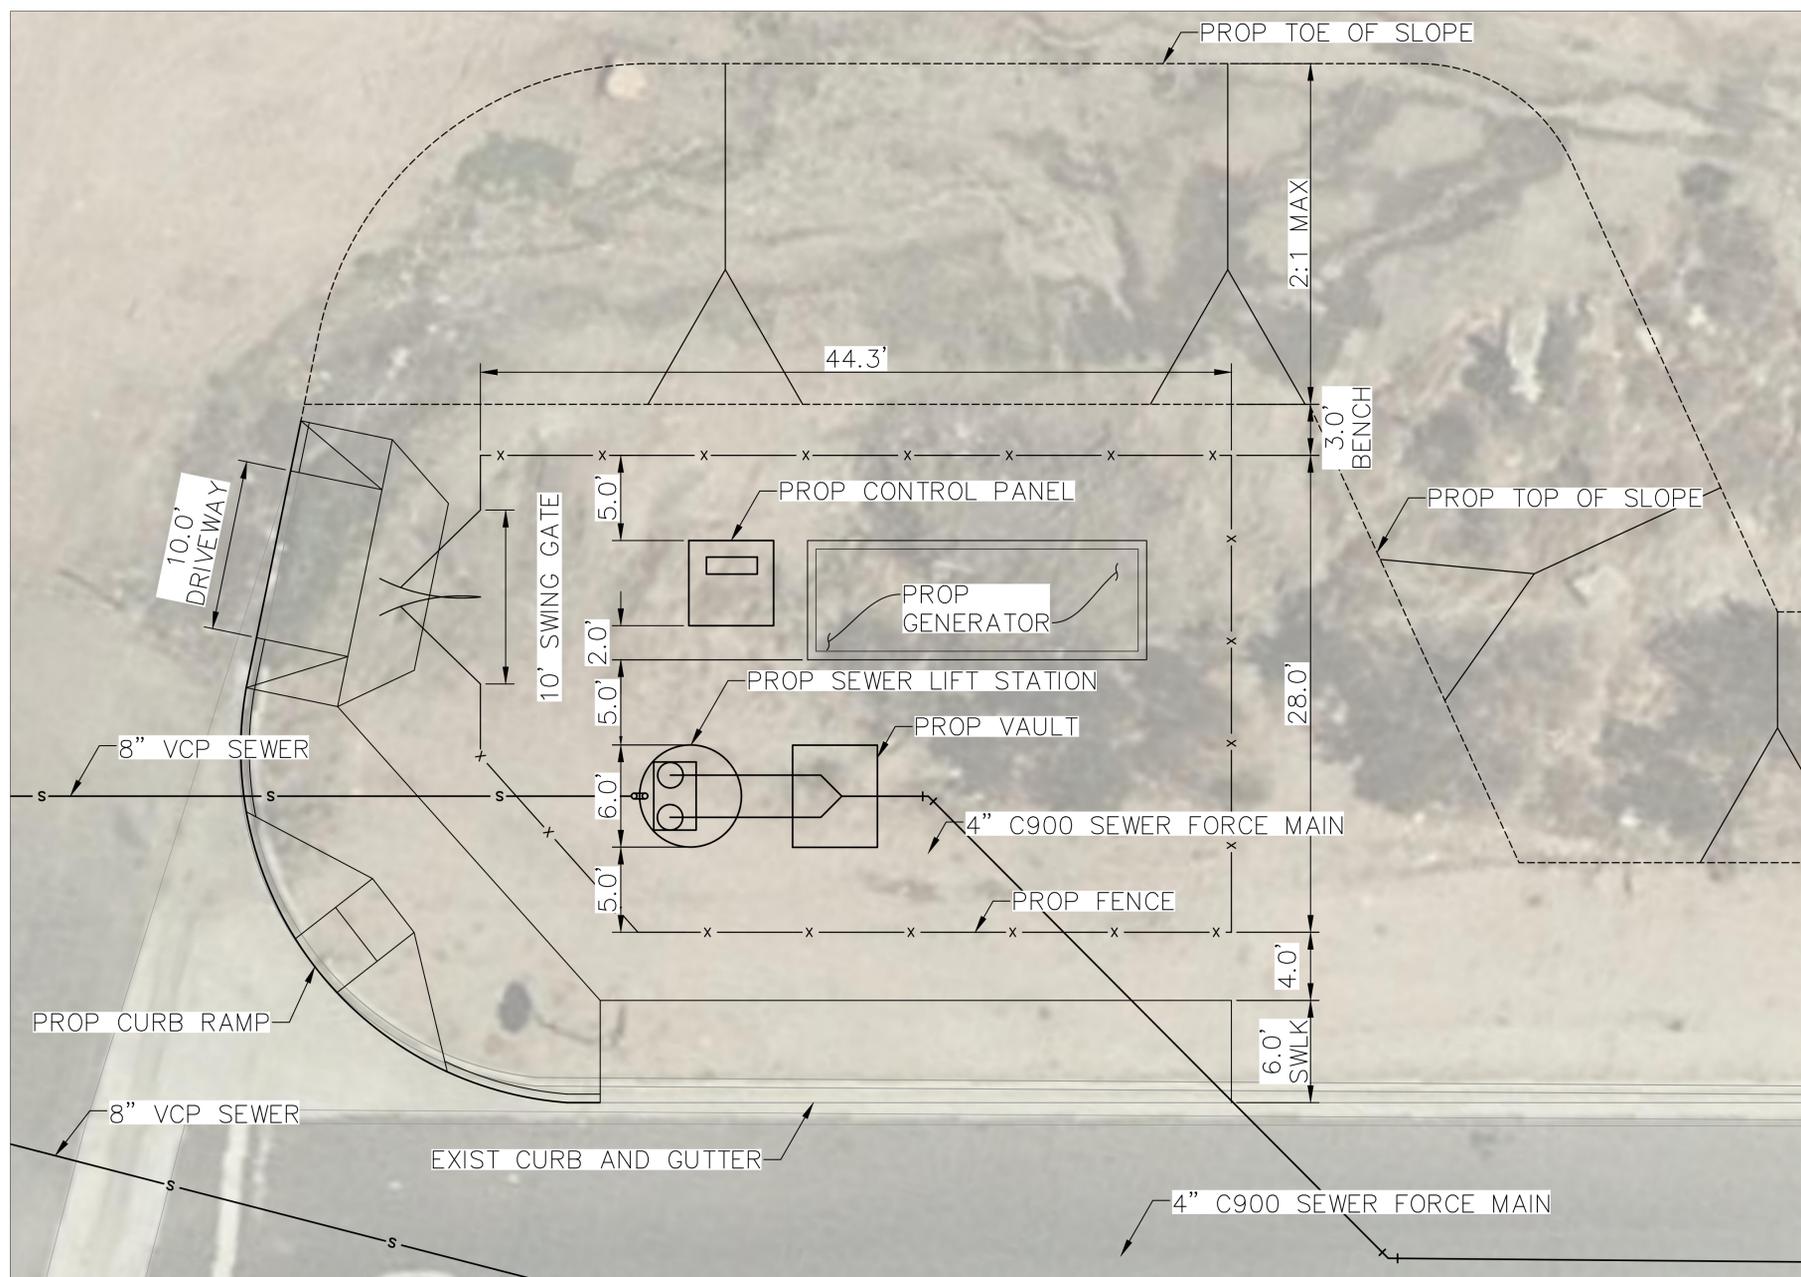

DETAIL A
 HORZ: 1"=5'

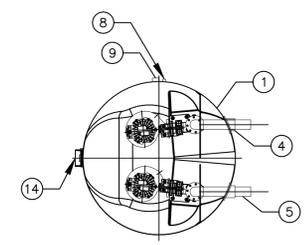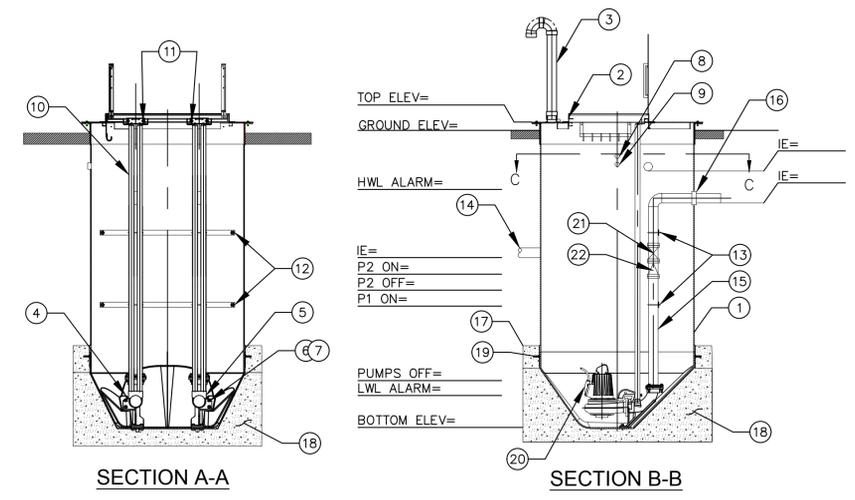

DETAIL B - INFLUENT SEWER LIFT STATION

- CONSTRUCTION NOTES**
- ① BASIN CYLINDER ASSEMBLY, 6' DIAMETER
 - ② COVER, 6' DIAMETER WITH HATCH AND FALL PROTECTION GRATE
 - ③ VENT PIPE 4" - GOOSE NECK STYLE
 - ④ DISCHARGE CONNECTION, LEFT, 4"
 - ⑤ DISCHARGE CONNECTION, RIGHT, 4"
 - ⑥ NUT, 3/4 -10, 316 SST
 - ⑦ WASHER, 1 1/2 ID, 1 1/2 OD, GENERAL PURPOSE, 316 SST
 - ⑧ SEAL CABLE WALL, LEVEL SENSOR
 - ⑨ SEAL CABLE WALL, PUMP POWER
 - ⑩ GUIDE BAR, 2", 316 SST
 - ⑪ UPPER GUIDE BAR KIT, 2"
 - ⑫ BRACING, DISCHARGE PIPE
 - ⑬ U-BOLT PER MANUFACTURER
 - ⑭ 8" PIPE CONNECTION-INFLUENT
 - ⑮ PIPE, 4" SCH. 10, 316 STAINLESS STEEL
 - ⑯ PIPING KIT
 - ⑰ CONCRETE BALLAST RING PER MFR RECOMMENDATIONS
 - ⑱ FOUNDATION PREP PER MFR RECOMMENDATIONS AND GEOTECH REPORT
 - ⑲ ANTI-FLOTATION FLANGE
 - ⑳ 2 FLYGT NON-CLOG SUBMERSIBLE PUMPS Q=XX GPM AT XX' TDH EACH PUMP, NPXX SHX X HP, 3 PHASE 460V XX RPM
 - ㉑ 4" GATE VALVE
 - ㉒ 4" CHECK VALVE

UNDERGROUND SERVICE ALERT

CALL-TOLL FREE
 1-800-227-2600

TWO WORKING DAYS BEFORE YOU DIG

MARK	REVISIONS	APPR.	DATE

DESIGNED BY: SM DRAWN BY: MM CHECKED BY: MA

SEAL-DESIGN ENGINEER

PREPARED UNDER THE SUPERVISION OF:

SAMUEL LAKE MCWHORTER, RCE 61788 DATE _____

RECOMMENDED FOR APPROVAL BY LOCKWOOD ENGINEERING:

CARLETON W. LOCKWOOD, JR., RCE 45935 DATE _____

ROBERT G. EISENBEISZ, PUBLIC WORKS DIRECTOR/CITY ENGINEER, RCE 54931 DATE _____

Kimley»Horn

401 B Street, Suite 600, San Diego, CA 92101
 Phone: (619) 234-9411
 WWW.KIMLEY-HORN.COM

CITY OF RIALTO
 FRISBIE PARK SEWER LIFT STATION

FIGURE 1.2

DETAILS

FOR: CITY OF RIALTO

PLAN No. _____