

Cable Advisory & Utility Commission Report

October 2025

Reporting period August 2025



RIALTO
CUSTOMER SERVICE & REVENUE
MONTHLY OPERATIONS REPORT

Reporting Period:

August 2025

Prepared for: Rialto Water Services

Prepared by: Veolia Water West Operating Services



Table of Contents

I. CUSTOMER SERVICE SUMMARY.....	3
II. CALL CENTER PERFORMANCE.....	3
III. AUTOMATED SERVICES.....	3
IV. CONSUMPTION & BILLING.....	4
A. Consumption.....	4
B. Billing.....	4
V. REVENUE & AGING.....	5
A. Revenue	5
B. Aging	6
C. Bad Debt.....	6
VI. SERVICE ORDERS	7
VII. OTHER ACTIVITIES	7
VIII. REVENUE REPORT	7
A. Revenue Summary.....	7
B. Non Rate Revenue - Extraterritorial Customers.....	7
C. Non-Rate Revenue – Other	8
D. Development Impact Fees.....	8
E. Rialto Basin Water Rights and Leasing	8
F. Payment Collection Method – Fiscal Year to Date.....	10
G. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison.....	10
H. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison	10
I. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date.....	11
J. Increase in Cash Collections and Fund Distribution—Prior Year Comparison	11
K. Non-Rate and Extraterritorial Customer Accounts Receivable Aging	12

I. CUSTOMER SERVICE SUMMARY


During this reporting month, the Customer Service team provided call service level of 80.1%. Out of 1,294 inbound calls answered 1,043 answered within the first 30 seconds.

Water consumption has increased by 33.2% when compared against previous month. When compared against last year, consumption has increased 19.2%. This increase is attributed to one additional week between the meter reads.

Sewer revenue has increased 4.0% compared to the prior month and increased by 7.6% from last year.

II. CALL CENTER PERFORMANCE

During this reporting month, service level was 80.1% with 1,043 out of 1,294 being answered within the first 30 seconds. Overall average wait time was sixty-three (63) seconds. Increase in average wait time is due to 2 representatives out on disability. A temporary employee was hired in May, but left the position without any notification in August. We are expecting one of the representatives to return in September.

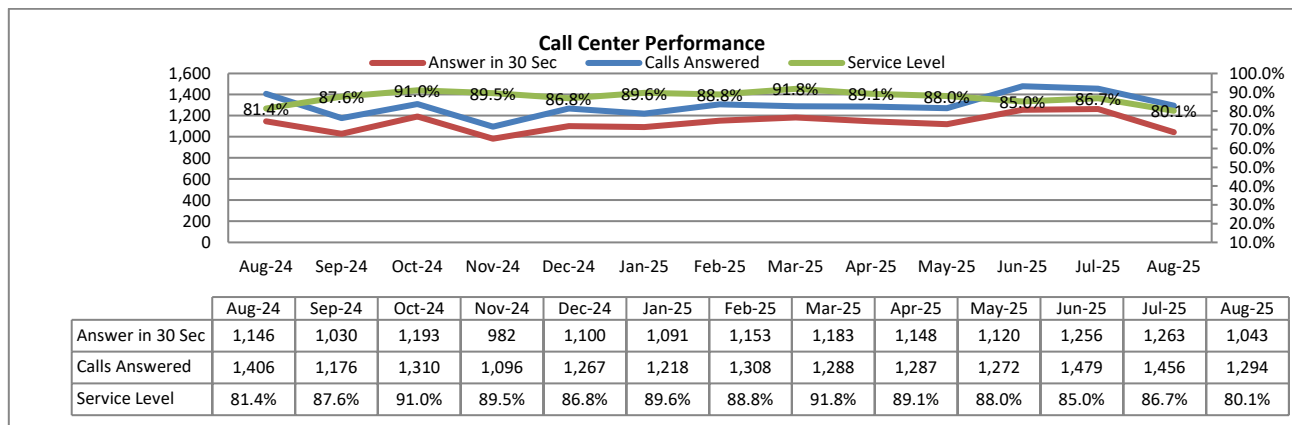

III. AUTOMATED SERVICES



About 12781 or 55.9% of the rate payers have created log-ins to access their accounts online. Of these customers, with online access, 48.3% have chosen the e-bill option. This e-bill participation is 7.2% increase from August of the prior year.

	Aug-24	Sep-24	Oct-24	Nov-24	Dec-24	Jan-25	Feb-25	Mar-25	Apr-25	May-25	Jun-25	Jul-25	Aug-25
Number of Bills	22,425	22,470	22,541	22,571	22,575	22,587	22,604	22,657	22,694	22,705	22,770	22,792	22,838
Number of Bill Adjustments (during billing)	9	5	11	9	29	17	10	29	25	15	18	29	10
Automated Over the Phone Payments	2,310	2,050	2,483	2,092	2,436	2,509	2,040	2,509	2,454	2,276	2,578	2,596	2,344
Online Payment	9,302	7,538	9,302	7,804	10,320	9,747	7,676	9,912	9,798	8,434	9,800	10,260	8,691
E-bill Participants	5,770	5,814	5,855	5,922	5,959	5,997	6,031	6,069	5,969	6,000	6,074	6,134	6,185
Auto Pay Participants (New Portal)	4,273	4,278	4,305	4,343	4,367	4,420	4,467	4,536	4,554	4,630	4,696	4,728	4,776
PayNearMe	118	92	95	93	95	108	73	99	97	88	88	88	88

IV. CONSUMPTION & BILLING

A. Consumption

Water consumption has increased by 33.2% when compared against previous month. When compared against last year, consumption has increased less than 19.2%. This increase is attributed to one additional week between the meter reads.

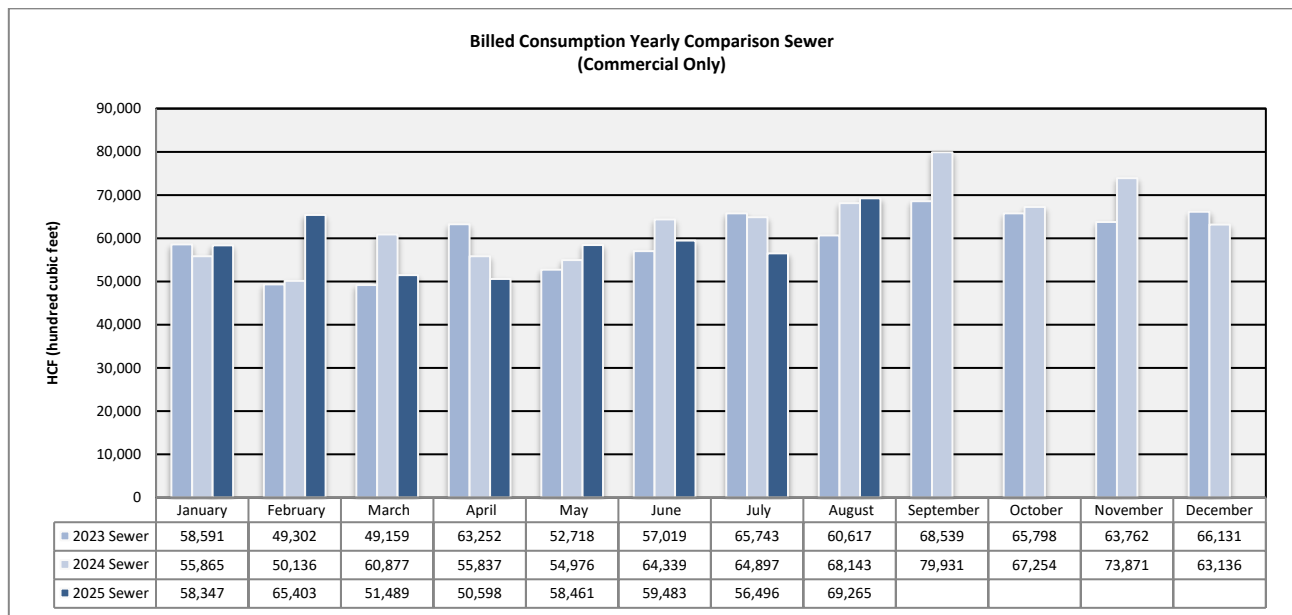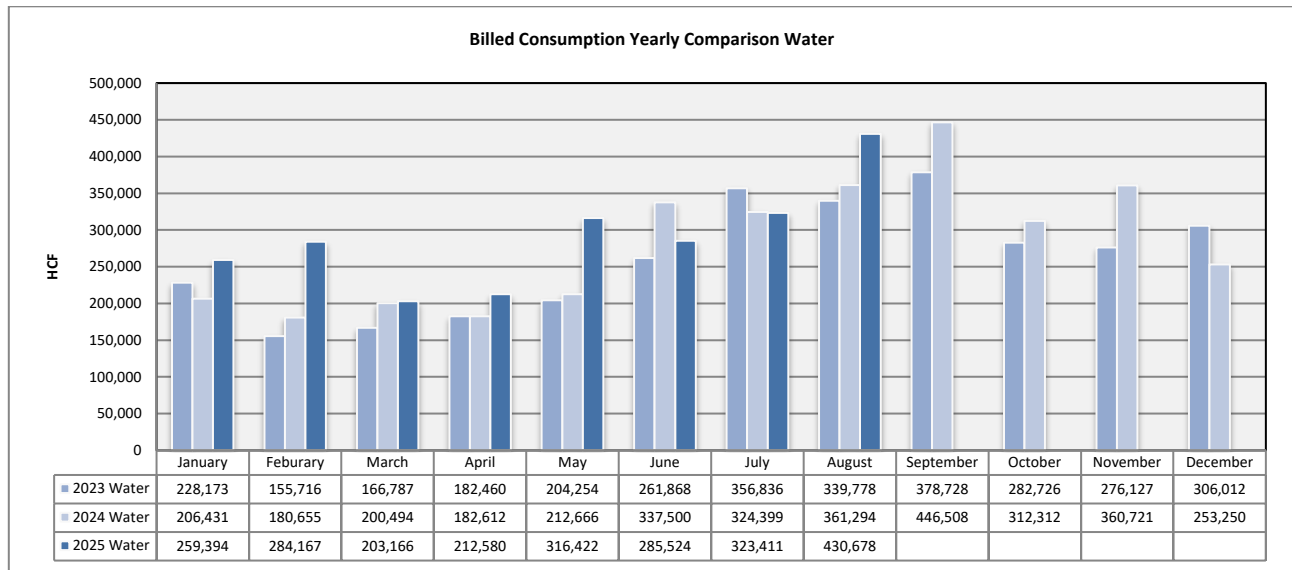


B. Billing

A total of 22,838 bills were mailed or sent out electronically in August. Billing accuracy was 99.9% with ten (10) requiring adjustments after bill generation.


V. REVENUE & AGING

A. Revenue

Water revenue has increased 19.5% when compared against the prior month and increased 25.6% when compared against previous year. Sewer revenue has increased 4.0% compared to the prior month and increased by 7.6% from last year. Increase of revenue in 2025 versus 2024 is due to rate modifications in January.


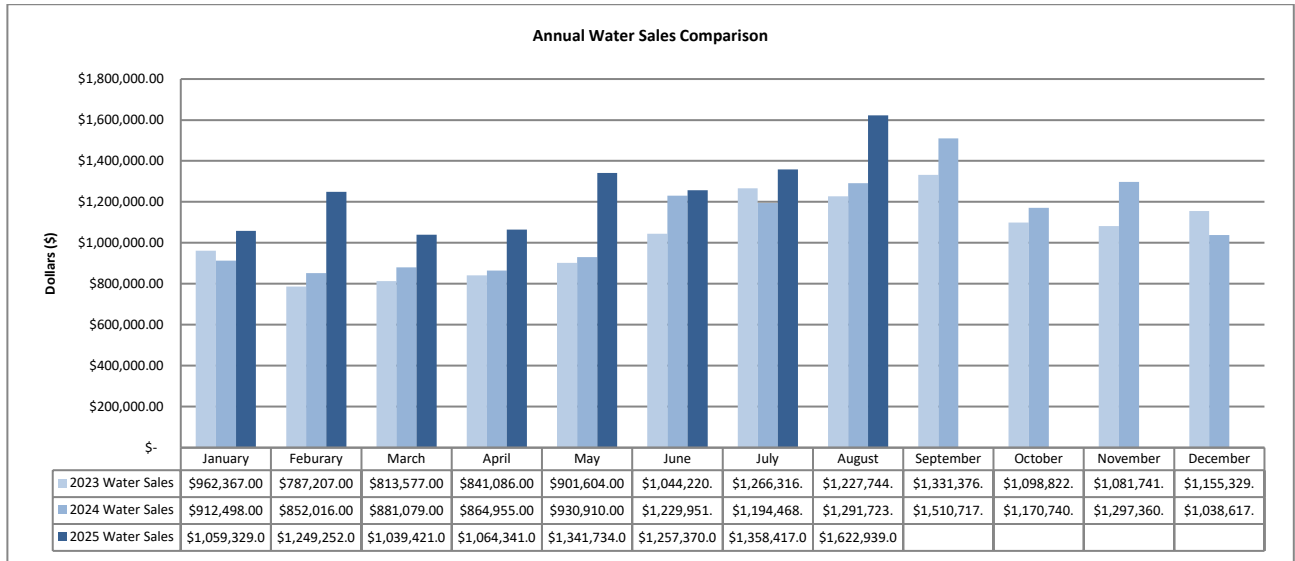


(Please consider the scale of the graph as doubled height does not mean double the amount)

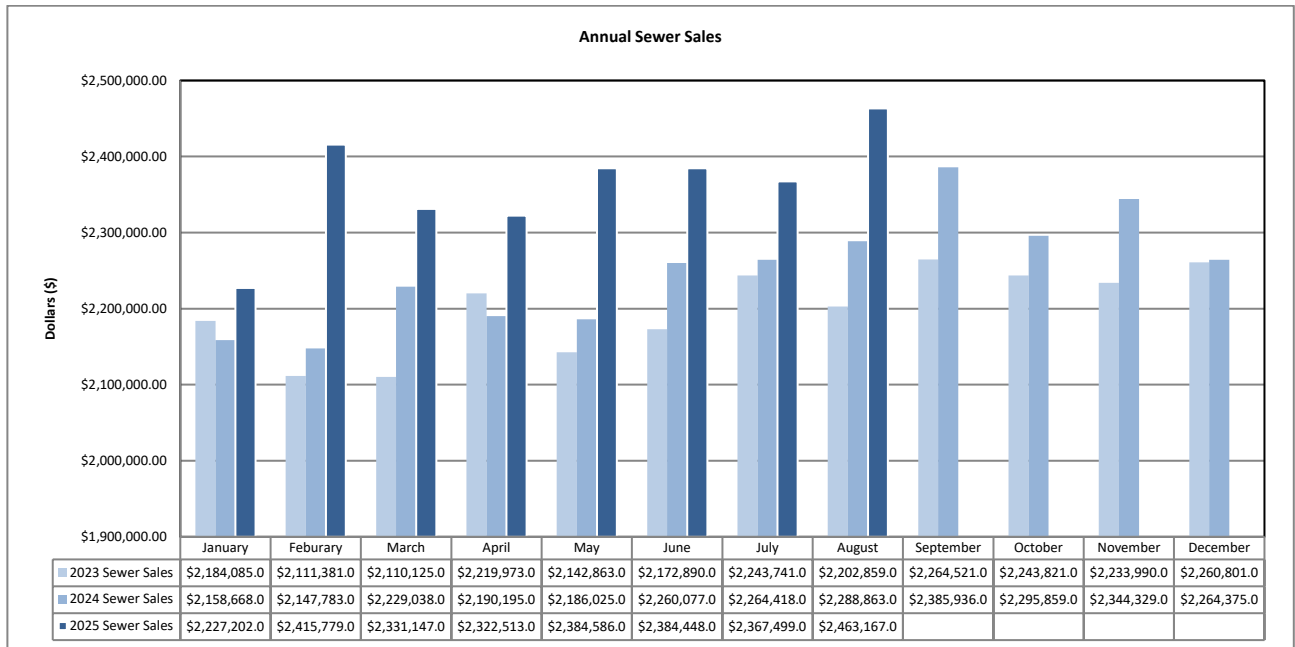

B. Aging

The total aging balance has increased by 30.9%, *see first table below*. For balances >30-days only, water has increased 18.2% and wastewater has increased by 25.7%.

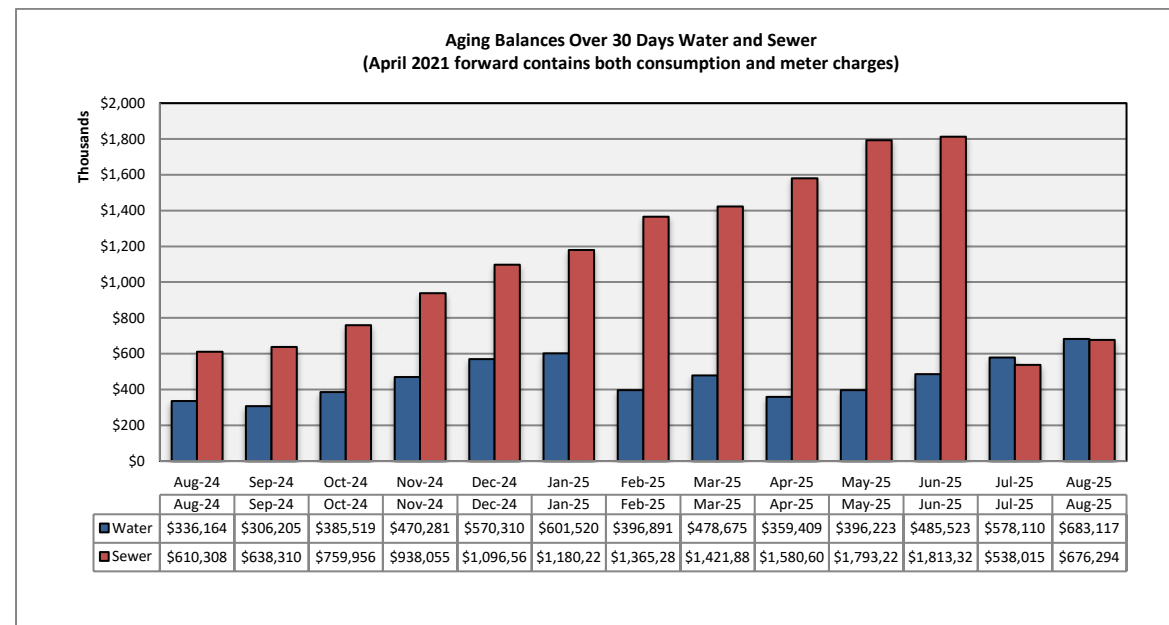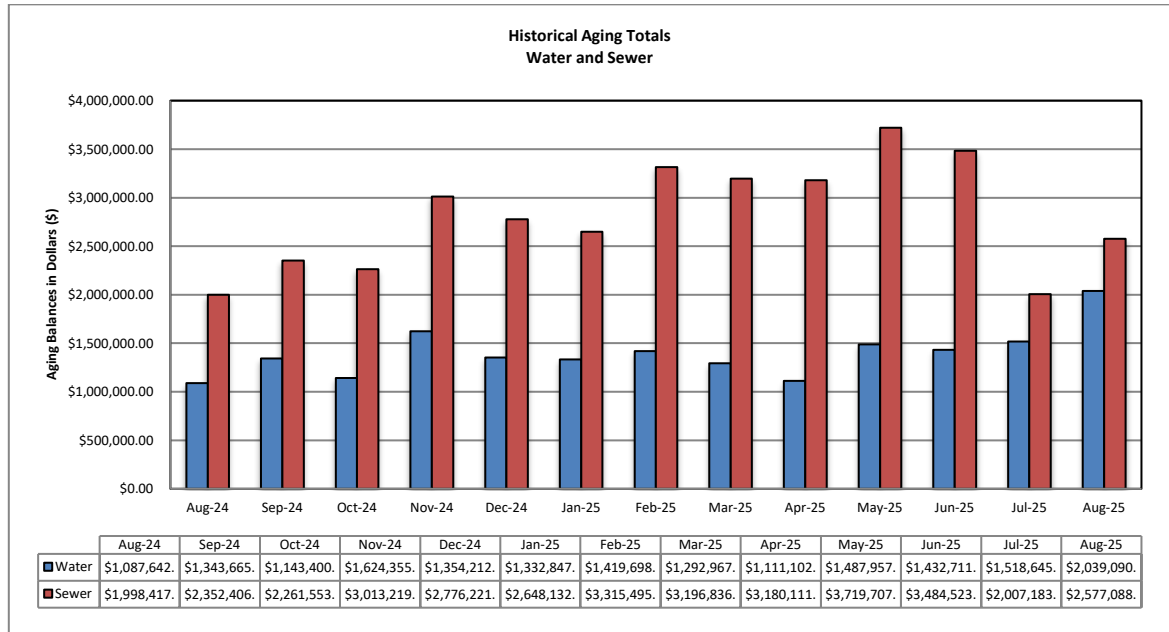

C. Bad Debt

Twenty-eight (28) accounts were sent to collections for a total amount of \$7,181.99. These bad debts arise from customers moving out or selling the property and not closing the account with final payments.

VI. SERVICE ORDERS

358 service orders were initiated by the customer service team during the reporting month. Of this total, 96 service orders or 26.8% were due to occupant changes.

199 service orders were initiated to accommodate water disconnection for non-payment and reconnection of water services when customer set up (or reinstate) a payment arrangement with down payment.

VII. OTHER ACTIVITIES

Two (2) CS team members are currently out on disability. One is expected to return in September. Another is expected to return at the end of October.

VIII. REVENUE REPORT

A. Revenue Summary

Cash Revenue is compiled and reconciled to the merchant account on a daily basis. Cash receipts and deposits are made daily and internal controls are reviewed regularly to ensure safeguarding of assets and proper recording of all transactions. Total revenue collected in August 2025 is \$3,364,000 whereas Non-Rate Revenue is \$48,000; Utility Revenue is \$3,264,000 and Tax / Ambulance Revenue at \$52,000.

RWS collects Utility User Taxes and Ambulance Fees on behalf of the City of Rialto. The Utility User Tax (UUT) rates are based on the total billed amount, therefore the collection fluctuates as billed amounts change. The total UUT charges collected in August 2025 and August 2024 are \$48,000 and \$267,000 respectively. The large variance in collection of UUT charges is due to the City exempting UUT charges to the Residential customers beginning January 2025 through December 2025. Ambulance Revenue is also collected on behalf of the City of Rialto totaling \$4,000 in August 2025 and \$6,000 in August 2024.

B. Non Rate Revenue - Extraterritorial Customers

RWS bills the City of Fontana \$133,000 each month for extraterritorial sewer usage.

Colton Unified School District is in agreement with RWS to pay \$5,000 monthly for sewage connections based on enrollment rates provided each school year.

An extraterritorial agreement to provide sewer service was executed between the City of Rialto and the County of San Bernardino—County Service Area 70, Zone BL (Bloomington). This housing development project generates extraterritorial sewer service revenue of \$20,000 per month.

The City has an agreement with Social Science Services dba Cedar House Life Change Center to provide extraterritorial sewer service providing sewer revenue of about \$5,000 each month.

C. Non-Rate Revenue – Other

Other revenue is generated by leasing space for cell towers to AT&T, which has two leases at \$2,073 and \$1,500. Sprint lease is at a currently contracted rate of \$2,000 each month. Vertical Bridge also provides \$2,400 a month of cell tower generated Revenue.

Rialto Bioenergy Solutions subleased a City property for \$10,750 a month.

The City and San Bernardino Valley Municipal Water District have entered into a Brine Line Capacity Agreement on August 23, 2021. This agreement pertains to the use of its interest in the SARI Line and discharge of certain brine waste to the SARI Line exclusively from the operation of Rialto Bioenergy Facilities within the City's boundaries. The revenue generated in this agreement consists of quarterly rent of \$37,500 along with the Fixed Pipeline Capacity Fee of \$3,300 per month and Fixed Treatment Plant Capacity Fee of \$3,300 per month. In addition, a variable fee of any discharge costs are also billed.

The San Bernardino Valley Water District (SBVWD) reimburses RWS for water conservation programs provided to customers. A quarterly bill is delivered directly by the City.

D. Development Impact Fees

Development Impact Fees ("DIF") are paid to the City of Rialto as various developments are completed in the City. As such, the City of Rialto receives monies from the various developments, which is then distributed to RWS. There was no DIF payment received in August of 2025.

E. Rialto Basin Water Rights and Leasing

A Standby Water Lease Agreement between Fontana Union Water Company and City of Rialto is in effect. For the Water 2023-2024 Water Year, RWS received a payment from San Bernardino County the amount of \$332,624 for Standby Charges and Production Charge.

In addition, the County is also billed annually for Rialto Well #3's summertime electricity costs based on peak usage.

Cash Collections by Payment Method – Rialto Water Services

Payment Method	Description	Transaction Count	AUGUST 2025	%
Carrier Deposits	Cash deposits prepared per day for transport to US Bank.	21	\$ 140,286	4.08%
Remote Deposits	Scanned batches of checks payments made at the customer service counter	21	241,420	7.02%
EBOX	Batches of electronic customer payments posted to customer accounts at US Bank.	21	286,741	8.34%
PAYMENTUS - IVR / Paymentus / Walk-in Credit Card payment	Customer payments by credit cards and ACH / eCheck payments through an Interactive Voice Response system using a touchtone phone. Payments originated from Merchant online service	11,855	1,853,657	53.91%
Lockbox Deposits	Batches of customer payments mailed in to US Bank's lockbox	21	904,658	26.31%
Pay Near Me	Cash payment service that allows customers to pay at a local 7-Eleven, CVS, Walmart or Family Dollar stores.	82	11,616	0.34%
Total Revenue per Bank			\$ 3,438,377	100.00%
Recon to RUA Recap:				
Adj detailed in RUA			(74,224)	
Prior mo. Correction				
RUA increase in Cash			\$ 3,364,153	

Transaction Counts for Carrier Deposits, Remote Deposits, UB Bill Conc Service (EBOX), and Lockbox Deposits reflect number of batches deposited to the bank. Transaction counts for credit card POS, IVR, and Pay-Near-Me transactions are per number of customer payments. IVR payments are received and process by Paymentus on the day the transactions are made. General ledger are posted and accounted for the following day the payments are processed.

F. Payment Collection Method – Fiscal Year to Date

	Jul 2025	Aug 2025	Total	%
Carrier Deposits	\$ 144,793	\$ 140,286	\$ 285,079	3.66%
Remote Deposits	499,489	241,420	\$ 740,909	9.50%
EBOX	407,888	286,741	\$ 694,630	8.91%
Paymentus, IVR, Credit Cards	2,118,383	1,853,657	\$ 3,972,040	50.94%
Lockbox Deposits	1,176,928	904,658	\$ 2,081,586	26.69%
Pay Near Me	11,821	11,616	\$ 23,437	0.30%
Total Revenue to Bank	\$4,359,302	\$3,438,377	\$ 7,797,680	100.00%
NSF	(10,757)	(15,745)	\$ (26,502)	
Net deposits	\$4,348,546	\$3,422,632	\$ 7,771,178	

G. Cash Collections on Behalf of the City of Rialto-Prior Year Comparison

	Aug 2025	Aug 2024	Variance
UUT Water	\$ 19,139	\$ 83,418	\$ (64,279)
UUT Sewer	29,137	183,329	(154,192)
Ambulance	4,072	5,037	(964)
Total	\$ 52,348	\$ 271,783	\$ (219,435)

H. Non-Rate Revenue + Utility Revenue Collections Prior Year Comparison

	Aug 2025	Aug 2024	Variance
Non-Rate / Extra Territorial Revenue	\$ 48,223	\$ 287,171	\$ (238,948)
Utility Revenue	\$3,263,582	\$3,986,969	(723,387)
Total	\$3,311,805	\$4,274,141	\$ (962,336)

I. Non-Rate Revenue + Utility Revenue Collected Fiscal Year-to-Date

	Jul 2025	Aug 2025	Total
Non-Rate Revenue			
Cell Tower Rent, Lease	21,485	17,154	38,639
Interest Income	-	-	-
NRR-FOG	-	-	-
Municipal Water Sales	-	-	-
Extra Terr- Sewage	169,483	6,711	176,194
Abatement of Expenses	-	-	-
Water Meter Lost/Damaged/Repl	22,650	17,176	39,827
Misc Fees - New Occ., Same Day Svc	10,815	7,182	17,997
Miscellaneous Revenue - Sewer	-	-	-
NSF	-	-	-
Total Non-Rate Revenue	\$ 224,433	\$ 48,223	272,656
Utility Revenue			
Water Penalty	30,460	33,752	64,211
Sewer Penalty	74,191	48,802	122,993
Turf Removal, Hi-Eff Rebate	(100)	-	(100)
Water Deposits Billed	16,142	15,863	32,005
Hydrant Deposits	315	158	473
Sewer Deposits Paid	-	-	-
Sewer Deposits Billed	16,204	16,667	32,871
Water	1,329,427	1,148,584	2,478,011
Sewer	2,760,649	1,949,745	4,710,394
Unapplied Credits	26,588	50,012	76,600
Bad Debt Sewer	-	-	-
Bad Debt Water	-	-	-
Tax Roll Sewer	-	-	-
Collection Agency - Water	-	-	-
Collection Agency - Sewer	-	-	-
Collection Agency - Misc Water	-	-	-
Total Utility Revenue	\$4,253,876	\$3,263,582	\$7,517,458
Total Non-Rate + Utility Rev.	4,478,309	3,311,805	7,790,114

J. Increase in Cash Collections and Fund Distribution—Prior Year Comparison

	Increase to Cash per Incode	Adjustments Required to GL Cash	Fund 660-Sewer	Fund 670-Water	Total Cash Per GL	Adjustments To Match RUA to Bank	Cash/CC/Cks Deposit To Bank
Aug 2025	3,364,153	16,566	1,979,980	1,367,607	3,364,153	74,224	3,438,377
Aug 2024	4,545,924	3,869	2,793,085	1,748,970	4,545,924	12,748	4,558,672

K. Non-Rate and Extraterritorial Customer Accounts Receivable Aging

Name	Total as of 8/31/2025	Current	31 to 60 days	61 to 90 days	>90 days
AT&T - Easton	\$ -	-			
Cedar House	8,342	8,342			
CITY OF FONTANA	131,182	131,182			
Colton Unified School District	5,571	5,571			
County of San Bernardino-CSA 70 BL	41,895	20,948			20,948
Rialto BioEnergy Facilities	-				
Sprint-Nextel	3,456				3,456
San Bernardino Co Waste System Div	-				
SB Valley Mun Water District	-				
Vertical Bridge Holdco, LLC (CIG)	4,714				4,714
Grand Total	\$ 195,160	\$ 166,043	\$ -	\$ -	\$ 29,117

AT&T makes annual payment of one cell tower rent and monthly dues on the other. The customer is current with its payments.

Social Science Service (Cedar House) balance reflects current service fees.

City of Fontana is current with its obligations.

Colton Unified School District is current with its obligations.

County of San Bernardino has been contacted for past due balance.

Rialto Bioenergy Solutions is current with its obligations.

Vertical Bridge Holdco, LLC and Sprint: Vertical Bridge and Sprint have been contacted for open Invoices.

RIALTO WATER

MONTHLY OPERATIONS REPORT

Reporting Period:

August 2025

Prepared for: Rialto Water Services

Prepared by: Veolia Water West Operating Services

RIALTO WATER

OPERATIONS AND MAINTENANCE REPORT

Contents

I.	EXECUTIVE SUMMARY	3
A.	Water Production Totals	4
B.	Static Water Levels	6
II.	REGULATORY	7
A.	Regulatory Submittals	7
B.	Sample Site Location Results	8
C.	Violations	10
D.	Source Water Total Dissolved Solids (TDS)	10
III.	HEALTH AND SAFETY	10
A.	Monthly Safety Program Overview	10
IV.	CHEMICAL USE	10
V.	ELECTRICAL USE	11
VI.	WATER QUALITY COMPLAINTS	11
VII.	OPERATIONS UPDATE	11
A.	Operational Wells	12
B.	Valve Activity	12
C.	Hydrant Flushing	12
D.	Sanitary Survey	13
VIII.	ASSET MANAGEMENT	13
A.	Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues	13
B.	Major Equipment and/or Machinery Outages	13
IX.	RAINFALL TOTALS	14

RIALTO WATER

MONTHLY OPERATIONS REPORT

I. EXECUTIVE SUMMARY

Highlights of this month's Water O&M report include the following:

- The water distribution network achieved compliance with all permit requirements.
- No sample anomalies that require secondary sampling.
- No significant issues with water availability. The purchasing of water remained consistent and daily equalization tanks levels remained at anticipated volume for customer availability.
- The Preventative Maintenance Program, as well as Valve Exercising, continues to identify areas of focus for our Routine Repair and Replacement.

A. Water Production Totals

Total water delivered into the Rialto system this month was 1114.47 acre-feet. 914.88 acre-feet was delivered into the system from the groundwater wells (City 4A production is included in the well total). 101.03 acre-feet was delivered via the BLF transmission system (City 4A production has been deducted). 98.56 acre-feet came from the OPRTP.

AUGUST 2025 DAILY PRODUCTION TOTALS IN ACRE FEET											
							Delivered Via BLF				
								Purchased			
DATE	Chino 2	City 2	Rialto 3	Rialto 5	Miro 3	EW-1	City 4A	BOOSTER 6-9	Cactus ¹	OPRTP ²	TOTAL ³
8/1/25	5.00	5.64	5.30	0.00	4.71	0.00	9.84	5.05	5.76	4.09	35.56
8/2/25	0.00	6.58	6.40	0.00	5.98	0.00	9.09	0.46	8.25	4.06	31.73
8/3/25	0.00	10.33	6.98	0.00	6.30	0.00	10.18	7.00	7.68	1.99	40.28
8/4/25	0.00	8.67	5.39	0.00	6.00	0.00	3.23	0.96	5.79	3.31	30.12
8/5/25	5.46	3.46	6.68	0.00	6.51	0.00	9.75	6.73	5.88	3.17	37.89
8/6/25	4.43	2.94	5.85	0.00	5.91	0.00	8.45	9.18	5.10	3.49	36.90
8/7/25	6.22	5.46	5.81	0.00	6.36	0.00	9.14	7.76	5.83	3.01	40.44
8/8/25	0.51	6.68	7.87	0.00	6.27	0.00	9.51	4.75	5.39	3.60	35.08
8/9/25	0.00	7.00	5.07	0.00	5.86	0.00	7.80	6.89	7.21	3.53	35.56
8/10/25	0.00	8.40	6.77	0.00	6.67	0.00	10.66	7.21	5.60	2.70	37.36
8/11/25	4.59	2.32	5.62	0.00	5.78	0.00	6.46	5.62	8.53	3.19	35.66
8/12/25	5.51	4.75	6.66	0.00	6.61	0.00	9.60	6.77	5.35	3.33	38.98
8/13/25	4.96	4.47	5.99	0.00	5.66	0.00	9.29	5.92	4.04	3.65	34.69
8/14/25	4.61	0.00	5.60	0.00	6.42	0.00	7.62	3.24	6.36	2.86	29.09
8/15/25	4.34	6.88	5.83	0.00	5.78	0.00	9.46	4.41	5.95	3.27	36.46
8/16/25	4.22	4.51	7.16	0.00	6.34	0.00	9.08	1.15	10.18	3.23	36.80
8/17/25	8.06	2.74	6.96	0.00	6.66	0.00	8.55	8.38	5.23	2.92	40.95
8/18/25	2.71	6.02	6.66	0.00	6.96	0.00	8.27	5.28	6.96	3.64	38.23
8/19/25	5.28	1.59	5.35	0.00	2.24	0.00	10.82	5.72	4.75	3.61	28.54
8/20/25	5.26	4.26	4.66	0.00	9.06	0.00	7.28	6.84	5.26	2.59	37.92
8/21/25	6.29	4.11	7.32	0.00	6.00	0.00	7.85	7.02	5.17	2.50	38.41
8/22/25	5.49	3.01	7.69	0.00	6.69	0.00	8.43	2.96	5.44	2.97	34.25
8/23/25	3.90	1.95	5.07	0.00	5.77	0.00	9.96	8.45	10.27	3.18	38.60
8/24/25	6.24	5.05	6.77	0.00	6.34	0.00	10.35	2.13	8.92	3.00	38.45
8/25/25	3.99	2.35	5.85	0.00	6.29	0.00	6.58	6.82	5.46	3.11	33.88
8/26/25	5.19	1.40	6.47	0.00	6.32	0.00	10.13	7.92	5.19	3.01	35.50
8/27/25	5.35	1.59	5.51	0.00	5.63	0.00	7.91	7.23	5.12	2.90	33.32
8/28/25	5.56	3.45	6.84	0.00	6.51	0.00	8.88	5.00	3.95	2.98	34.29
8/29/25	5.88	4.67	6.20	0.00	6.31	0.00	9.33	8.22	7.34	3.36	41.97
8/30/25	5.21	0.18	5.79	0.00	5.86	0.00	7.61	5.69	4.43	3.15	30.30
8/31/25	5.16	3.45	4.98	0.00	4.88	0.00	10.62	8.98	6.63	3.16	37.24
TOTAL	129.42	133.91	191.14	0.00	188.68	0.00	271.73	179.74	193.02	98.56	1114.47
MIN	0.00	0.00	4.66	0.00	2.24	0.00	3.23	0.46	3.95	1.99	28.54
MAX	8.06	10.33	7.87	0.00	9.06	0.00	10.82	9.18	10.27	4.09	41.97
AVE	4.17	4.32	6.17	0.00	6.09	0.00	8.77	5.80	6.23	3.18	35.95

¹ Measured at point of connection at Cactus Reservoir site including production from City 4A. Amount may vary compared to billing.

² Measured at point of connection at Cedar Reservoir site. Amount may vary as compared to billing.

³ City 4A is not included in total. It has been accounted for in the Purchased total.

AUGUST 2025 DAILY BOOSTER TOTALS IN ACRE FEET								
DATE	Booster 1	Booster 2	Booster 3	Booster 4	Booster 5	Booster 6-9	Booster 10	Booster 11
8/1/25	0.00	0.00	8.69	0.00	0.00	5.05	0.00	0.00
8/2/25	0.00	0.00	4.10	0.00	0.00	0.46	0.00	0.00
8/3/25	0.00	0.00	10.95	0.00	2.46	7.00	0.00	0.00
8/4/25	0.00	0.00	3.78	0.00	1.55	0.96	0.00	0.00
8/5/25	0.00	0.00	7.38	0.00	0.56	6.73	0.00	0.00
8/6/25	0.00	0.00	7.20	0.00	0.00	9.18	0.00	0.00
8/7/25	0.00	0.00	7.05	0.00	0.00	7.76	0.00	0.00
8/8/25	0.00	0.00	7.38	0.00	0.00	4.75	0.00	0.00
8/9/25	0.00	0.00	3.68	0.00	0.00	6.89	0.00	0.00
8/10/25	0.00	0.00	13.07	0.00	0.00	7.21	0.00	0.00
8/11/25	0.00	0.00	5.89	0.00	0.00	5.62	0.00	0.00
8/12/25	0.00	0.00	5.88	0.00	2.08	6.77	0.00	0.00
8/13/25	0.00	0.00	9.46	0.00	0.30	5.92	0.00	0.00
8/14/25	0.00	0.00	1.37	0.00	0.00	3.24	0.00	0.00
8/15/25	0.00	0.00	10.15	0.00	1.31	4.41	0.00	0.00
8/16/25	0.00	0.00	0.00	0.00	0.00	1.15	0.00	0.00
8/17/25	0.00	0.00	10.33	0.00	3.98	8.38	0.00	0.00
8/18/25	0.00	0.00	5.28	0.00	0.00	5.28	0.00	0.00
8/19/25	0.00	0.00	9.07	0.00	1.17	5.72	0.00	0.00
8/20/25	0.00	0.00	5.90	0.00	0.00	6.84	0.00	0.00
8/21/25	0.00	0.00	6.90	0.00	0.00	7.02	0.00	0.00
8/22/25	0.00	0.00	5.77	0.00	0.00	2.96	0.00	0.00
8/23/25	0.00	0.00	8.26	0.00	0.00	8.45	0.00	0.00
8/24/25	0.00	0.00	4.42	0.00	6.38	2.13	0.00	0.00
8/25/25	0.00	0.00	4.95	0.00	3.72	6.82	0.00	0.00
8/26/25	0.00	0.00	7.05	0.00	0.00	7.92	0.00	0.00
8/27/25	0.00	0.00	8.58	0.00	0.00	7.23	0.00	0.00
8/28/25	0.00	0.00	4.97	0.00	0.00	5.00	0.00	0.00
8/29/25	0.00	0.00	7.76	0.00	0.00	8.22	0.00	0.00
8/30/25	0.00	0.00	4.40	0.00	0.00	5.69	0.00	0.00
8/31/25	0.00	0.00	10.97	0.00	0.00	8.98	0.00	0.00
TOTAL	0.00	0.00	210.64	0.00	23.51	179.74	0.00	0.00
MIN	0.00	0.00	0.00	0.00	0.00	0.46	0.00	0.00
MAX	0.00	0.00	13.07	0.00	6.38	9.18	0.00	0.00
AVE	0.00	0.00	6.79	0.00	0.76	5.80	0.00	0.00

B. Static Water Levels

All City of Rialto wells are sounded each month, both active and inactive well sites. Depth-to-water is measured from the well head to the static water surface. Increases in depth-to-water represent a decrease in static water level.

Depth to Water													
Wells Depth to Pump	Historical Maximum Depth to Water	Sept	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug
Chino # 1 (580 ft) In-active well	429'	411'	411'	411'	410'	412'	414'	414'	413'	413'	413'	411'	410'
Chino # 2 (550 ft)	369'	347'	343'	340'	342'	341'	335'	338'	335'	337'	334'	334'	333'
City # 1 (260 ft)	392'	247'	247'	251'	121'	126'	121'	122'	119'	117'	119'	121'	120'
City # 2 (480 ft)	402'	210'	137'	139'	147'	146'	128'	130'	128'	122'	129'	131'	125'
City # 3 (525 ft) Out of Service	505'	416'	416'	417'	414'	414'	415'	416'	416'	414'	417'	418'	418'
City # 4A (528 ft)	406'	380'	380'	380'	381'	374'	377'	375'	373'	362'	367'	370'	366'
City # 5 (385 ft) In-active well	364'	332'	322'	320'	318'	318'	321'	318'	318'	316'	316'	316'	316'
Rialto # 1 (650 ft) In-active well	588'	571'	553'	552'	561'	555'	571'	569'	565'	563'	564'	565'	562'
Rialto # 2 (550 ft) In-active well	502'	502'	501'	501'	499'	501'	496'	495'	502'	496'	498'	498'	497'
Rialto # 3 (509 ft)	478'	473'	476'	473'	472'	473'	473'	472'	472'	470'	470'	472'	471'
Rialto # 4 (450 ft) In-active well	418'	418'	418'	414'	413'	414'	415'	416'	415'	415'	414'	413'	414'
Rialto # 5 (560 ft)	387'	384'	384'	384'	385'	385'	384'	384'	386'	386'	387'	387'	387'
Rialto Well # 7 In-active well	362'	362'	362'	361'	362'	360'	360'	359'	353'	356'	354'	356'	357'
Miro # 3 (563 ft)	492'	485'	485'	484'	484'	484'	484'	484'	483'	483'	481'	480'	479'
EW-1 (780 ft)	476'	474'	473'	475'	475'	474'	472'	475'	475'	474'	475'	460'	471'

II. REGULATORY

All State of California and public health agency regulatory requirements were met.

A. Regulatory Submittals

- Monthly Summary of Distribution System Coliform Monitoring
- NPDES Discharge Letter
- Conservation SAFER Report

Sample Test Result Standards			
Type of Sampling	Units of Measure	Detectable Limit for Reporting	Maximum Contaminant Level
Total Coliform	A	--	--
E. Coli	A	--	--
Nitrate as N	mg/L	0.20	10
Perchlorate (CLO ₄)	µg/L	1.0	6.0
Total Dissolved Solids	mg/L	--	500
P= Present A= Absent mg/L = parts per million µg/L = parts per billion			

Sample Date 08/13/2025	Sample Site Location Results									
Type of Sampling	Chino 2	City 2	City 4A	Rialto 3	Rialto 5	Miro 3	EW-1	BLF Cactus	BLF 6- 9	OPRT P
Total Coliform	A	A	A	A	A	A	OUT OF SERVICE	A	A	A
E. Coli	A	A	A	A	A	A		A	A	A
Nitrate as N	3.0									
Perchlorate (CLO ₄)	1.5*			6.8*	<1.0	8.9*				
Total Dissolved Solids	160	200	280	210	270	170		360	350	280

*Sample is from the well head so it is before disinfection & treatment. Treatment is performed before it goes into the distribution system. Water going into the distribution system is <1.0 (non-detect).

B. Sample Site Location Results

Rialto Distribution Sample Results						
August 2025						
Sample Location	Free Cl Res (Field)	Total Coliform	E. Coli	Apparent Color	Odor Threshold	Turbidity
CYCLE 1 - 08/05/25	mg/l	P/A	P/A	Color Units	TON	NTU
335 W. Rialto	1.20	A	A			
1228 W. Merrill	1.10	A	A			
256 N. Fillmore	1.20	A	A			
987 W. Grove	1.20	A	A			
978 N. Driftwood	1.20	A	A			
1451 N. Linden	1.10	A	A			
469 W. Jackson	1.20	A	A			
935 E. Mariposa	1.10	A	A			
1000 N. Joyce	1.10	A	A			
766 N. Chestnut	1.10	A	A			
149 W. Victoria	1.00	A	A			
313 E. McKinley	1.10	A	A			
609 E. South	1.10	A	A			
273 E. Alru	1.20	A	A			
1161 S. Lilac	1.20	A	A			
101 E. Valley	1.00	A	A			
CYCLE 2 - 08/12/25	mg/l	P/A	P/A	Color Units	TON	NTU
210 N. Park	1.00	A	A	<3.0	1	<0.10
101 S. Larch	1.00	A	A	<3.0	1	<0.10
320 N. Wisteria	1.00	A	A	<3.0	1	0.12
861 W. Grove	1.00	A	A	<3.0	1	<0.10
1168 N. Glenwood	1.00	A	A	<3.0	1	0.11
1320 N. Fitzgerald	1.00	A	A	<3.0	1	<0.10
860 N. Willow	1.20	A	A	<3.0	1	<0.10
209 E. Cornell	1.00	A	A	<3.0	1	0.11
643 E. Margarita	1.20	A	A	<3.0	1	0.13
1170 N. Terrace Rd.	1.20	A	A	<3.0	1	<0.10
681 E. Erwin	1.00	A	A	<3.0	1	<0.10
402 E. Merrill	1.00	A	A	<3.0	1	<0.10
261 W. Wilson	1.00	A	A	<3.0	1	0.14
532 S. Iris	1.00	A	A	<3.0	1	<0.10
281 W. Hawthorne	1.00	A	A	<3.0	1	<0.10
379 W. Valley	0.94	A	A	<3.0	1	0.11

Rialto Distribution Sample Results						
August 2025						
Sample Location	Free Cl Res (Field)	Total Coliform	E. Coli	Apparent Color	Odor Threshold	Turbidity
CYCLE 3 - 08/19/25	mg/l	P/A	P/A	Color Units	TON	NTU
236 N. Willow	1.00	A	A			
775 E. Foothill	1.00	A	A			
878 N. Primrose	1.10	A	A			
369 E. Van Koevering	1.00	A	A			
274 W. Valencia	1.00	A	A			
1566 N. Fillmore	0.90	A	A			
932 N. Idyllwild	0.80	A	A			
644 N. Smoketree	1.00	A	A			
605 W. Rosewood	0.91	A	A			
1189 W. Second	1.00	A	A			
775 W. Rialto	0.84	A	A			
211 E. Wilson	0.83	A	A			
595 E. Huff	1.00	A	A			
1005 S. Riverside	1.00	A	A			
794 S. Verde	1.00	A	A			
1055 W. Bloomington	0.81	A	A			
CYCLE 4 - 08/26/25	mg/l	P/A	P/A	Color Units	TON	NTU
375 S. Cactus	0.90	A	A			
101 S. Linden	1.00	A	A			
234 N. Larch	1.10	A	A			
575 N. Driftwood	1.10	A	A			
1355 W. Shamrock	1.00	A	A			
992 N. Yucca	1.10	A	A			
481 W. Cornell	1.10	A	A			
158. E. Shamrock	1.10	A	A			
749 E. Holly	1.10	A	A			
545 E. Victoria	1.10	A	A			
200 N. Sycamore	1.10	A	A			
407 E. Allen	1.00	A	A			
399 E. Montrose	1.00	A	A			
856 S. Orange	1.00	A	A			
911 S. Cactus	1.00	A	A			
220 W. Valley	1.00	A	A			
P/A + Present or Absent						

C. Violations

No violations were received during this reporting period.

D. Source Water Total Dissolved Solids (TDS)

Veolia has a goal of maintaining an acceptable blended TDS level between all its sources. This goal is achieved by shifting production to or from the lowest TDS wells or purchased low TDS water while adhering to the overall water supply strategy and meeting system demands. The TDS was 233 mg/L for the month of August as compared to 235 mg/L in July. The TDS levels are below the secondary maximum contaminant level requirements.

III. HEALTH AND SAFETY

A. Monthly Safety Program Overview

Category	Monthly Statistic
Safety Training Topics	Excavation and Trenching Competent Person
Lost Time Incidents, count*	0
Recordable Incidents, count	0
Near Miss Incidents, count	3
Vehicle Incidents, count	0

*A lost time incident has not occurred in the past 4340 days.

IV. CHEMICAL USE

Sodium hypochlorite is the only chemical added to the water system. A total of 3928 gallons of sodium hypochlorite was used in August as compared to 3318 gallons used in July.

V. ELECTRICAL USE

Southern California Edison (SCE) has not provided all of the data for August 2025. We will provide the data as it is received, thus will include yearly usage received to date.

SCE		kWh
Year	Month	Billed Usage
2024	September	562,739
2024	October	529,208
2024	November	266,378
2024	December	247,546
2025	January	360,398
2025	February	294,421
2025	March	223,709
2025	April	428,976
2025	May	505,764
2024	June	575,467
2025	July	842,561
2025	August	669,021

VI. WATER QUALITY COMPLAINTS

No complaints were received during this reporting period.

VII. OPERATIONS UPDATE

The overall operational strategy is to meet the daily water demand. The City of Rialto water system has six operational wells, one of which is owned by the County of San Bernardino and operated by Veolia; Oliver P. Roemer Treatment Plant (OPRTP), which is jointly owned by the City (25%) and West Valley Water District (WVWD); purchased water through the Baseline Feeder (BLF) system from San Bernardino Valley Municipal Water District (SBVMWD); and, if required to meet demand, additional water can be supplied by the City of San Bernardino (CSB) through the BLF for emergency supply only with no guarantee of actual delivery. Water produced from City Well 4A discharges into the BLF and its production is included in deliveries from that shared transmission line when City Well 4A is in service.

The overall pumping strategy is based on adjudicated rights, well availability, remediation requirements, and quality of source, cost to operate, and varying weather conditions. TDS effluent concentrations for the City of Rialto WWTP are taken into consideration when operating the facilities and water sources.

A. Operational Wells

EW-1 well was out of service due to pump issues.

B. Valve Activity

On the basis of information collected in 2019, Veolia now has a baseline assessment of all valves and has initiated a new cycle of valve exercising. 12 valves were exercised in the month of August.

Valve Turning Progress	
	Valves Turned
2020	530
2021	340
2022	463
2023	750
2024	379
2025	313

C. Hydrant Flushing

There are 63 hydrant/dead ends that are flushed annually to maintain water quality. 29 flushings were performed in August.

Hydrant/Dead End Flushing Progress	
	2025
January	0
February	0
March	6
April	6
May	11
June	0
July	0
August	29
Total	52
Progress % (83)	

D. Sanitary Survey

DDW performed field site visits on May 22 and August 22, 2024. The results of the sanitary survey were received on September 19, 2024. All minor deficiencies have been corrected and submitted to DDW.

VIII. ASSET MANAGEMENT

The following work orders were completed by Water production staff for the month of August:

- Preventive Maintenance –131
- Corrective Maintenance –53
- Predictive Maintenance –0

56– PMs planned for September 2025

A. Main Breaks, Service Leaks, Adverse Water Quality and Health/Safety Issues

The following work orders were completed by Water distribution staff for the month of August:

- Main line – 2
- Service line – 7
- Hydrants - 6
- Angle Meter Stop – 7
- Meter Box & Lid Replacement – 0
- Meter Leaks/ Replacements - 9

B. Major Equipment and/or Machinery Outages

EW-1 well was out of service due to pump issues.

IX. RAINFALL TOTALS

Highland - Los Angeles Basin - Station 251

Month Year	Total ETo (in)	Total Precip (in)	Avg Sol Rad (Ly/day)	Avg Vap Pres (mBars)	Avg Max Air Temp (°F)	Avg Min Air Temp (°F)	Avg Air Temp (°F)	Avg Max Rel Hum (%)	Avg Min Rel Hum (%)	Avg Rel Hum (%)	Avg Dew Point (°F)	Avg Wind Speed (mph)	Avg Soil Temp (°F)
Jan 2025	2.81 K	1.87	261	5.4	66.4 K	38.9	52.5	65	26	42	27.1	4.0 K	49.8 K
Feb 2025	2.87	4.35	321	8.9 K	71.3 K	45.9 K	57.8 K	80	37	56 K	40.7 K	3.5	53.8
Mar 2025	3.66	3.01	389	9.7	67.2 K	45.8	55.7	87	43	65	43.5	4.0 K	56.8
Apr 2025	4.90	1.39	480 K	9.8	73.3	48.8	60.3	82	34	56	43.5	4.2 K	61.2 K
May 2025	6.07	3.76	558	13.1	80.1	55.7	66.9 K	85	39	61 K	51.7 K	4.3	66.6 L
Jun 2025	7.31	2.58	666	15.0	88.8	59.5 K	73.1	82	33	55	55.3	4.5 K	71.4
Jul 2025	8.05 K	1.96	676	15.1	92.1 K	60.9 K	75.6 K	80	27	50 L	55.5 L	4.5 K	73.6
Aug 2025	7.58	1.90 K	590	15.8	96.7	64.9	80.2	74	25	45	56.7	4.0 K	74.6
Tots/Avg	43.25	20.8	493	11.6	79.5	52.6	65.3	79	33	54	46.8	4.1	63.5

RIALTO WASTEWATER
MONTHLY OPERATIONS REPORT

Reporting Period:
August 2025

Prepared for: - Rialto Water Services



Prepared by: - Veolia Water West Operating Services



RIALTO WASTEWATER OPERATIONS AND MAINTENANCE REPORT

Contents

EXECUTIVE SUMMARY

- 1. Collection System / Customer Service Log**
 - a. Collection System Activities
 - b. S.S.O. dates
 - c. Customer Service Call Outs
- 2. Wastewater Treatment Plant - Monthly Overview**
 - a. Significant events during the month
- 3. Treatment Facility Performance / Laboratory Activities**
 - a. See attached Monthly Performance Summary
 - B. Summary of Notices and Laboratory Tests / Reports filed with government agencies
 - c. Effluent Specifications Exceedance Discussion
- 4. Monthly Safety Program Overview**
- 5. Biosolids, Chemicals, and Utilities**
 - a. Monthly Biosolids Production
 - b. Monthly Chemical Consumption
 - c. Monthly Utilities Consumption
- 6. Odor Complaints / Actions Taken**
- 7. Major Equipment and/or Machinery Outages**
- 8. Outside Agency Activities during the Month**
 - a. Government agency or property insurance inspections
 - b. Government agency environmental, health, or safety tests/monitoring
 - c. Government agency notice of violation received
 - d. Government agency monitoring
 - e. Other matters of concern
- 9. Complaint Logs**

TABLES

- Treatment Facility – Monthly Performance Summary
- Collection System- Monthly Pipe Cleaned

RIALTO WASTEWATER

MONTHLY OPERATIONS REPORT

EXECUTIVE SUMMARY

Highlights of this month's Wastewater O&M report include the following:

- The treatment plant performed well and met all compliance parameters.
- There were one residential call-outs for sewer-related issues.

1. Collection System/Customer Service Log

a. Collections group activities this month:

Category	Current Month Statistics	Prior Month Statistics	2025 Year to Date Statistics
Sanitary sewers are cleaned using the conventional method, including feet, which includes "Hot spot cleaning."	25,175	7,296	162,255
Sanitary sewers assessed using the SL-RAT method, feet	0	5,888	21,112
CCTV Inspection, miles (26 is the annual goal)*	2.36	0.47	17.29
Manhole Inspections	3	4	38
USA Dig Alert Markings, count	47	34	288
Residential call-outs	3	1	18
Sanitary sewer overflows	1	0	2

- b. S.S.O. N/A
- c. Customer Service Call Outs – See Item 9 for details.

2. Wastewater Treatment Plant – Monthly Overview

- NPDES discharge compliance parameters were achieved.

a. Significant events during the month were:

None

3. Treatment Facility Performance/Laboratory Activities

- a. See the attached Table 1, Monthly Performance Summary.
- b. Summary of Notices and Laboratory Tests/Reports filed with government agencies.
The monthly submittal of State/Federal discharge monitoring reports was completed promptly.
- c. Effluent specification exceedance discussion
See Section 2 above. N/A

4. Monthly Safety Program Overview

Category	Monthly Statistic
Safety Training Topics	0
Lost Time Incidents count*	0
Recordable Incidents, count	0
Near Miss Incidents, count	20
Vehicle Incidents, count	0

*A lost time incident has not occurred since 9-3-2020, totaling 1,822 days.

5. Biosolids, Chemicals, and Utilities

a. Monthly Biosolids Production

Biosolids	Current Month Statistics	Prior Month Statistics	2025 Year-to-Date Statistics
Wet Tons Produced	1,526.71	1,149.15	8,719.13

10,245.84

b. Monthly Chemical Consumption

Chemical	Current Month Gallons Used	Prior Month Gallons Used
Sodium Hypochlorite, Tertiary Disinfection	31,456	35,352
Sodium Bisulfite, Discharge Dechlorination	11,407	11,113
Ferrous Chloride, Digester Gas Conditioning	4,812	4,146
Polymer, Gravity Belt Thickener	474	460
Polymer, Belt Filter Press	762	762
Alum, Tertiary Filters	1	0

c. Monthly Utilities Consumption

Utility	Current Month Statistics	Prior Month Statistics
Electricity WWTP, KWH	**	424308
Electricity Lilac LS, KWH	**	908
Electricity Sycamore LS, KWH	**	474
Electricity Ayala LS, KWH	**	7789
Electricity Agua Mansa LS, KWH	**	2610
Electricity Cactus LS, KWH	**	1433
Electricity Ramrod LS, KWH	678	576
Frisbee Park LS, KWH	**	628
El Rancho Verde LS, KWH	2180	1986
Natural Gas WWTP, Therms	3580	5162

* LS is in bypass mode, pending CIP completion

** SCE has not updated this account.

6. Odor Complaints Received/Actions Taken

None

7. Major Equipment and/or Machinery Outages

- Sludge Holding Tank
- Aeration Basin #1 is currently offline.

8. Outside Agency Activities during the Month

- a. Government agency or property insurance inspections
None
- b. Government agency environmental, health, or safety tests/monitoring
Permit testing was completed for this month
- c. Government agency notices of violation received
Received Notice of Violation from the Regional Water Quality Control Board for self-reported violations for the time period 2009 - 2024
- d. Government agency monitoring
Routine monitoring reports were submitted.
- e. Other matters of concern
None

9. Customer Service Callout Details Log

Date	Address	Comments	Personnel	Manhole	To Manhole
8/5/2025	989 E Jackson	A resident called in to report a sewer backup. The mainline was inspected and was flowing upstream and downstream from home. The resident was informed to call a plumber.	JV		
8/20/2025	522 Havasu Way	A call came in about sewer coming out of a manhole. The mainline was plugged with rocks and debris. The line was cleared with the hydro-jetter.	PH		
8/27/2025	1386 N Sycamore Ave	A resident called in to report a sewer odor outside the property. The manhole at the property was checked, plus the upstream and downstream manholes. There was no blockage or odor noticed. A courtesy was performed.	JV		

Table 1 Summary

Table 1 Summary MOR

August 2025

Date	Rialto Flow	Rialto Effluent Flow	Rialto BOD	Rialto BOD	Rialto Influent BOD Load	Rialto WRF Effluent			Rialto WRF Influent		Rialto WRF Effluent		
	MGD	MGD	mg/l	mg/l	lbs/day	Effluent BOD	Effluent BOD Load	BOD % Removal	Influent TSS	Influent TSS Load	Effluent TSS	Effluent TSS Load	TSS % Removal
	MGD	MGD	mg/l	mg/l	lbs/day	mg/L	lbs/day	%	mg/L	lbs/day	mg/L	lbs/day	%
8/1/2025	7.56	7.20	260	260	16,393	<5.0	300.24	98.10					
8/2/2025	7.97	7.59											
8/3/2025	6.35	7.35											
8/4/2025	7.27	7.20	310	310	18,796	<2.5	150.12	99.20	300.00	18190.00	1.00	60.00	99.70
8/5/2025	7.31	7.32											
8/6/2025	7.23	7.50											
8/7/2025	7.74	7.64											
8/8/2025	6.61	6.80	330	330	18,192	3.2	181.48	99.00					
8/9/2025	6.76	6.99											
8/10/2025	7.29	7.57											
8/11/2025	6.77	7.19	290	290	16,374	3.1	185.89	98.90	250.00	14115.00	0.80	48.00	99.70
8/12/2025	7.93	7.79											
8/13/2025	7.28	7.13											
8/14/2025	7.12	7.34											
8/15/2025	7.20	7.36	280	280	16,813	4.3	263.94	98.50					
8/16/2025	7.10	7.04											
8/17/2025	7.25	7.48											
8/18/2025	7.58	7.28											
8/19/2025	7.04	7.64	360	360	21,137	4.3	273.99	98.80	200.00	11743.00	1.00	64.00	99.50
8/20/2025	7.19	7.52											
8/21/2025	7.04	7.72											
8/22/2025	7.20	7.34	230	230	13,811	<5.0	306.08	97.80					
8/23/2025	7.02	6.49											
8/24/2025	8.27	7.74											
8/25/2025	6.92	7.64	310	310	17,891	<2.5	159.29	99.20	210.00	12120.00	1.00	64.00	99.50
8/26/2025	7.69	7.50											
8/27/2025	7.25	7.77											
8/28/2025	7.09	6.61											
8/29/2025	7.49	7.20											
8/30/2025	6.79	7.34											
8/31/2025	7.19	7.18											
Minimum	6.35	6.49	230	230	13,811	<2.5	150.12	97.80	200.00	11743.00	0.80	48.00	99.50
Maximum	8.27	7.79	360	360	21,137	<5.0	306.08	99.20	300.00	18190.00	1.00	64.00	99.70
Total	224.50	227.46	2,370	2,370	139,407	<29.9	1821.03	789.50	960.00	56167.00	3.80	235.00	398.40
Average	7.24	7.34	296	296	17,426	<3.7	227.63	98.70	240.00	14042.00	0.95	59.00	99.60

Table 2 Summary

Table 2 Summary MOR

August 2025

Date	Rialto Influent Conductivity (uS/cm)	Rialto WRF Effluent Conductivity Daily Ave (uS/cm)	Rialto WRF Influent COD mg/l	Rialto WRF Final Effluent COD mg/l	Rialto WRF Influent TDS mg/l	Rialto WRF Filter Effluent TDS mg/l	Rialto WRF EFF FINAL TDS mg/L	Rialto Influent Inorganic Nitrogen mg/L	Rialto Effluent Inorganic Nitrogen mg/l as N
8/1/2025	1430.00	814.00							
8/2/2025	1235.00	746.00							
8/3/2025	1221.00	760.00							
8/4/2025	1331.00	702.00							
8/5/2025	1462.00	745.00	680	16.0	530.00	420.00	460.00	37.00	7.10
8/6/2025	1316.00	758.00							
8/7/2025	1361.00	684.00							
8/8/2025	1497.00	672.00							
8/9/2025	1277.00	796.00							
8/10/2025	1201.00	776.00							
8/11/2025	1296.00	781.00							
8/12/2025	1516.00	788.00							
8/13/2025	1385.00	775.00							
8/14/2025	1450.00	748.00							
8/15/2025	1141.00	774.00							
8/16/2025	1435.00	792.00							
8/17/2025	1295.00	805.00							
8/18/2025	1420.00	839.00							
8/19/2025	1699.00	828.00							
8/20/2025	1398.00	792.00							
8/21/2025	1388.00	785.00							
8/22/2025	1442.00	769.00							
8/23/2025	1365.00	794.00							
8/24/2025	1238.00	816.00							
8/25/2025	1387.00	809.00							
8/26/2025	1388.00	816.00							
8/27/2025	1490.00	788.00							
8/28/2025	1477.00	755.00							
8/29/2025	1649.00	749.00							
8/30/2025	1297.00	790.00							
8/31/2025	1273.00	788.00							
Minimum	1141.00	672.00	680	16.0	530.00	420.00	460.00	37.00	7.10
Maximum	1699.00	839.00	680	16.0	530.00	420.00	460.00	37.00	7.10
Average	1379.00	775.00	680	16.0	530.00	420.00	460.00	37.00	7.10

Table 3 Summary

Table 3 Summary MOR

August 2025

Date	Rialto WRF\Influent		Rialto WRF\Effluent		Rialto WRF\Eff		Rialto WRF\Effluent		Tranfer	Tranfer	Rialto	Tranfer Data
	Influent pH	24 hr avg. effl. pH	Effluent Temp	Effluent Ammonia	Effluent Total Coliform	Effluent Coliform 7 Day Median	Effluent Cyanide, Free Available	Eff Di(2-ethylhexyl) phthalate (DEHP)	FIT-8321 ADG #2 Flow	FIT-8321 ADG #2 Flow	Natural Gas Daily Use	FIT-8321 ADG #2 Flow
	SU	SU	Deg C	mg/L	MPN/100mL	MPN/100ML	ug/L	ug/l	cu ft/day	cu ft/day	cf/day	cu ft/day
8/1/2025	7.32	6.81	28.90		<1.8	<1.80			150342.00	150342.00	2200.00	150342.00
8/2/2025	7.42	6.88	28.90		<1.8	<1.80			150603.00	150603.00	20400.00	150603.00
8/3/2025	7.38	6.95	28.90		<1.8	<1.80			146838.00	146838.00	19900.00	146838.00
8/4/2025	7.30	7.18	29.00	<0.10	<1.8	<1.80			147321.00	147321.00	10600.00	147321.00
8/5/2025	7.21	7.28	29.10		<1.8	<1.80		<5.00	150532.00	150532.00	700.00	150532.00
8/6/2025	7.62	7.26	29.10		<1.8	<1.80			142154.00	142154.00	1000.00	142154.00
8/7/2025	7.43	7.20	29.20		<1.8	<1.80			175503.00	175503.00	100.00	175503.00
8/8/2025	7.37	7.23	29.20		<1.8	<1.80			141265.00	141265.00	1100.00	141265.00
8/9/2025	7.27	7.25	29.20		<1.8	<1.80			145999.00	145999.00	13200.00	145999.00
8/10/2025	7.14	7.35	29.00		<1.8	<1.80			135679.00	135679.00	19000.00	135679.00
8/11/2025	7.31	7.42	29.50	<0.10	<1.8	<1.80			139712.00	139712.00	5600.00	139712.00
8/12/2025	6.93	7.59	29.50		<1.8	<1.80			149086.00	149086.00	1200.00	149086.00
8/13/2025	7.32	7.67	29.60		<1.8	<1.80			166044.00	166044.00	1000.00	166044.00
8/14/2025	7.22	7.49	29.50		<1.8	<1.80			164796.00	164796.00	13900.00	164796.00
8/15/2025	7.37	7.10	29.40		<1.8	<1.80			161509.00	161509.00	18500.00	161509.00
8/16/2025	7.54	7.43	29.10		<1.8	<1.80			147766.00	147766.00	17400.00	147766.00
8/17/2025	7.33	7.03	29.20		<1.8	<1.80			150862.00	150862.00	1400.00	150862.00
8/18/2025	7.48	7.03	29.40		<1.8	<1.80			140552.00	140552.00	1000.00	140552.00
8/19/2025	7.51	7.02	29.50	0.07	<1.8	<1.80			146794.00	146794.00	800.00	146794.00
8/20/2025	7.33	7.14	29.40		<1.8	<1.80			159620.00	159620.00	900.00	159620.00
8/21/2025	6.98	7.19	29.50		<1.8	<1.80			141209.00	141209.00	28400.00	141209.00
8/22/2025	6.82	7.26	29.70		<1.8	<1.80			164437.00	164437.00	6800.00	164437.00
8/23/2025	6.94	7.21	29.60		<1.8	<1.80			125698.00	125698.00	17500.00	125698.00
8/24/2025	6.85	7.24	29.70		<1.8	<1.80			148944.00	148944.00	400.00	148944.00
8/25/2025	7.18	7.25	29.80	0.06	<1.8	<1.80			154341.00	154341.00	200.00	154341.00
8/26/2025	7.41	7.21	29.90		<1.8	<1.80			147821.00	147821.00	1200.00	147821.00
8/27/2025	7.44	7.22	29.70		<1.8	<1.80			137079.00	137079.00	1300.00	137079.00
8/28/2025	7.20	7.19	29.70		<1.8	<1.80			137243.00	137243.00	2400.00	137243.00
8/29/2025	7.47	7.17	29.50		<1.8	<1.80			152192.00	152192.00	22300.00	152192.00
8/30/2025	7.16	7.22	29.40		<1.8	<1.80			168543.00	168543.00	19400.00	168543.00
8/31/2025	7.52	7.25	29.40		<1.8	<1.80			155890.00	155890.00	8300.00	155890.00
Minimum	6.82	6.81	28.90	0.06	<1.8	<1.80		<5.00	125698.00	125698.00	100.00	125698.00
Maximum	7.62	7.67	29.90	<0.10	<1.8	<1.80		<5.00	175503.00	175503.00	28400.00	175503.00
Average	7.28	7.22	29.40	<0.08	<1.8	<1.80		<5.00	149883.00	149883.00	8326.00	149883.00

Monthly Sewer Line Cleaned

Pipe Cleaning - August 2025

Map Centre Coords
x: 2055325 y: 567234
Date Printed: 9/17/2025
Scale: 1:140000

1 mile

